
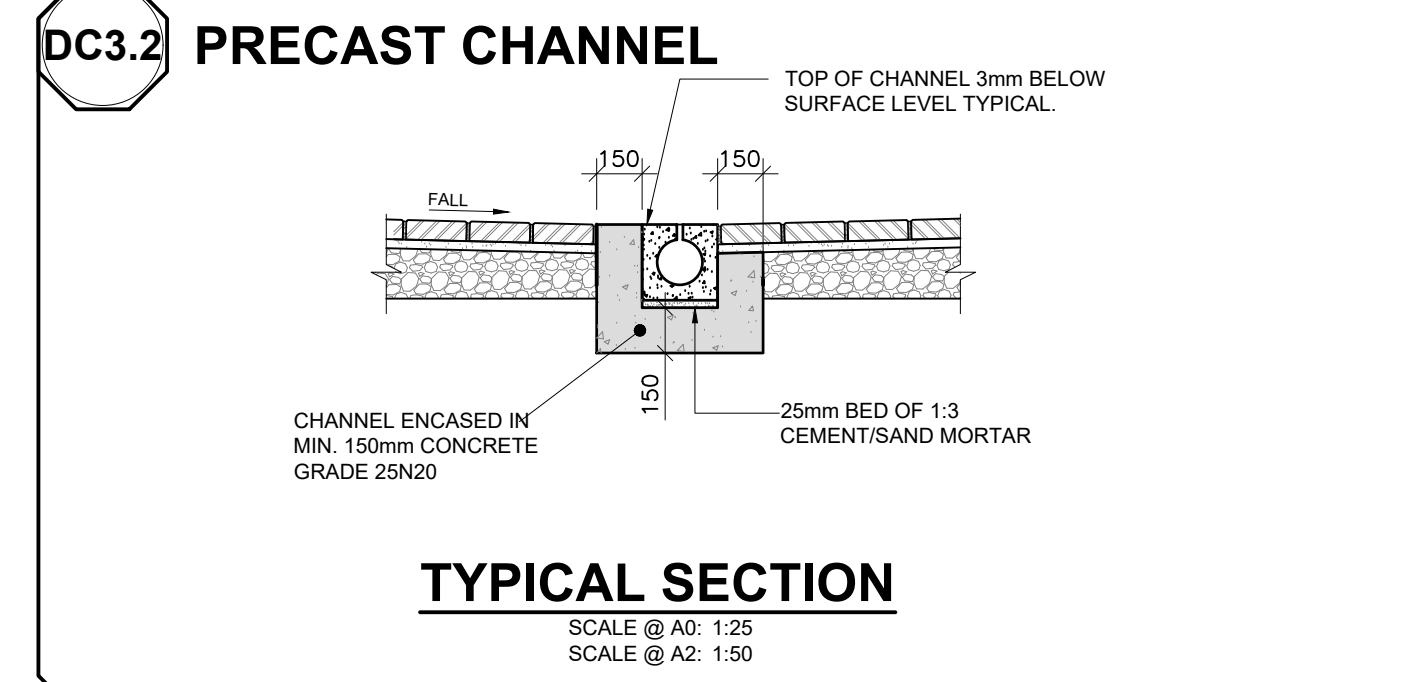
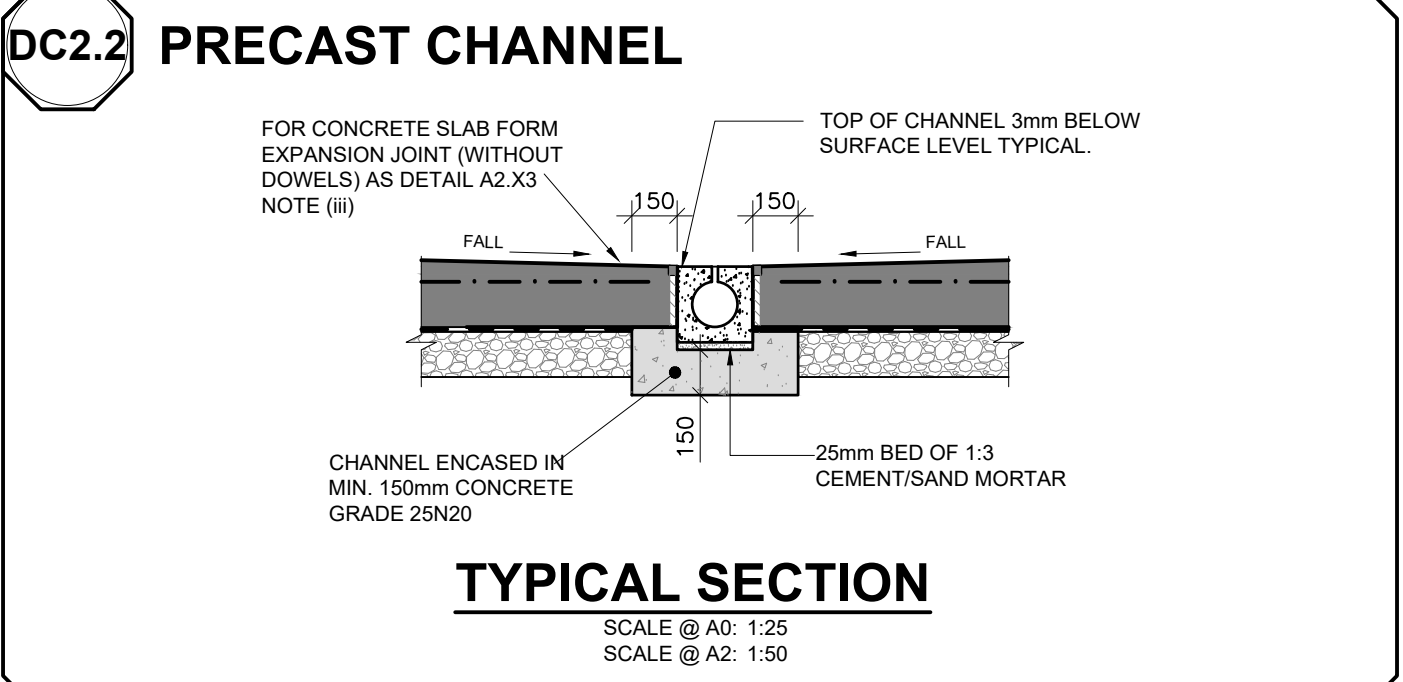
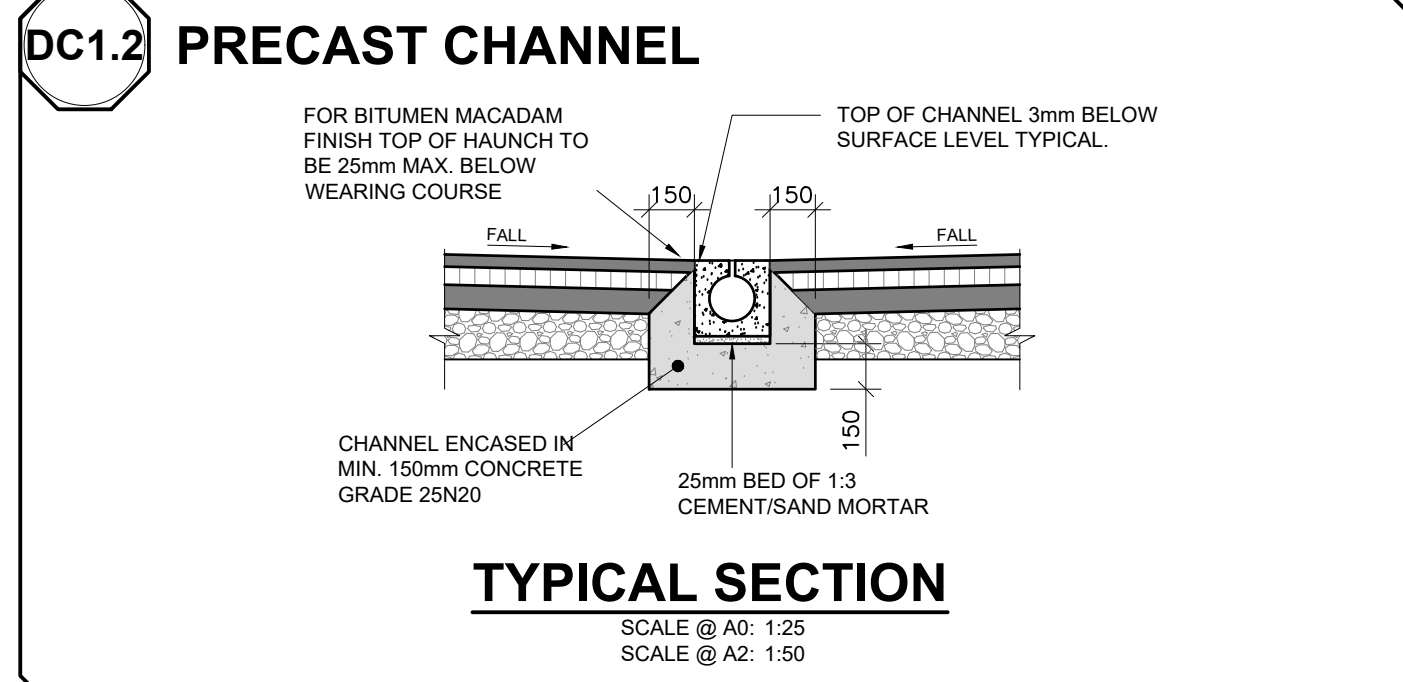
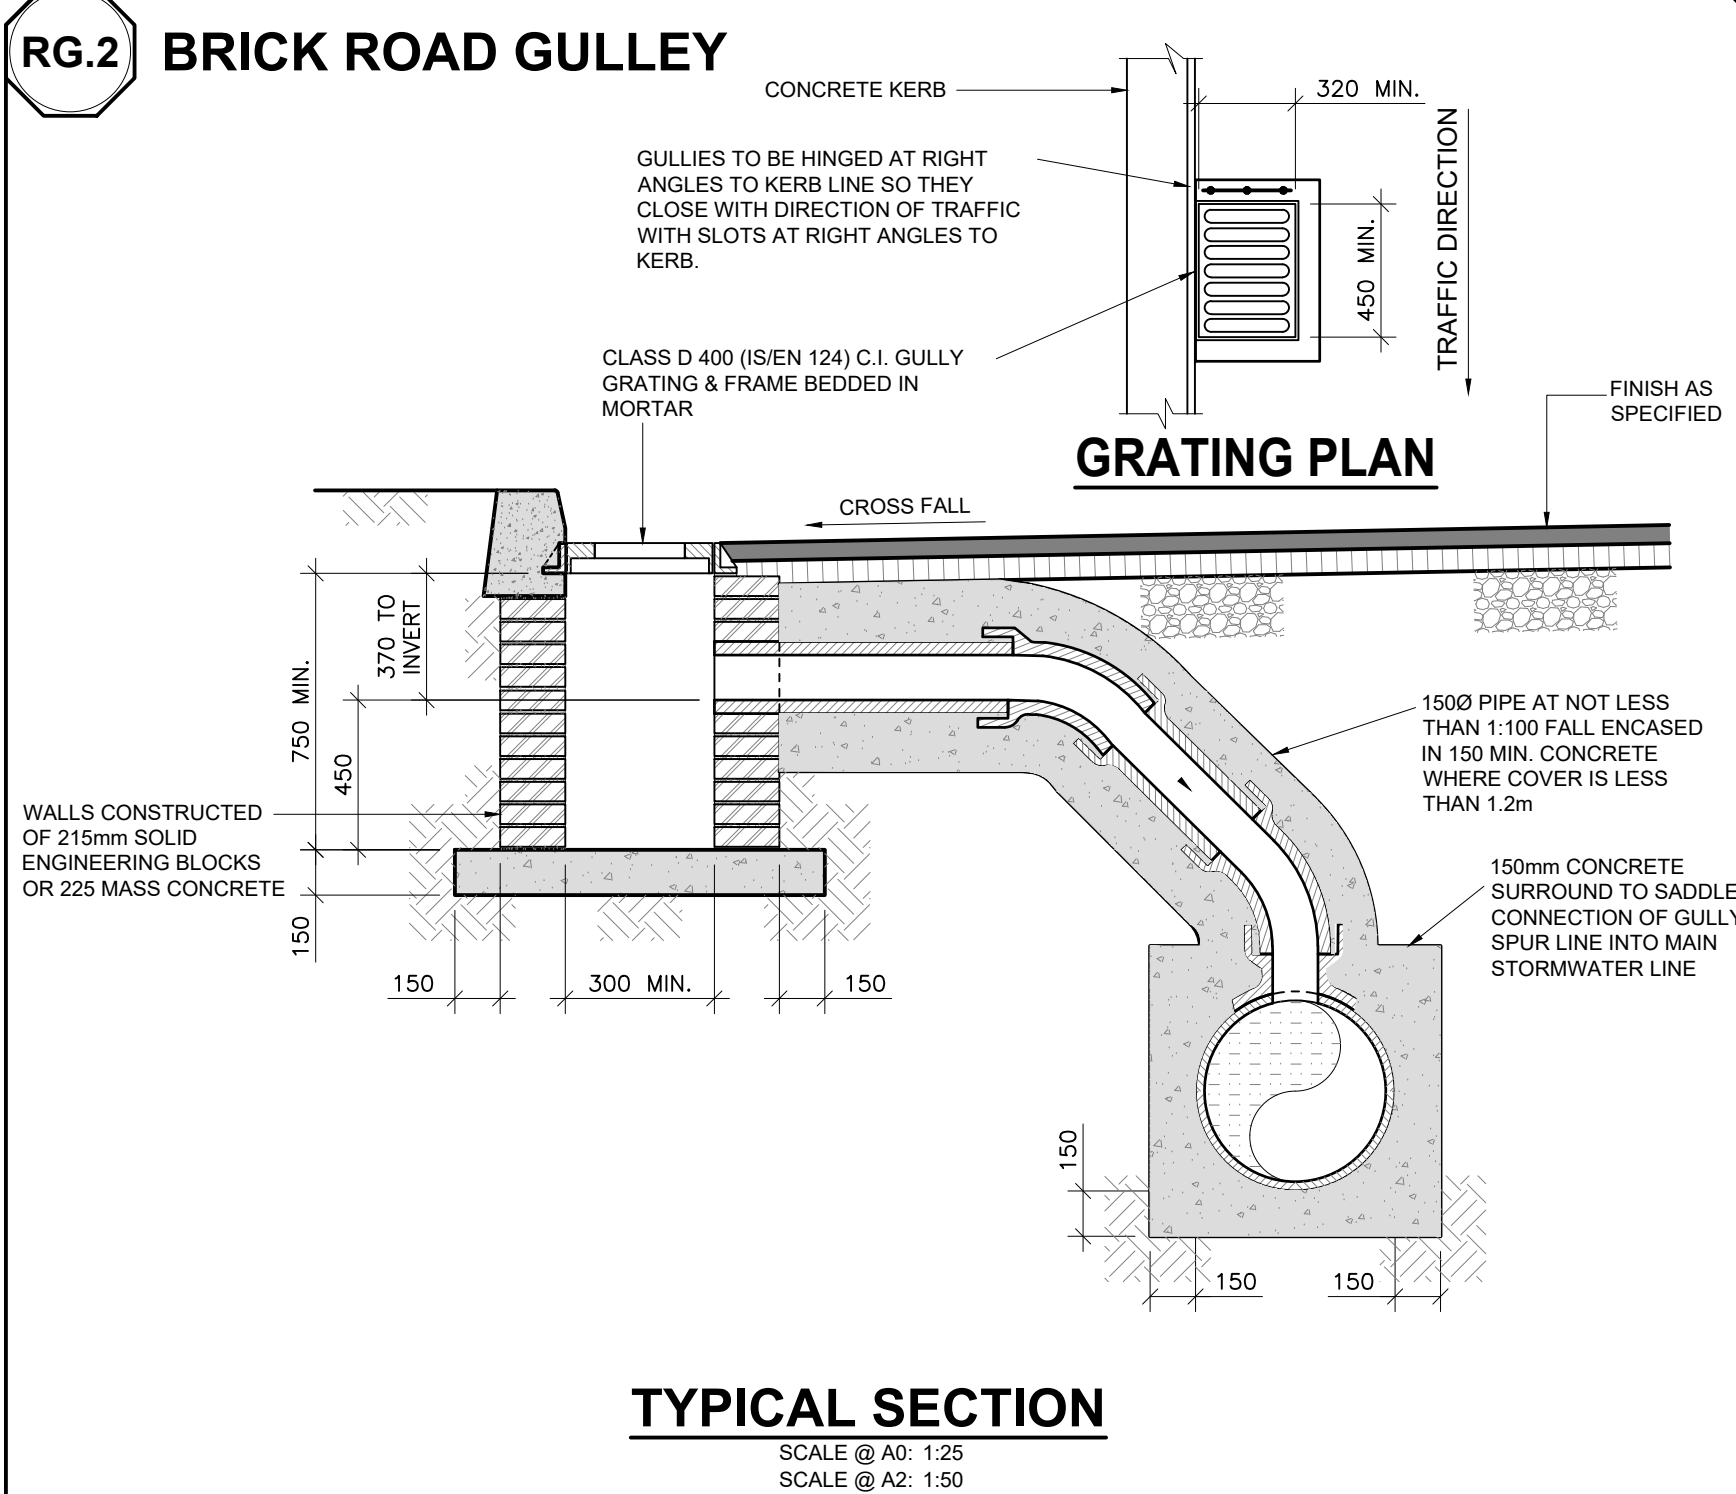


DC

DC


$$\left\{ \begin{array}{l} R \\ \end{array} \right.$$

RG.

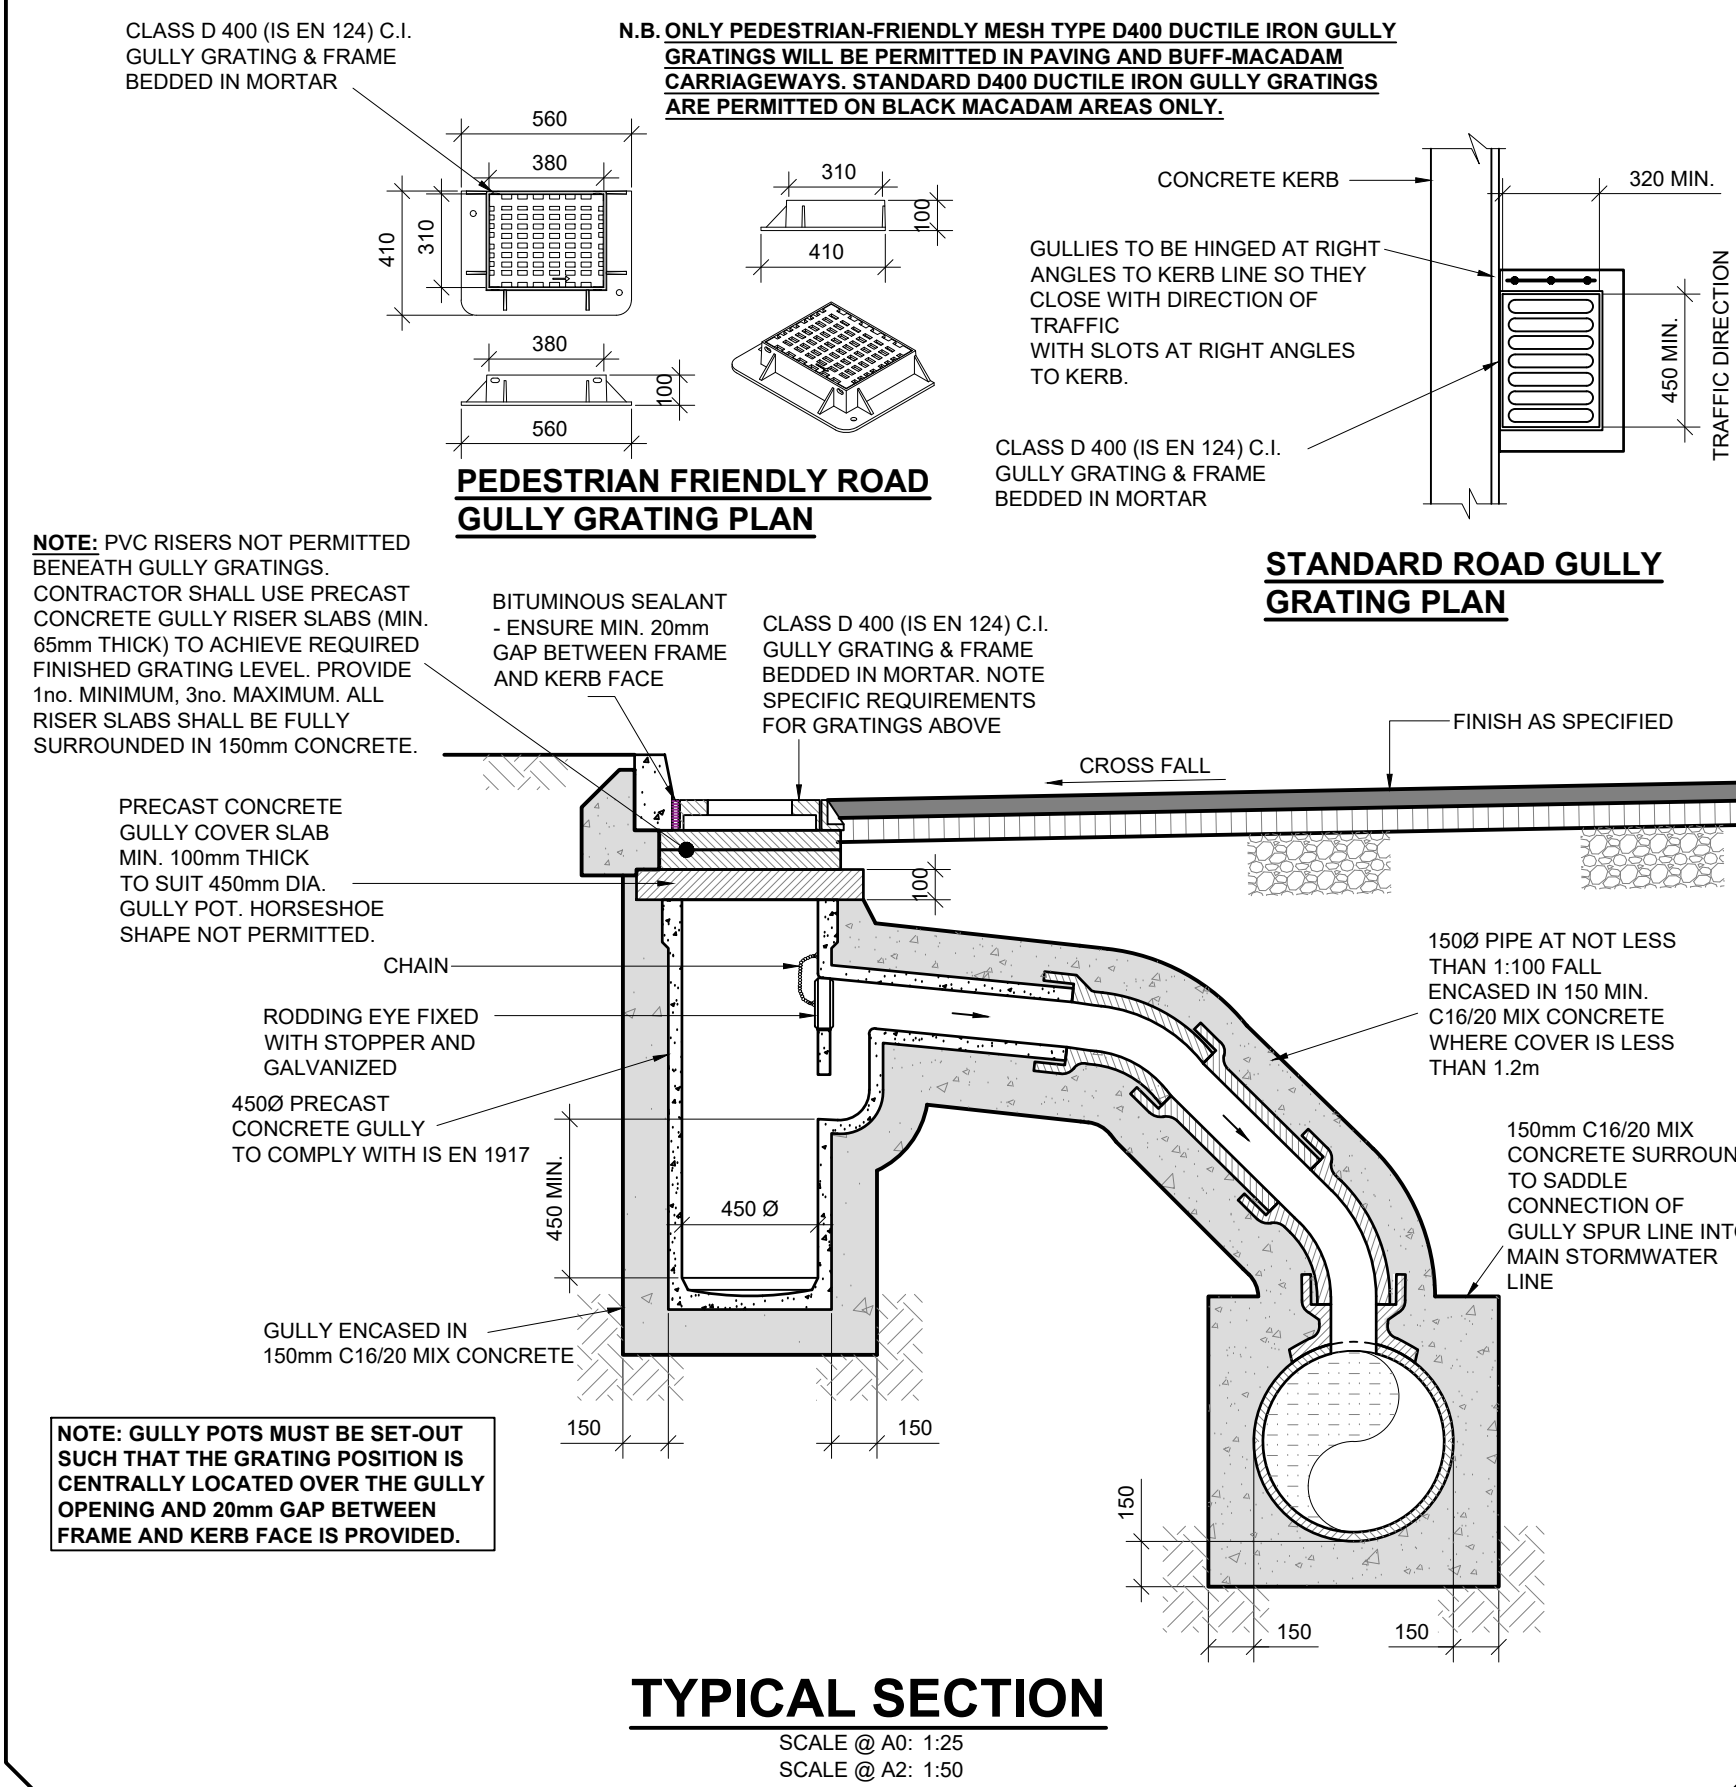

REFERENCE DRAWING

C-10000, CIVIL ENGINEERING

GENERAL NOTES FOR ROAD / FOOTPATH NOTES FOR ALL NOTE REFERRALS ON THIS DRAWING

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL ENGINEERS & ARCHITECTS' DRAWINGS REQUIRING INTERPRETATION ON THE DRAWING TO BE USED. WHERE A CONFLICT OF INFORMATION EXISTS OR IF IN ANY DOUBT - ASK
2. CONSULTANTS TO BE INFORMED IMMEDIATELY OF ANY DISCREPANCIES, BEFORE WORK PROCEEDS.
3. LINEAR DRAINAGE CHANNEL SYSTEMS SHALL BE FULLY COMPLIANT WITH BS EN 1433:2002 AND CERTIFIED TO THE LOAD CLASSES SPECIFIED ON THE DRAWINGS AND AS DEFINED IN BS EN 1433:2002.
4. GRATED LINEAR DRAINAGE CHANNEL SYSTEMS SHALL BE OF 100mm, 150mm OR 200mm NOMINAL INTERNAL WIDTH, AS SPECIFIED ON THE DRAWINGS. MANUFACTURERS SHALL BE REQUIRED TO SUPPLY CHANNELS WITH CAST-IRON GALVANISED STEEL EDGE RAILS. THE CHANNELS SHALL BE INSTALLED WITH MANUFACTURERS RECOMMENDED OR STAINLESS STEEL GRATING APPROPRIATE TO THE SPECIFIED LOAD CLASS AND LOCKED SECURELY IN PLACE. THE SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.
5. SLOTTED LINEAR DRAINAGE CHANNEL SYSTEMS SHALL BE CHOSEN ACCORDING TO THE LOAD CLASS REQUIRED AND MANUFACTURED FROM HIGH STRENGTH POLYMER COMPOSITE INCORPORATING A 10mm wide CENTRALLY POSITIONED SLOT. THE SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.
6. PRECAST KERBS SHALL BE LAID AND LEVELLED IN ACCORDANCE WITH BS 7033 PART 4. A RAISED UP OF 20mm SHOULD BE USED FOR VEHICULAR ENTRANCES AND 0mm for PEDESTRIAN CROSSINGS.
7. IN SITU KERBS SHALL COMPLY WITH THE REQUIREMENTS OF BS 5931. KERBS SHALL BE PROTECTED FROM THE EFFECTS OF ADVERSE WEATHER UNTIL CURED. A RAISED UP OF 20mm SHOULD BE USED FOR VEHICULAR ENTRANCES AND 0mm for PEDESTRIAN CROSSINGS.

NOTE:
BEFORE PAVERS / PAVEMENT WORKS ARE COMMENCED THE CONTRACTOR IS TO ESTABLISH IF THESE WORKS ARE TO BE TAKEN IN CHARGE BY THE LOCAL AUTHORITY. IF THIS IS THE CASE THE CONTRACTOR IS TO GET APPROVAL FROM THE LOCAL AUTHORITY FOR THE DETAILS SHOWN ON THIS DRAWING AND ESTABLISH INSPECTION AND TESTING REQUIREMENTS BEFORE COMMENCING THE WORK

K

