

Apartment Development Kilwoghan Woods, Celbridge - Phase 2

Daylight and Sunlight Assessment Report
Applicant: Seattle Construction Limited

"The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design." - BR 209

☎ +353 (0) 1 288 0186

✉ info@3ddesignbureau.com

🌐 www.3ddesignbureau.com



Creative & Technical 3D Solutions in
Design, Planning & Marketing.

Report Contents

1.0	Executive Summary	3
1.1	Summary of Assessment.....	3
1.2	Impact Assessment Results Overview - Neighbouring Properties:.....	5
1.3	Scheme Performance Results Overview:.....	6
1.4	Supplementary Assessment Results Overview.....	7
2.0	Methodology	8
2.1	Impact Assessment, Window Selection Criteria.....	8
2.2	Preparing the analytical model	10
2.3	Quantitative Impact Assessment Overview.....	12
2.4	Qualitative Assessment - Shadow Study	14
2.5	Quantitative Scheme Performance Assessment Overview.....	14
3.0	Analysis of Results.....	18
3.1	Analysis of Impact Assessment Results.....	18
3.2	Analysis of Scheme Performance Results.....	19
4.0	Conclusion	23
	Appendix - Results.....	24
A.0	Impact Assessment Results.....	26
A.1	Effect on Vertical Sky Component (VSC).....	26
A.2	Effect on Annual/Winter Probable Sunlight Hours (APSH/WPSH)	28
A.3	Effect on No Sky Line (NSL).....	31
A.4	Effect on Sun On Ground (SOG) in Existing Outdoor Areas	33
B.0	Shadow Studies	36
B.1	Shadow Study 21 March	36
B.2	Shadow Study 21 June	39
B.3	Shadow Study 21 December.....	43
C.0	Scheme Performance	45
C.1	Proposed Floor Plans.....	45
C.2	Spatial Daylight Autonomy (SDA) in Proposed Units.....	58
C.3	Sunlight Exposure (SE) in Proposed Units.....	76
C.4	Sun On Ground (SOG) in Proposed Outdoor Amenity Areas	93
D.0	Supplementary Study Results.....	95
D.1	SDA study, under the I.S. EN 17037 criteria	95
D.2	Supplementary No Sky Line (NSL) assessment in proposed units.	111
E.0	Glossary	127
E.1	Terms and Definitions	127
E.2	Definition of Effects	128
E.3	Definition of Levels of Sunlight Exposure.....	129
F.0	Guidelines / Standards	130

The following report has been prepared by 3D Design Bureau (3DDB). 3DDB have over eight years experience in producing daylight and sunlight assessments for large scale planning applications and are recognised as experts in the field. This report has been reviewed and overseen by Nicholas Polley and Richard Dalton. Nicholas is CEO of 3D Design Bureau and is a qualified Building Services Engineer (B.Sc.(Eng) Dip Eng) with over 25 years experience in the industry. Richard is Associate Director of 3DDB and has a bachelor's degree in Building Information Modelling (BIM) with over 20 years experience in the industry.

1.0 Executive Summary

1.1 Summary of Assessment

3D Design Bureau (3DDB) were commissioned to carry out a comprehensive daylight and sunlight assessment, along with an accompanying shadow study for the proposed apartment development at Kilwoghan Woods, Celbridge - Phase 2.

The development comprises 81 no. apartment units, 82 no. duplex units, and 76 no. house units and has been assessed with Phase 1 treated as an existing, completed development. Accordingly, Phase 1 buildings were incorporated into the baseline condition, allowing the assessment to determine any potential impacts arising from Phase 2.

Assessments have been broken down into the following two main categories, 'Impact Assessment' and 'Scheme Performance', of which there are subcategories as summarised below:

Explanations of key terms and the relevant daylight and sunlight assessment standards are included in the sections E.0 & F.0 at the end of this report.

Impact Assessment

Following advice within section 2.2 of the BRE Guidelines (BR 209 - 2022), the surrounding context was carefully considered to ensure all properties and amenity spaces that may potentially experience a level of effect were included in the study. A more detailed explanation of the criterion applied can be found in section "2.1 Impact Assessment, Window Selection Criteria" on page 8.

The impact assessment that was carried out for the purpose of this report is in accordance with the BRE Guidelines. The potential levels of effect that the proposed development would have on the surrounding existing environment and/or properties have been assessed in the 'baseline state' versus the 'proposed state'. For definition of model states, including a visual representation of the model states, please refer to section "2.2 Preparing the analytical model" on page 10.

In accordance with the criteria for assessing properties within the potential impact zone, a single property was identified: **Phase 1 unit 37**. This property is highlighted and labelled #1 on Figure 1.1 below.

The impact assessment, in accordance with the BRE Guidelines, covered the following metrics:

- Effect on daylight through the effect to the Vertical Sky Component (VSC) to the windows of this property.
- Effect on sunlight through the effect to the Annual and Winter Probable Sunlight Hours (APSH/WPSH) to the windows that are oriented within 90° of due south.
- Effect on sun on ground (SOG) to surrounding external amenity spaces labelled as:

(1) Phase 1 unit 37 back garden, (2) Ardrath View outdoor space and (3) 76A Crodaun Forest Park back garden.

The results of the impact assessments can be found in section A.0 on page 26. These results are summarised in section 1.2 and explained in section "3.1 Analysis of Impact Assessment Results" on page 18.

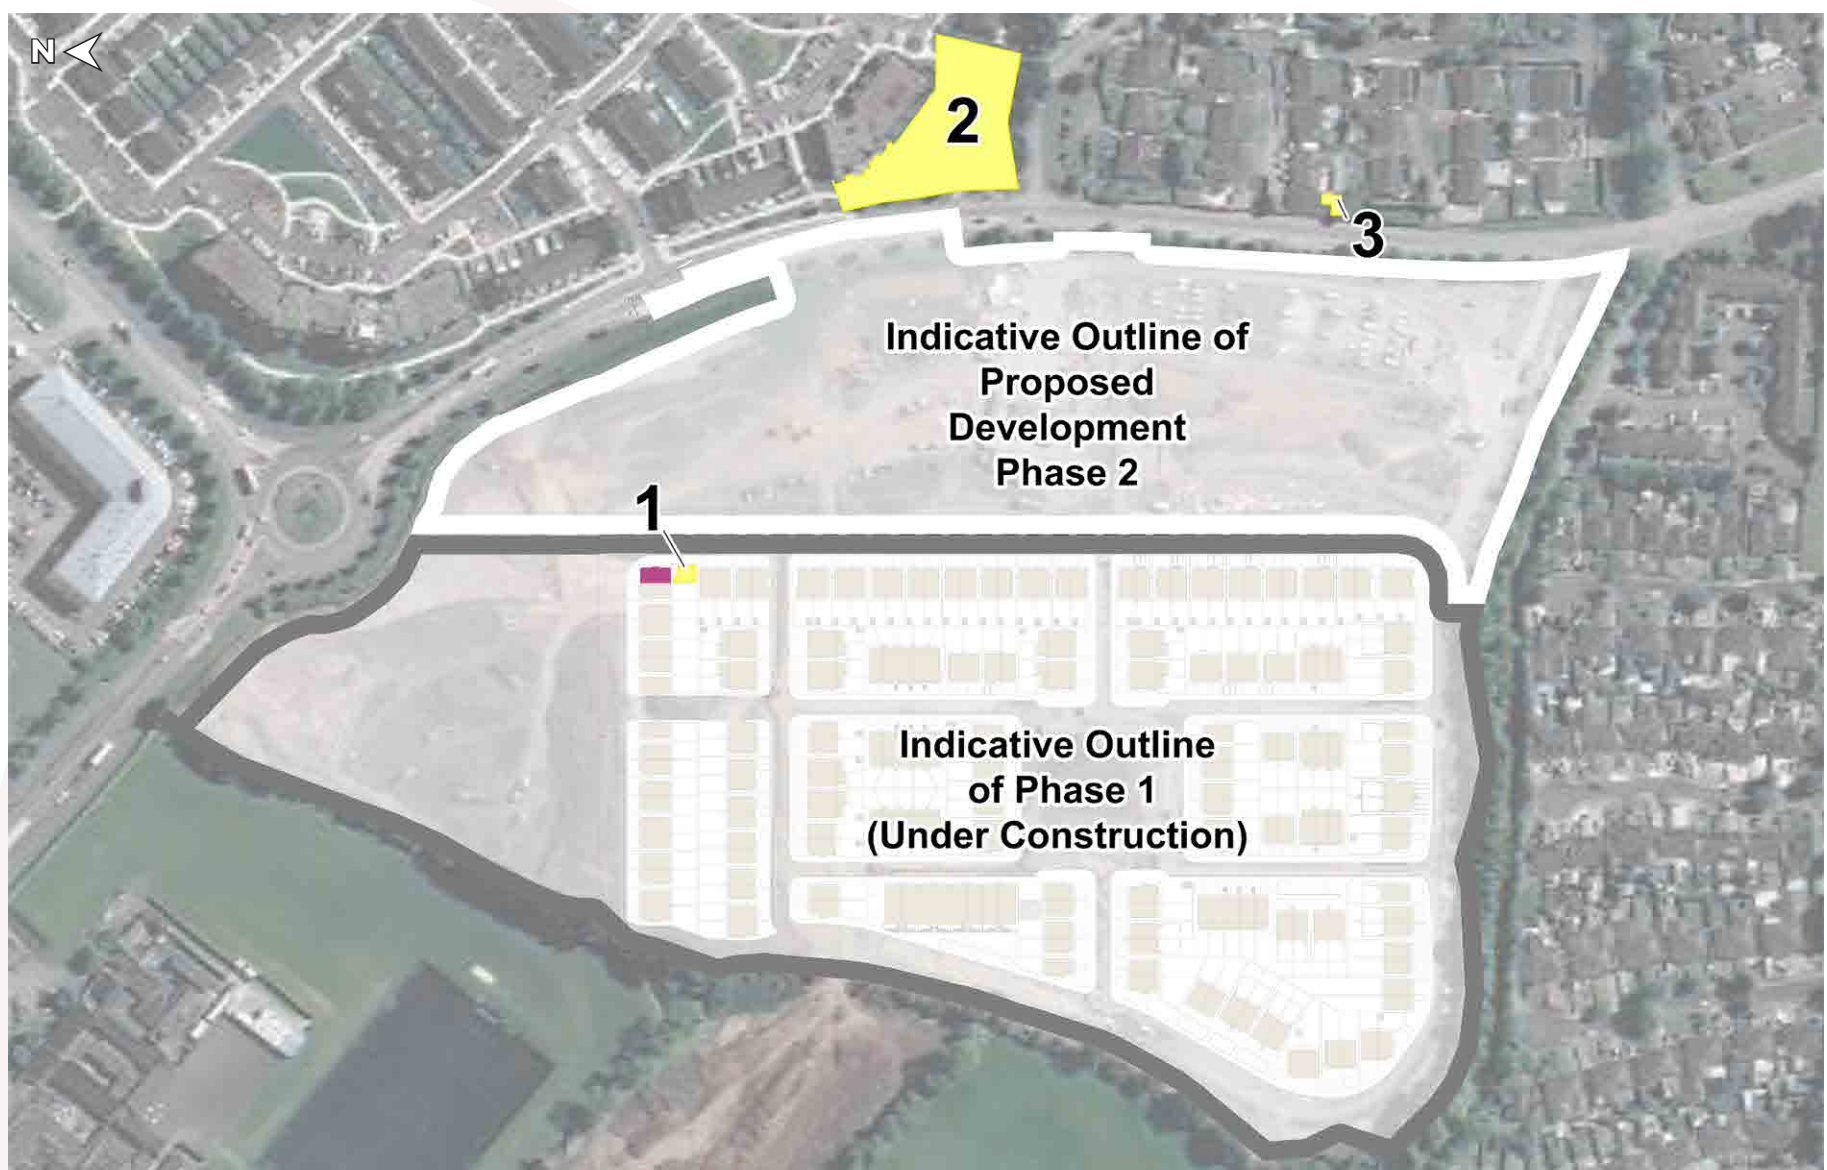


Figure 1.1: Scope of surrounding properties and environment assessed.

Scheme Performance

- **Daylight access:** Evaluated for the habitable rooms within the proposed apartment units and duplexes by means of a Spatial Daylight Autonomy (SDA) study.
- **Sunlight access:** Quantified through a Sunlight Exposure (SE) assessment for the same habitable rooms.
- **A Sun On Ground (SOG):** This assessment is used to indicate the level of sunlight on March 21st in the proposed external amenity spaces. March 21st, also known as the spring equinox, is chosen as the assessment date as daytime and night-time are of approximately equal duration on this date.

The results of these scheme performance assessments, which are in accordance with the BRE Guidelines, can be found in section C.0 on page 45. These results are summarised in section 1.3 and explained in section “3.2 Analysis of Scheme Performance Results” on page 19.

Supplementary scheme performance studies have also been carried out. These include an SDA assessment under the I.S. EN 17037 criterion, and a No Sky Line (NSL) study within proposed habitable rooms. The results of the supplementary scheme performance assessments can be found in section D.0 on page 95.



Figure 1.2: Model view of the site proposed state

Qualitative Assessment

In addition to the quantitative assessments detailed in the ‘Impact Assessment’ and ‘Scheme Performance’ sections, this report includes a qualitative assessment. This is provided through the false colour plans of the proposed SOG assessment (section C.4 on page 93) and the hourly renderings of the shadow study (section B.0 on page 36).

Overall Summary Conclusion

The findings of this report demonstrate that the proposed development at Kilwoghan Woods performs strongly in terms of daylight and sunlight compliance. Neighbouring properties would not experience any adverse effects, while the internal daylight and sunlight levels across the proposed units and amenity spaces are shown to be favourable.

1.2 Impact Assessment Results Overview - Neighbouring Properties:

Effect to Daylight - Vertical Sky Component (VSC) :

Effect to Vertical Sky Component (VSC)	
Windows/Rooms Assessed	5
Negligible	5
Minor Adverse	0
Moderate Adverse	0
Major Adverse	0
Beneficial Impact*	0
n.a.**	0

Effect to Sunlight - Annual Probable Sunlight Hours (APSH): ‡

Effect to Annual Probable Sunlight Hours (APSH)	
Windows/Rooms Assessed	1
Negligible	1
Minor Adverse	0
Moderate Adverse	0
Major Adverse	0
Beneficial Impact*	0
n.a.**	0

Effect to Sunlight - Winter Probable Sunlight Hours (WPSH): ‡

Effect to Winter Probable Sunlight Hours (WPSH)	
Windows/Rooms Assessed	1
Negligible	1
Minor Adverse	0
Moderate Adverse	0
Major Adverse	0
Beneficial Impact*	0
n.a.**	0

Effect to Sun On Ground (SOG):

Effect to Sun On Ground (SOG)	
Areas Assessed	3
Negligible	3
Minor Adverse	0
Moderate Adverse	0
Major Adverse	0
Beneficial Impact*	0
n.a.**	0

The levels of effect in the tables above describe the effect the proposed development would have, based on its compliance with the various BRE Target Values. A full list of definitions and a numerical rationale for each can be found in the section "Definition of Effects" on page 128.

*'Beneficial Impact' will only be stated if the ratio of change is greater than 1.20 (an improvement of 20%). Should less perceptible improvements occur a 'Negligible' level of effect will be stated.

**In instances where a baseline value is particularly low, levels of effects can appear exaggerated. To mitigate such occurrences, If the baseline value in the VSC, APSH/WPSH or SOG studies is below 1%, 3DDB have categorised the level of effect as n.a. (not applicable). Where windows/gardens/amenity areas are considered non-applicable, these instances are not included in the compliance rates calculation.

‡APSH/WPSH Note: as per the recommendations made in section 3.2.3 of the BRE Guidelines, only windows/rooms with an orientation within 90° of due south need to be included in the APSH/WPSH impact assessment. Therefore, the number of windows assessed in this study is typically reduced when compared with the VSC impact assessment.

1.3 Scheme Performance Results Overview:

Spatial Daylight Autonomy (SDA):

Spatial Daylight Autonomy (SDA) BRE 209 Criteria	
Unit Count	163
Rooms Assessed	472
Without Trees	
Compliant	457
Non-compliant	15
Compliance Rate*	c. 97%
With Trees (Proposed and Existing Trees)	
Compliant	443
Non-compliant	29
Compliance Rate*	c. 94%
Note: It is the expert opinion of 3DDB that the appropriate criteria for SDA assessments are that of the BRE Guidelines (BRE 209)	

* Compliance rates stated for the SDA analysis are based on the rooms that have been assessed within the apartment units and duplexes of the proposed development. Units which contain non-compliant rooms will have Compensatory Design Solutions provided by the project architects.

Sunlight Exposure (SE):

Sunlight Exposure (SE)	
Units Assessed	163
SE without deciduous trees	
Non-Compliant	19
Minimum	14
Medium	20
High	110
Compliance Rate*	c. 88%
SE with trees as opaque objects	
Non-Compliant	19
Minimum	15
Medium	24
High	105
Compliance Rate*	c. 88%

For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.

* Compliance rates stated for the SE analysis are based on the units that have been assessed.

Sun On Ground (SOG)	
Areas Assessed	12
Areas meeting the guidelines	12
Areas not meeting the guidelines	0
Compliance Rate*	100%

Sun On Ground (SOG) in proposed gardens / amenity areas:

* Compliance rates stated for the SOG assessment are based on the public and communal open space only.

1.4 Supplementary Assessment Results Overview

Spatial Daylight Autonomy (SDA) under I.S. EN 17037 Criterion:

Spatial Daylight Autonomy (SDA) under I.S. EN 17037 Criterion	
Unit Count	163
Rooms Assessed	472
Without Trees	
Compliant	295
Non-compliant	177
Compliance Rate*	c. 63%
With Trees (Proposed and Existing Trees)	
Compliant	282
Non-compliant	190
Compliance Rate*	c. 60%
Note: The study under the I.S. EN 17037 criterion should be considered a supplementary assessment. It is the expert opinion of 3DDB that the appropriate criteria are that of the BRE Guidelines (BRE 209)	

* Compliance rates stated for the SDA analysis are based on the rooms that have been assessed.

No Sky Line (NSL):

No Sky Line (NSL):	
Unit Count	163
Rooms Assessed	472
Yes	468
No	4
Compliance Rate*	c. 99%
Note: As the BRE Guidelines do not provide a recommended minimum for NSL in proposed developments, compliance rates for NSL are calculated using a criteria applied by 3DDB.	

* Compliance rates stated for the NSL analysis are based on the rooms that have been assessed.

2.0 Methodology

2.1 Impact Assessment, Window Selection Criteria

To determine the properties to be included in the impact assessment, the decision chart taken from the BRE Guidelines has been followed, as shown in Figure 2.2.

Accordingly, all properties within a distance of three times the height of the proposed development, as illustrated in Figure 2.1, have been considered for impact assessment.



Figure 2.1: Properties within three times the height of the proposed development

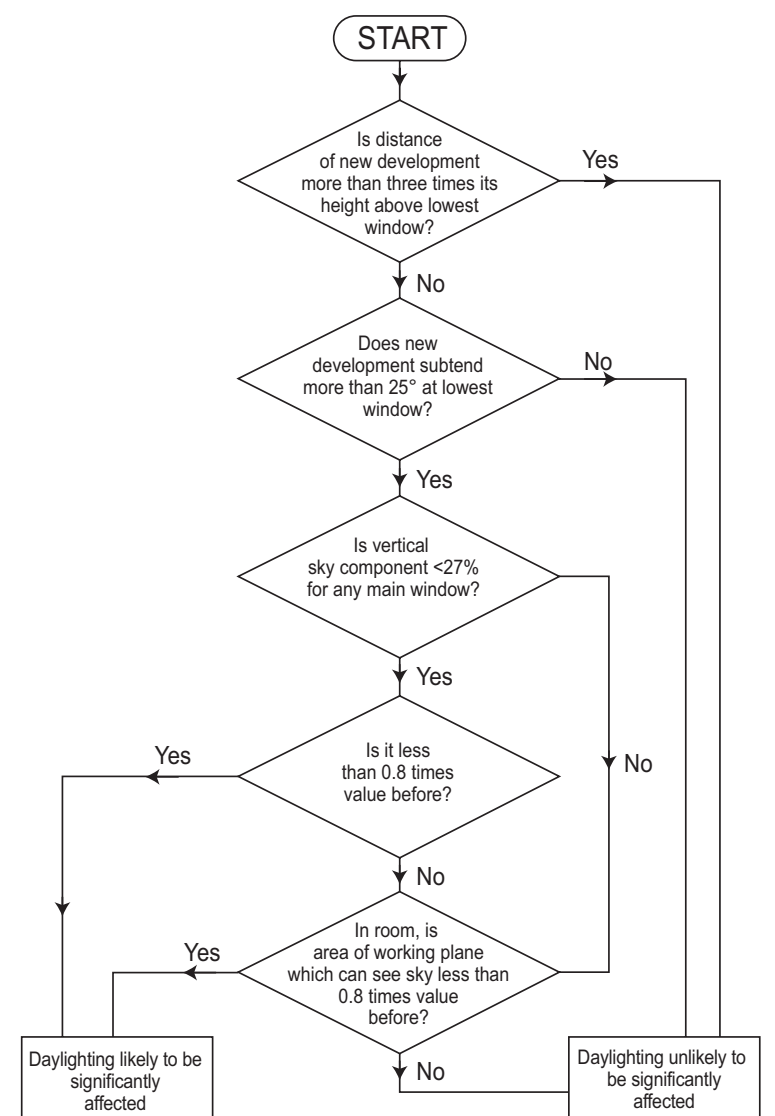


Figure 2.2: VSC decision chart, taken from BR 209.

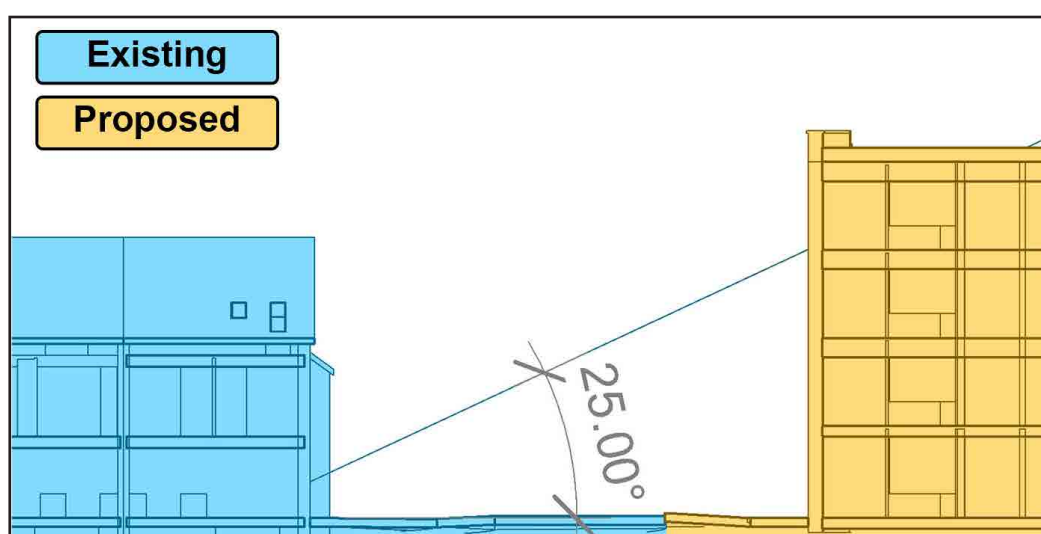


Figure 2.3: Example Section A-A taken through Phase 1 unit 37

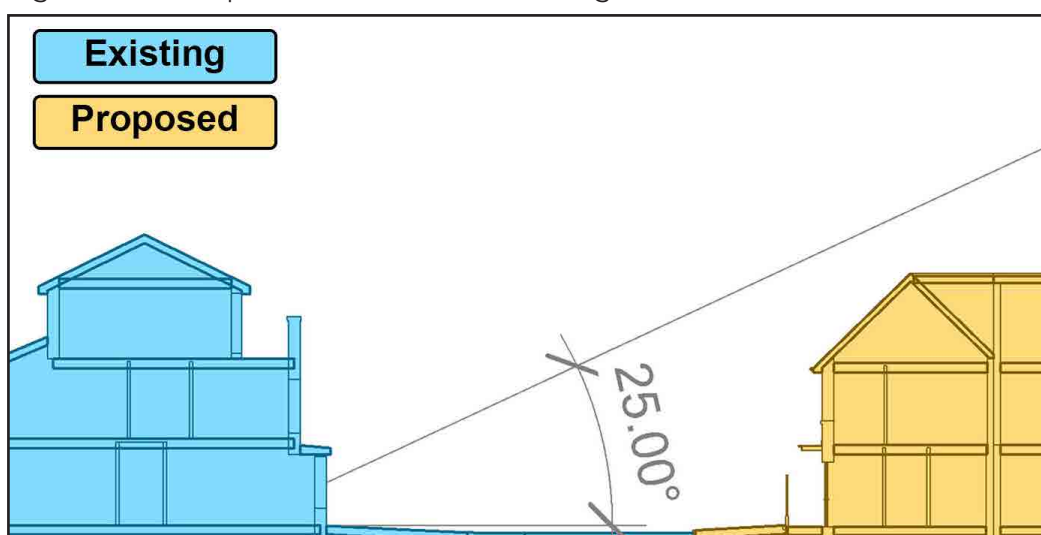


Figure 2.4: Example Section B-B taken through Phase 1 unit 28

As per the recommendation made in section 2.2.5 of the BRE Guidelines, a perpendicular section has been drawn from the main window wall of the potentially affected properties to determine if the proposed development subtends an angle of more than 25° at the lowest window.

If the proposed development subtends 25° in this section, then a VSC assessment should be conducted. Figure 2.3 shows a perpendicular section taken through Phase 1 unit 37 which provides an example of where the proposed development subtends 25° when measured in a perpendicular section through an existing window.

However, if the proposed development does not subtend 25° in a perpendicular section, daylight is unlikely to be significantly affected and no further assessment will be carried out. Figure 2.4 shows a perpendicular section taken through Phase 1 unit 28 which provides an example of where an existing window is within three times the height of the proposed development but the proposed development does not subtend 25° when measured in a perpendicular section.

According to section 2.2.10 of the BRE Guidelines, it is advisable that where VSC assessments are conducted, a no sky line (NSL) assessment should also be carried out where room layouts are known as it provides a more comprehensive understanding of daylight distribution within rooms. However, NSL assessments

require accurate information on internal room layouts and window position details that are often unavailable for existing buildings. In the case of the identified Phase 1 unit 37 building, internal layouts were provided, enabling an NSL study to be carried out for the rooms within this property whose windows were included in the VSC assessment.

Furthermore, if a proposed obstruction falls within 45° when measured both in a plan and elevation view, then it is also appropriate to conduct a VSC impact assessment to determine if daylight will be affected. This is referred to in section 2.2.17 of the BRE Guidelines as the '45° approach'. The 45° approach has been taken into consideration when determining which properties to include in the impact assessment. No property was identified following this criteria.

A detailed description regarding the methodology of the VSC assessment can be found in 2.3.1 on page 12.

Section 3.2.9 of BRE Guidelines also applies the 25° rule to determine the need for an impact assessment for loss of sunlight (APSH/WPSH). They also advise that only windows with an orientation within 90° of due south should be assessed. The BRE recommends to assess the main living rooms of dwellings and conservatories, while APSH/WPSH assessments are typically not required for kitchens and bedrooms.

In practice, 3DDB include all windows meeting the proximity criteria in an APSH/WPSH assessment if they are reasonably assumed to serve habitable spaces. This approach avoids distinguishing whether the windows serve bedrooms or living areas, thereby eliminating the need to make assumptions about the specific functions of rooms in existing dwellings.

While section 2.1.21 and 2.2.23 of the BRE Guidelines recommends conducting an impact assessment on the lowest window where daylight/sunlight is needed, if a property is found to have a window potentially affected by the proposed development, based on the previously explained criteria, other windows facing the proposed development on that property may also be assessed. This approach provides a more comprehensive understanding of the overall impact on the property.

2.2 Preparing the analytical model

2.2.1 Building the Model States

The project architect, JFA Architects supplied 3DDB with AutoCAD drawings of the proposed development from which a 3D analytical model was created. Landscape drawings were provided by PC ROCHE + associates Landscape Architects.

A site visit has not been conducted. A combination of survey information, aerial photography, available online photography and/or ordnance survey information were used to model the surrounding context and assessed buildings. **Note:** as the information gathered from online sources is not as accurate as surveyed information, a reasonable tolerance should be allowed to the placement of windows, boundary treatments and the results generated.

Baseline model state

As illustrated in Figure 2.5, the baseline model state reflects the existing environment. It includes the surrounding context and the subject site in their current standing. This includes any structures that are to be demolished as part of this application as well as the buildings from Phase 1. Existing trees were placed using photogrammetry information, with assumptions made regarding exact size, position and species.



Figure 2.5: Model view of the baseline model state

As explained in section 2.1 of this report, section 2.2.5 of the BRE Guidelines recommend that impact assessments should be carried out if any part of a new building or extension, measured in a vertical section perpendicular to a main window wall of an existing building, from the centre of the lowest window, subtends an angle of more than 25° to the horizontal. This criteria has been used to ensure all windows that could possibly sustain an adverse level of effect have been included in the model when running VSC and APSH/WPSH assessments.

Proposed model state

As illustrated in Figure 2.6, the proposed model state reflects the subject site if the development is built as proposed. This includes proposed landscaping on the subject site and the demolition of existing structures, etc. Proposed buildings have been positioned in their location on the subject site with relevant surrounding context included. Proposed trees within the development have also been included according to the information provided by the landscape architect.

All of the above information was subsequently used to prepare a digital analytical model in software specifically designed for daylight and sunlight analysis.

Relevant weather and climatic data has been obtained for this report using a localised EnergyPlus Weather File (IRL_EM_Casement.AP.039670_TMYx.epw).



Figure 2.6: Model view of the proposed model state

2.2.2 Trees

As stated in section 3.3.9 of the BRE Guidelines, the exact shapes of trees are “almost impossible to predict”. When modelling trees for this assessment tree geometry has been simplified. Where tree survey information was not provided, the position and size of existing trees have been estimated using photogrammetry information. The shape of the trees have been simplified and an average transmittance value has been applied using information from table G1 from the BRE Guidelines. Simplified models of proposed trees within the development have also been included according to the information provided by the landscape architect.

BR 209 provides guidance on how trees should be treated depending on the study being carried out, as summarised below:

Impact to Vertical Sky Component (VSC) and Annual / Winter Probable Sunlight Hours (APSH / WPSH)

Section G1.2 of the BRE Guidelines states that when assessing the effect a new development would have on existing buildings, “it is usual to ignore the effect of deciduous trees”. This is because daylight is at its scarcest and most valuable in winter when most trees will not be in leaf. Evergreen trees should be included, particularly where a dense belt or group of evergreens is specifically planned as a windbreak or for privacy purposes.

Sun On Ground (SOG)

Regarding SOG assessments, section G4.1 of the BRE Guidelines states:

“...trees and shrubs are not normally included in the calculation unless a dense belt or group of evergreens is specifically planned as a windbreak or for privacy purposes. This is partly because the dappled shade of a tree is more pleasant than the deep shadow of a building (this applies especially to deciduous trees).”

As such, deciduous trees have not been included in the calculation of SOG, unless there is a dense belt present or a group of trees specifically planned as a windbreak or for privacy purposes. Evergreen trees are included in the SOG assessment.

Sunlight Exposure (SE)

Section G3.1 of the BRE Guidelines states that as deciduous trees would not be in full leaf on the recommended assessment date (March 21st), sunlight would be expected to penetrate deciduous trees. However, as trees have so many variables, it is impossible to accurately represent how they would affect sunlight at a given time. The suggested methodology (BR 209) to allow for this is to run the sunlight exposure study in two states. Once with trees as opaque objects and secondly without deciduous trees in the assessment model. This gives a range of potential sunlight hours.

Spatial Daylight Autonomy (SDA)

BR 209 recommends when assessing daylight in a proposed building, it is appropriate to run the assessment with trees represented over the course of the whole year. Light transmittance values for the modelled trees are varied to account for summer and winter foliage.

Taking average dates from *BRE Digest 350*, appropriate light transmittance values have been applied to deciduous trees to represent the ‘full leaf’ and ‘bare branch’ states.

Evergreen trees are represented as ‘full leaf’ throughout the year.

The BRE Guidelines (section G2.3) also state:

“The calculation model should account for the obstruction to daylight caused by the trees. This needs to be done by modelling a representative shape of the trees. Often trees are irregularly shaped and simple modelling, using height and spread data and assuming a circular tree, will give inaccurate results. A special survey on site is generally required to produce the required data on the tree profile, using a clinometer or other device to measure tree height. Buildings and other solid objects should also be taken into account.”

In the absence of a ‘special survey’ being conducted, as mentioned above, simplified models representing trees have been used. The information for these trees has been taken from photogrammetry information and an arborist report when available. A reasonable tolerance should be applied to the results generated to account for trees not being represented exactly as they appear on site.

Units have also been assessed without trees to give an understanding of how the architecture performs should trees not be factored into the calculation.

I.S. EN 17037 does not give any guidance on how trees should be represented. For the purpose of this report, the SDA calculation under the I.S. EN 17037 criteria has been carried out with trees represented in the same manner as the BR 209 assessment. Units have also been assessed without trees to give an understanding of how the architecture performs should trees not be factored into the calculation.

No Sky Line (NSL)

Because some sky can usually be seen through a tree canopy, deciduous trees are not included in the No Sky Line assessment model. Evergreen trees may be included in this assessment, particularly if there is a dense belt or group planned for windbreak or for privacy purposes.

Shadow Study

The hourly renderings of the shadow study will be generated with evergreen trees represented as opaque objects, where applicable, and without deciduous trees. This method best represents the methodology used for the impact assessment and allows for a better understanding of potential shadows cast by the proposed development through the tree canopy.

2.3 Quantitative Impact Assessment Overview

2.3.1 Effect on Vertical Sky Component (VSC)

A proposed development could potentially have a negative effect on the level of daylight that a neighbouring property receives, if the obstructing building is large in relation to their distance from the existing dwelling.

Section 2.1 outlines the decision process which was used to determine the appropriate properties to be included in the VSC impact assessment.

For proposed developments, all properties within a distance of three times the height of the proposed development are considered with regards to an impact assessment. Should the angle from the windows to the proposed development subtend 25° in a perpendicular section, then VSC is calculated in both the baseline and proposed model states, and a comparison made.

A no sky line assessment requires accurate dimensions and layouts of both rooms and windows. However, the required information is rarely available for existing dwellings. As such, it is not common practice to carry out a no sky line (NSL) impact assessment.

VSC can be defined as the amount of skylight that falls on a vertical wall or window.

Where applicable, this report assesses the percentage of direct sky illuminance that falls on the assessment point of neighbouring windows that could be affected by the proposed development.

Section 2.1.6 of the BRE Guidelines states that if the VSC is:

- At least 27%, then conventional window design will usually give reasonable results;
- Between 15% and 27%, then special measures (larger windows, changes to room layout) are usually needed to provide adequate daylight;
- Between 5% and 15%, then it is very difficult to provide adequate daylight unless very large windows are used;
- Less than 5%, then it is often impossible to achieve reasonable daylight, even if the whole window wall is glazed.

Where a VSC assessment is warranted, the values for each relevant window/room may be calculated in the corresponding model states, as outlined in section 2.2 on page 10. A comparison of these results can be used to indicate the level of effect.

A proposed development could possibly have a noticeable effect on the daylight received by an existing window, if the following occurs:

- The VSC value drops below the guideline value of 27%; **and**
- The VSC value is less than 0.8 times the existing value.

In instances where a baseline value is less than 1%, the impact will be considered '*non-applicable*' (n.a.).

Under BRE Guidelines (section 2.2.2), only habitable rooms need to be assessed for effect to VSC. In the absence of design layouts or floor plans, or information pertaining to the internal 'as-built' layouts, assumptions have been made regarding the function of the windows of the existing surrounding properties (i.e. what room type is served by the window being assessed).

Typically, the effect on ground floor windows is greater than the effect on windows of subsequent floors. However, floors above ground floor level may be included in this study to give a more comprehensive assessment.

Assessment Points

The VSC impact assessment are carried out on the windows/rooms of the neighbouring properties that could be affected by the proposed development as highlighted in Figure 1.1 on page 3.

The assessment points for measuring VSC are taken from the centre point of a standard window. If the window being assessed is a full height window, the assessment point is taken at 1600 mm above the finished floor level.

Weighted Averages

If it can be determined or reasonably assumed that multiple windows are servicing the same room, each window has been assessed and a room VSC will be calculated by applying a weighted average calculation to the results.

When calculating weighted averages the proportion of the total glazing area represented for each window is taken into account. It should be noted that estimations typically need to be made regarding window sizes, so a tolerance should be applied regarding calculated weighted averages.

In instances where weighted averages have been calculated, the VSC figures will be stated for each window on an individual basis as well as the calculated figure to be applied to the room, but the level of effect will only be stated for the room.

Project Assessment

Following the BRE decision chart, as illustrated in Figure 2.2 on page 8, a VSC impact assessment has been carried out on the windows/rooms of the neighbouring properties that could be affected by the proposed development as indicated in Figure 1.1 on page 3.

A single property has been identified, namely Phase 1 unit 37, which has been assessed.

No VSC impact assessment was conducted for other properties that are within three times the height of the proposed development. This is because they do not have a window from which the proposed development would subtend an angle of 25° when measured in a perpendicular section.

The results for the VSC assessment can be found in the appendix results section A.1 on page 26, with analysis of the results in section 3.1.1 on page 18.

2.3.2 Effect on Annual/Winter Probable Sunlight Hours (APSH/WPSH)

Annual/Winter Probable Sunlight Hours (APSH/WPSH) is a measure of sunlight that a given window may expect to receive over the period of a year. The percentage of APSH/WPSH that windows in existing properties receive might be affected by a proposed development.

A proposed development could potentially have a negative effect on the level of sunlight that a neighbouring property receives, if the obstructing building is located to the south and is large in relation to their distance from the existing dwelling. This can be determined if the distance of a proposed development is less than three times its height from an existing dwelling, or if the angle from an existing window to the proposed development subtends 25° to the horizontal when measured in a perpendicular section.

Whether a window is considered for APSH/WPSH impact assessment is based on its orientation. A south-facing window will, in general, receive the most sunlight. North facing windows may receive sunlight on only a handful of occasions in a year, and windows facing eastwards or westwards will receive sunlight only at certain times of the day. Taking this into account, section 3.2.3 of the BRE Guidelines suggest that windows with an orientation within 90 degrees of due south should be assessed.

Section 2.1 outlines the decision process which is used to determine the appropriate properties to be included in a APSH/WPSH impact assessment.

The APSH/WPSH for each of the assessed windows should be calculated in the relevant model states, as outlined in section 2.2 on page 10. A comparison between the results generated using these model states can be used to determine the level of effect.

If it can be determined or reasonably assumed that multiple windows are servicing the same room, the APSH/WPSH will be assessed for the room as opposed to each individual window. When APSH/WPSH is assessed for a room it considers sunlight coming from all windows, but does not double count if sunlight is reaching multiple windows at the same time.

If a room can receive more than 25% of APSH, including at least 5% of the WPSH, then the room should receive enough sunlight.

A proposed development could possibly have a noticeable effect on the sunlight received by an existing window/room, if the following occurs:

- The APSH value drops below the annual (25%) or winter (5%) guidelines; **and**
- The APSH value is less than 0.8 times the baseline value; **and**
- There is a reduction of more than 4% to the annual APSH.

In some circumstances, the available sunlight during the winter period (WPSH) may both drop below the recommended minimum of 5% with a proposed value of less than 0.8 times the baseline value, but the reduction to annual probable sunlight (APSH) is less than 4%. Such occurrences are considered compliant with the BRE Guidelines (Section 3.2.6), and the impact to WPSH will be stated as 'n.a.' on that basis.

Additionally, where a baseline value is less than 1%, the impact will be considered '*non-applicable*' (n.a.)

According to section 3.2.3 of the BRE Guidelines, only main living-rooms, or rooms comprising living space, need to be assessed for effect on sunlight. In the absence of design layouts or floor plans, or information pertaining to the internal 'as-built' layouts, all windows assumed to be servicing habitable rooms will be included in the APSH/WPSH assessment provided they are orientated within 90° of due south and are in relative close proximity to the proposed development.

Typically, the effect on ground floor windows is greater than the effect on windows of subsequent floors. However, floors above ground floor level may be included in this study to give a more comprehensive assessment.

Assessment Points

The assessment points for measuring APSH/WPSH are taken from the centre point of a standard window. If the window being assessed is a full height window, the assessment point is taken at 1600 mm above the finished floor level.

Project Assessment

The APSH/WPSH impact assessment has been carried out on the windows/rooms of the neighbouring properties that could be affected by the proposed development as indicated in Figure 1.1 on page 3, with an orientation within 90 degrees of due south.

The assessed property is Phase 1 unit 37.

No APSH/WPSH impact assessment was conducted for other properties that are within three times the height of the proposed development. This is because they do not have a window from which the proposed development would subtend an angle of 25° when measured in a perpendicular section.

The results for the APSH/WPSH assessment can be found in the appendix results section A.2 on page 28, with analysis of the results in section 3.1.2 on page 18.

2.3.3 Effect on Sun On Ground in Existing Gardens/Amenity Areas (SOG)

Section 3.3.17 of the BRE Guidelines recommend that for a garden or amenity area to appear adequately sunlit throughout the year, at least half the area should receive at least two hours of sunlight on March 21st. As the BRE Guidelines do not provide clear criteria on which neighbouring properties should be included in an impact on SOG study, 3DDB have carefully considered the neighbouring properties that may be affected when running the impact assessment. Gardens or amenity areas included in this study are typically located within close proximity, to the north of the proposed development.

Where a quantitative assessment has not been carried out it is on the basis that the omitted areas are unlikely to be adversely affected. Such instances may be because the areas are not deemed to be in close proximity to the proposed

development or because they are located to the south. Should there be any concerns over the potential impact on any areas that have not been included in the quantitative assessment, a qualitative assessment may be carried out using a shadow study and/or false colour plans.

March 21st, also known as the spring equinox, is chosen as the assessment date as daytime and night-time are of approximately equal duration on this date.

In accordance with section 3.3.9 of the BRE Guidelines, typically deciduous trees will not be included unless there is a particularly dense belt. The analytical model for SOG impact assessment includes evergreen trees, where applicable.

Where applicable, the percentage of assessed areas which can receive two hours or more of direct sunlight on March 21st is calculated in the relevant model states, as outlined in section 2.2 on page 10. A comparison between the results generated with these model states can be used to determine the level of effect.

A proposed development could possibly have a noticeable effect on the sunlight received by an existing garden and/or amenity area, if the following occurs:

- Half the area of the space does not receive at least two hours of sunlight during the spring equinox; **and**
- The area that receives more than two hours of sun on the spring equinox is less than 0.8 times its former value.

In instances where a baseline value is less than 1%, the impact will be considered '*non-applicable*' (n.a.)

Effect on sunlight to existing neighbouring gardens and/or amenity areas has been assessed to the north of the proposed development, as areas located to the south are unlikely to be affected as the sun does not cast shadows in this direction. Overshadowing is highly unlikely to occur in areas that are due south of any proposed development.

Project Assessment

The SOG impact assessment has been carried out on the neighbouring gardens/amenity areas that could be affected by the proposed development as outlined above.

A quantitative SOG impact assessment has been carried out on areas surrounding the subject site. The areas considered for assessment are the rear garden of Phase 1 unit 37, the outdoor space of Ardrath View and the rear garden of 76A Crodaun Forest Park.

Other areas were excluded because they are either located to the south of the proposed development, meaning shadows will be cast in the opposite direction, or they have sufficient separation distance from the proposed development. The relatively low height of the new development is another factor that reduces the likelihood of overshadowing.

The results of the impact to sun on ground assessment in the neighbouring gardens/amenity areas (including a visual representation in the form of 2-hour false colour plans) can be found in the appendix results section A.4 on page 33, with analysis of the results in section 3.1.3 on page 18.

2.4 Qualitative Assessment - Shadow Study

A shadow study has been carried out to allow a qualitative comparison between the relevant model states, as outlined in section 2.2 on page 10. This visual representation of the shadows cast by the proposed development can be found in the hourly shadow diagrams in the appendix results section B.0 on page 36.

Hourly renderings have been shown from sunrise to sunset on the following dates in 2025:

- Spring equinox: March 21st Sunrise 6:31 | Sunset 18:35. (GMT)
- Summer solstice: June 21st Sunrise 5:05 | Sunset 21:51. (BST) (Daylight savings)
- Winter solstice: December 21st Sunrise 8:47 | Sunset 16:02. (GMT)

The shadow study has been generated using the same model states as described in section 2.2.1. In certain cases, assumptions or estimations may have been made when modelling elements of the surrounding context and/or proposed site details when creating the various model states. Therefore, it is advisable for a reasonable tolerance to be applied when interpreting shadows in the qualitative assessment.

The hourly renderings of the shadow study will be generated without deciduous trees and with evergreen trees, where applicable, represented as opaque objects when present in the model states.

Note: The spring equinox (March 21st) and autumn equinox (21st September) yield similar shadows, albeit with a one hour difference as daylight saving time (BST) would be in effect. Only the spring equinox was included in the shadow study images in accordance with section 3.3.14 of the BRE Guidelines.

2.5 Quantitative Scheme Performance Assessment Overview

2.5.1 Spatial Daylight Autonomy in Proposed Habitable Rooms (SDA)

Since the publication of the 3rd edition of the BRE Guidelines (BR 209 - 2022), Spatial Daylight Autonomy (SDA) is the recommended metric for assessing daylight access within a proposed development. Spatial Daylight Autonomy replaces Average Daylight Factor (ADF) in this regard, which was the recommended metric under the 2nd edition of the BRE Guidelines (BR 209 - 2011).

Spatial Daylight Autonomy assesses whether a room receives sufficient daylight on a working plane during standard operating hours on an annual basis. A given target value should be achieved across 50% of the working plane for half of the daylight hours.

There are two methods for calculating SDA:

- **Calculation method using illuminance level:** This requires the use of a detailed daylight calculation method where hourly (or sub-hourly) internal daylight illuminance values for a typical year are computed using hourly (or sub-hourly) sky and sun conditions derived from climate data appropriate to the site. This calculation method determines daylight provision directly from simulated illuminance values on the reference plane. The illuminance value of at least half the required area of the space should equal or exceed the target values.
- **Calculation method using daylight factor:** The daylight factor method assumes a constant ratio between internal and external illuminance. The daylight factors in the space shall be calculated by any reliable method that is based on the ISO 15469:2004 standard overcast sky (TYPE 1 or TYPE 16). Daylight factors are to be predicted across grid of points on a plane 0.85m above the floor of the space. The daylight factor of at least half the required area of the space should equal or exceed the target values.

It is the opinion of 3DDB that the calculation method using illuminance level better represents a real-world scenario as it accounts for the quality of daylight based on orientation. As such, the illuminance methodology has been adopted as the preferred SDA assessment methodology by 3DDB. A localised EnergyPlus Weather File is used to apply the relevant climate information. In the case of this report, the weather file used is IRL_EM_Casement.AP.039670_TMYx.epw.

In terms of housing, BR 209 provides target SDA values to be received across at least 50% of the working plane for at least half the daylight hours. The target values differ based on the function of the room assessed:

- 200 Lux for kitchens • 150 Lux for living rooms • 100 Lux for bedrooms

Where rooms serve more than one function, the higher SDA target value should be taken. In new developments, some internal spaces (e.g. studio apartments, shared communal areas etc.) can possibly be of a nature that do not have a predefined target value in BR 209. In such instances, 3DDB have applied a target value they deem to be appropriate.

The proposed development also includes a childcare facility on the ground floor of Block A. However, there is not a predefined target value in BR 209 for such spaces. Therefore, 3DDB applied an SDA target value of 200 Lux to these rooms. This target was chosen because the classrooms are designed for group use, and the value typically assigned to living rooms was deemed appropriate. These rooms have not been included in the calculated compliance rates.

Under I.S. EN 17037 at least 50% of the working plane should receive above 300 lux for at least half the daylight hours, with 95% of the working plane receiving above 100 Lux for all rooms. The target SDA values do not vary depending on the room function under this criteria.

This study has assessed the Spatial Daylight Autonomy (SDA) received in the habitable rooms of the proposed development under the BR 209 criterion. The SDA of the proposed development has been calculated under the I.S. EN 17037 criterion as part of a supplementary assessment.

Defining Rooms

Definition of rooms are typically taken directly from the architectural drawings supplied by the project architect. Sometimes, the applied names of rooms may differ slightly. e.g. A “Kitchen / Living / Dining room (KLD)” may be referred to as a “Living / Kitchen / Dining room (LKD).

According to section 2.1.14 of the BRE Guidelines areas like bathrooms, stairwells, garages, and storage areas do not have a special requirement for daylight. As such these spaces have not been assessed.

Where SDA assessment has been conducted, an indication of the assessed space in each room will be indicated in the floor plans that correspond to the SDA results in the appendix section “Proposed Floor Plans” on page 45.

Working Plane

The calculation of SDA is carried out on a hypothetical working plane which lies 850 mm from the finished floor level in residential units and 700 mm in academic and office spaces.

In the BR 209 study the working plane is offset 300 mm from the room boundaries. Under the I.S. EN 17037 criteria the working plane is offset 500 mm from the room boundaries. The working plane has a grid density of c. 300 mm.

Material Palette

Following consultation with the design team, material values used for SDA calculations are as per the table below:

Table No. 2.5.1 - Material Palette for SDA Calculations					
Object	Material	Reflectance	Object	Material	Reflectance
					Transmittance
Exterior walls	Standard Brick	0.3	Interior Walls	Pastel paint	0.7
	Light Brick	0.4	Interior Ceiling	White paint	0.8
	Dark Brick	0.15	Interior Floor	Light timber	0.4
	Render	0.6	Miscellaneous	Miscellaneous	0.5
	Concrete	0.4	Glass	Glass transmittance value	0.68
Ground cover	Paving	0.4		Maintenance factor	0.91
	Tarmac	0.2		Glass adjusted for maintenance	0.62
	Grass	0.2		Frosted glass	0.5

Project Assessment

The results for the study on SDA can be found in the appendix results section C.2 on page 58.

Analysis of the results can be found in section 3.2.1 on page 19.

The results of the supplementary SDA study under the I.S. EN 17037 criterion can be found in section D.0 on page 95.

2.5.2 Sunlight Exposure in Proposed Habitable Rooms (SE)

Since the publication of the 3rd edition of the BRE Guidelines (BR 209 - 2022), Sunlight Exposure (SE) is the recommended metric for assessing sunlight access within a proposed development. Sunlight Exposure replaces APSH/WPSH in this regard, which was the recommended metric under the 2nd edition of the BRE Guidelines (BR 209 - 2011).

Sunlight exposure (SE) is a measure of sunlight that a given window may expect to receive on a given date between the 1st of February and the 21st of March. Section 3.1.10 of the BRE guidelines suggests that March 21st (equinox) is used as the assessment date.

In the presence of trees, SE results have been generated, both with deciduous trees as opaque objects and without the inclusion of deciduous trees, in accordance with section G3 of the BRE Guidelines. Evergreen trees have been included as opaque objects, where applicable, in both states.

The level of sunlight exposure is categorised as follows:

- 1.5 Hours - Minimum • 3 Hours - Medium • 4 Hours - High

The recommendation for dwellings is that at least one habitable room, preferably a main living room, should receive at least the minimum criterion. Should no room within a given unit meet the recommended minimum level of sunlight exposure, it will be stated as non-compliant.

Sunlight exposure is carried out on habitable rooms within a proposed development. The assessment point for windows is 1.2m above the finished floor level, or 0.3m above the sill level (whichever is higher). If a room has multiple windows, the amount of sunlight received by each can be added together provided they occur at different times and sunlight hours are not double counted.

The criterion applies to rooms of all orientations, although if a room faces significantly north of due east or west it is unlikely to be met. As such, it is not always possible to achieve full compliance, especially in developments that contain single aspect units.

The sunlight exposure assessment focuses on habitable residential rooms. Unless sunlight access is deemed important for the functionality of a non-residential room in a proposed development, it will not be included in the study, which remains limited to residential rooms. For example, in the childcare facility located on the ground floor of Block A, while assessing SDA values is relevant for overall daylight quality, direct sunlight is less important for classroom activities. Therefore, while these rooms are compliant, they have not been included in the final study or calculated compliance rates.

Project Assessment

The results for the study on sunlight exposure can be found in the appendix results section C.3 on page 76, with analysis of the results in section 3.2.2 on page 21.

2.5.3 Sun On Ground in Proposed Outdoor Amenity Areas (SOG)

Section 3.3.17 of the BRE Guidelines recommends that for a garden or amenity area to appear adequately sunlit throughout the year, at least half of it should receive at least two hours of sunlight on March 21st.

March 21st, also known as the spring equinox, is chosen as the assessment date as daytime and night-time are of approximately equal duration on this date.

The analytical model for SOG assessment in proposed amenity areas includes evergreen trees, where applicable, as per section G4.1 of the BRE Guidelines. Typically deciduous trees will not be included unless there is a particularly dense belt.

A quantitative SOG assessment may be carried out on the areas as indicated by the project architect. Shadow studies and false colour plans can allow for a qualitative assessment for all other areas.

The portion of each assessed space capable of receiving 2 hours of direct sunlight on March 21st should be calculated individually. These areas can be combined to give the development average where appropriate.

Project Assessment

The levels of sunlighting to proposed amenity areas, as indicated by the architect, have been assessed. However, it should be noted that the numbering of these spaces in the Daylight and Sunlight Assessment Report has been assigned by 3DDB specifically for the purposes of this report. If other consultants are referencing these spaces in their own reports, it is unlikely they will be numbered the same.

The results for the study on sun on ground in the proposed outdoor amenity areas (including a visual representation in the form of 2-hour false colour plans) can be found in the appendix results section C.4 on page 93, with analysis of the results in section 3.2.3 on page 22.

2.5.4 No Sky Line in Proposed Habitable Rooms (NSL)

The no sky line divides the areas of the working plane which can receive direct skylight, from those which cannot. It indicates the distribution of direct daylight within a room.

Section D3 of the BRE Guidelines recommends the No Sky Line study as an appropriate metric for an impact assessment to daylight, but only where room layouts are known.

“The calculation can only be carried out where room layouts are known. Using estimated room layouts is likely to give inaccurate results and is not recommended.”

All advice regarding NSL in the BRE Guidelines (section 2.2) is in relation to impact assessments. NSL is not mentioned in the BRE section regarding daylight in new developments. Nevertheless, an NSL assessment was carried out on the proposed development as a supplementary study as it is requested in the DCC Development Plan 2022-2028 (Section 5.1, Appendix 16). Although the proposed development is not under Dublin City Council's jurisdiction, the NSL study has been included to provide consistency across 3DDB daylight and sunlight assessments.

As the BRE Guidelines does not give advice on target NSL values for proposed rooms, no compliance rate has been stated. However a no sky line of 80% could be considered an appropriate figure given that section 2.2.10 of the BRE Guidelines state that supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line.

The results of the supplementary NSL study can be found in section D.2 on page 111.

3.0 Analysis of Results

3.1 Analysis of Impact Assessment Results

3.1.1 Effect on Vertical Sky Component (VSC)

The effect on VSC has been assessed for 5 no. windows/rooms within the identified property (Phase 1, Unit 37).

Using the rationale explained in section E.2 on page 128, the effect on the VSC of these windows/rooms is considered 'negligible'. The windows/rooms assessed can be seen in Figure 3.1 below.

This indicates that all of the assessed windows, falling under the criteria for assessment explained in Section 2.1 pPage 8, would not experience any adverse levels of effect. Additionally, all other neighbouring windows facing the proposed development, though not directly assessed, are situated at greater distances and can be reasonably expected to remain unaffected.

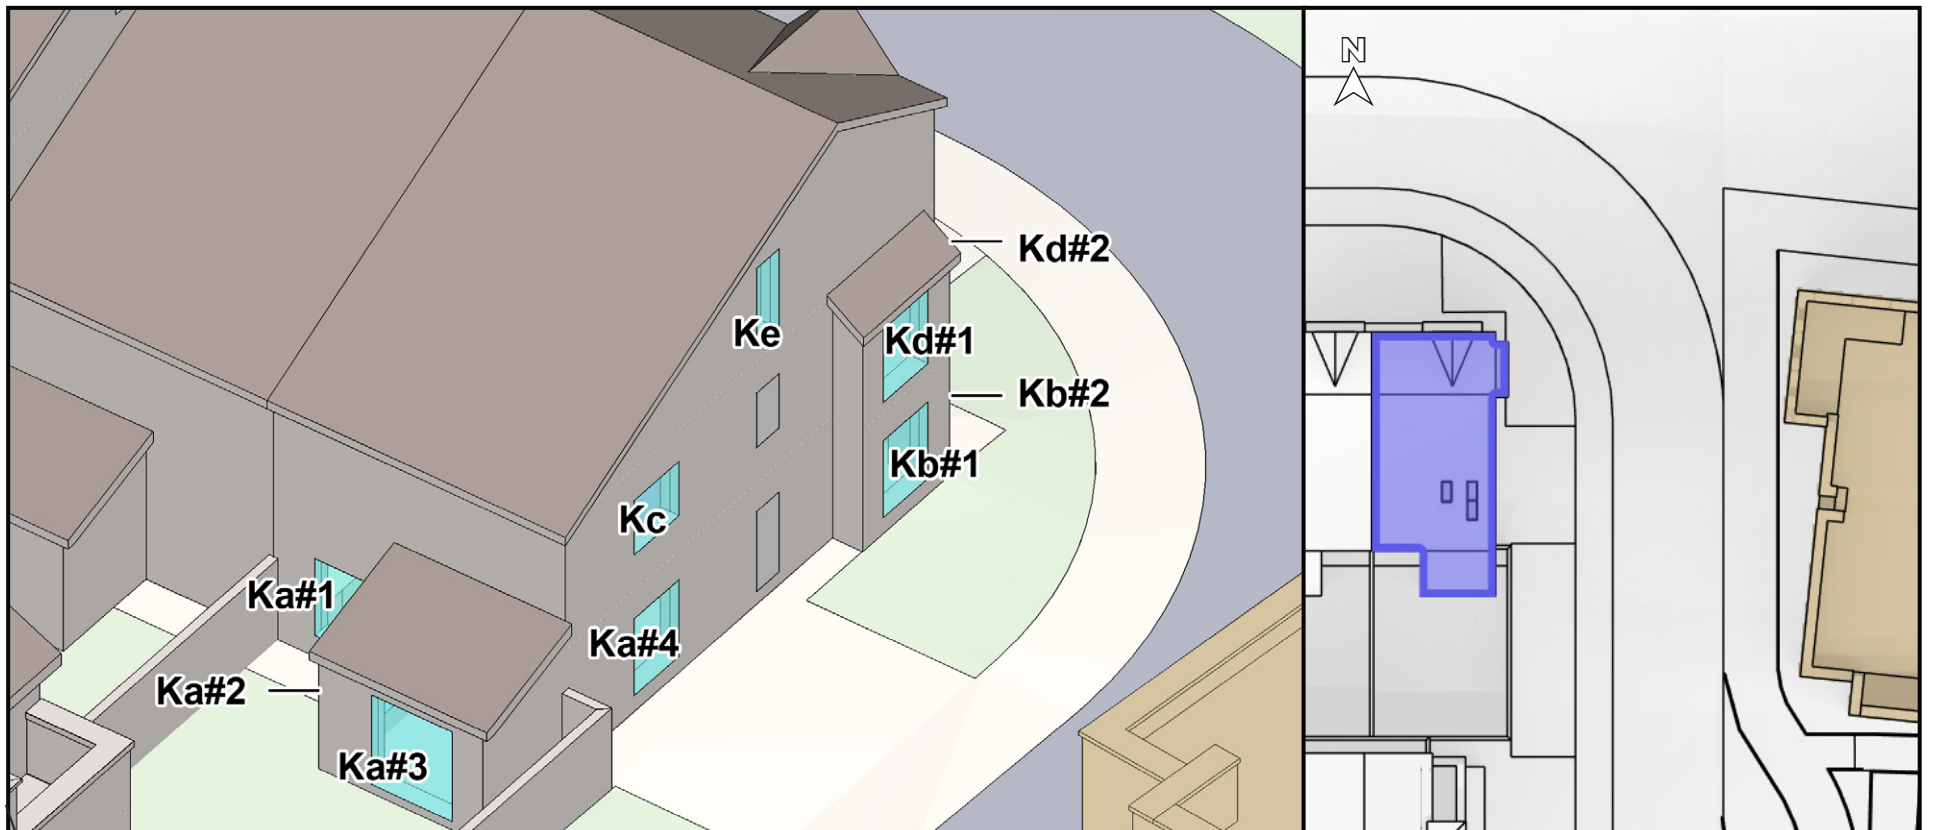


Figure 3.1: Highlighted areas indicate the position of assessed windows (L), Aerial view of assessed location (R)

This favourable outcome is primarily attributed to the modest height of the proposed development and its strategic setback from adjacent properties.

The results of the study on VSC can be found in section A.1 on page 26.

3.1.2 Effect on Annual/Winter Probable Sunlight Hours (APSH/WPSH)

The effect on APSH/WPSH has been assessed for 1 no. room of the surrounding existing property Phase 1 unit 37. Only windows that have an orientation within 90 degrees of due south have been included in this assessment, namely Ka# windows, in Figure 3.1 above.

This assessed room showed a 'negligible' impact for APSH and likewise for WPSH, thereby meeting the criteria set out in Section 3.2 of the BRE Guidelines for APSH and WPSH.

In the opinion of 3DDB, these results are favourable, as this room demonstrated 'negligible' effects in both annual and winter assessments. This indicates that the proposed development would have no adverse effect on overall sunlight availability.

The results of the study on APSH/WPSH can be found in Section A.2 on page 28.

3.1.3 Effect on Sun On Ground in Existing Outdoor Areas

This study has assessed the effect the proposed development would have on the level of sunlight on March 21st in the rear gardens and amenity outdoor areas of the neighbouring properties: Phase 1 unit 37 back garden, Ardrath View outdoor space and 76A Crodaun Forest Park back garden.

In total 3 no. spaces have been assessed. Using the rationale explained in section E.2 on page 128, the effect on the SOG would be considered 'negligible' for all these spaces.

100% of these outdoor spaces have met the criteria for effect on sunlighting as set out in the BRE Guidelines as set out in section 3.3 of the BRE Guidelines.

The Sun on Ground study confirms that neighbouring gardens and outdoor amenity areas will retain adequate levels of sunlight, with no notable impact on their usability. These positive results are largely due to the proposed development's generous setback from neighbouring properties, modest building heights, and well-considered site layout. The results of the Sun On Ground study (SOG) on the neighbouring gardens can be found in section A.4 on page 33.

A visual representation of these readings can be seen in the 2 hour false colour plans in section A.4 and in the hourly shadow diagrams for March 21st in section B.1 on page 36.

3.2 Analysis of Scheme Performance Results

3.2.1 Spatial Daylight Autonomy (SDA)

This study has assessed the Spatial Daylight Autonomy (SDA) received in all habitable rooms within the apartment blocks and duplex units across the proposed development both with and without trees. This has ensured that a clear understanding has been obtained regarding the daylight performance of these unit types.

Under the criteria as set out in the BR 209 considering trees, the SDA value in 443 no. habitable rooms meets or exceeds the appropriate target values. This gives a circa compliance rate of 94%. It is worth noting that most of the remaining rooms fall just below the threshold.

In Blocks A and B, the majority of underperforming rooms are located on the ground floor with SDA values under the recommended 50% compliance threshold but exceeding 40%. The non-compliant LKDs of units BB-40 (48% without trees and 46% with trees) and BB-41 (47% without trees and 45% with trees), for example, are single-aspect deep rooms, predominantly north-facing, and positioned beneath projecting balconies, factors which naturally limit direct daylight access. On the subsequent upper floors, however, these same room types achieve compliance. This highlights how marginal the underperformance is.



Figure 3.2: Block B Ground Floor Plan, underperforming rooms (L), Block B, First Floor, same room types, compliant (R)

It is a similar situation with non-compliant rooms in the duplex units, where rooms falling slightly below the target values are primarily ground-floor bedrooms whose layouts are constrained by the staircase volume (see Figure 3.3 on the left). A few additional underperforming spaces are attributed to factors such as north-facing, single-aspect rooms and geometric limitations of L-shaped blocks (see Figure 3.3 on the right).

Overall, it is the opinion of 3DDB that, for a scheme of this size and density, the findings of the SDA assessment represent a very favourable level of compliance, reflecting the low-rise surrounding context and a well-considered site layout with adequate separation distances between buildings.

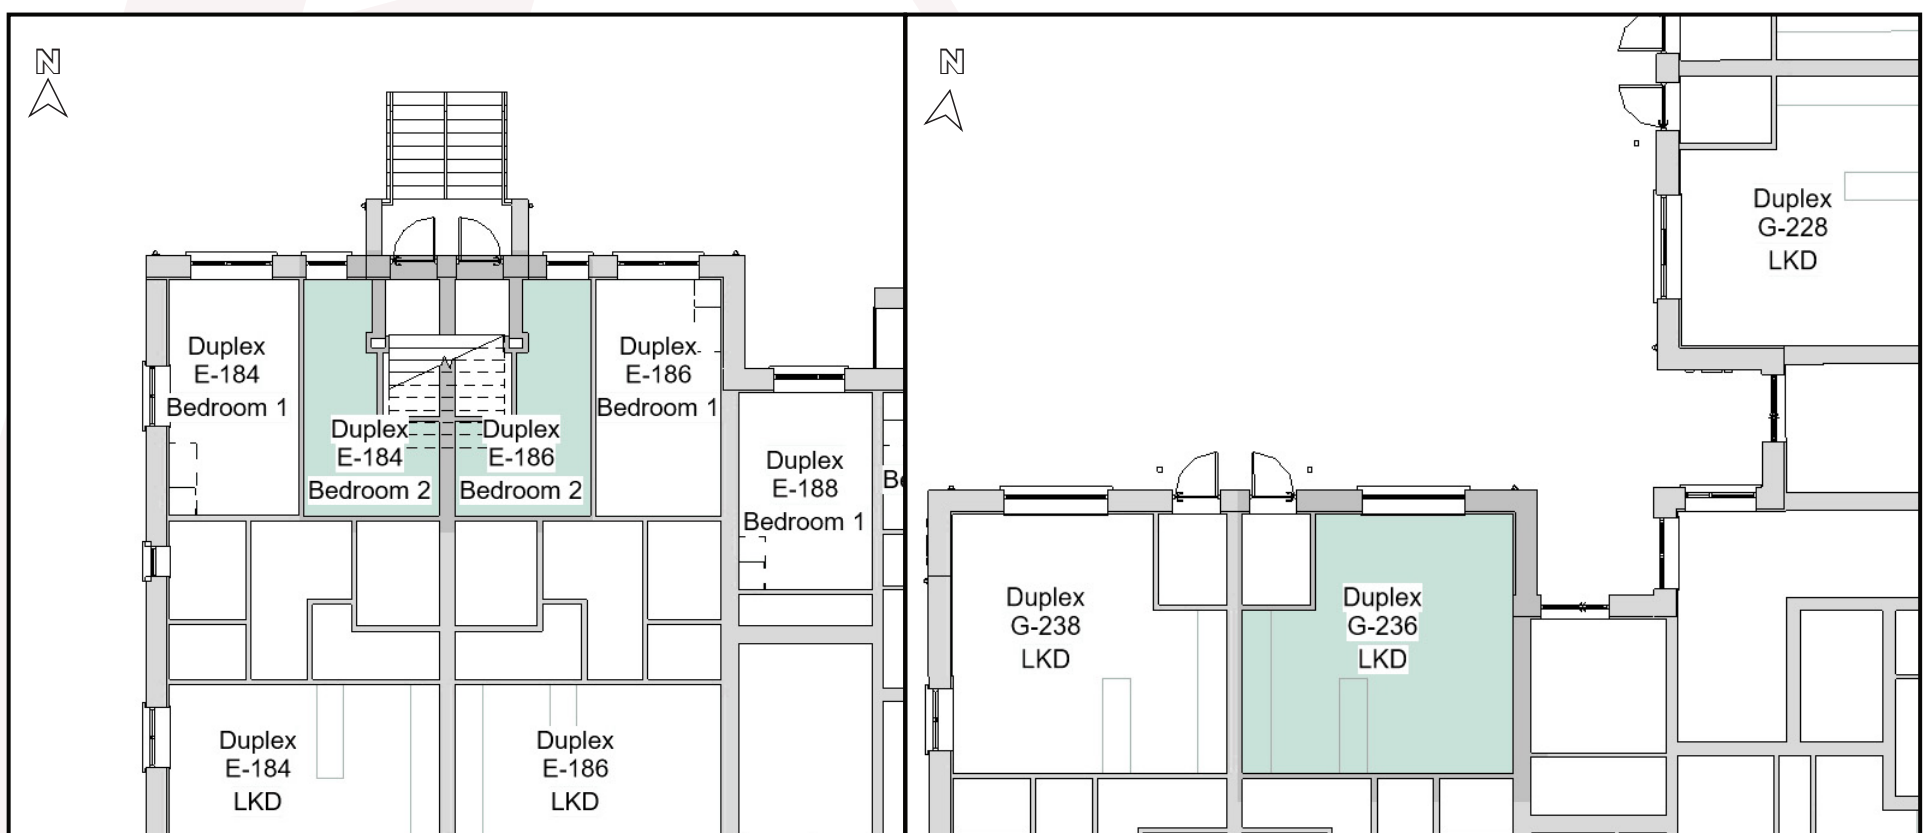


Figure 3.3: Duplex Block E Ground Floor Plan (L), Duplex Block G, Ground Floor Plan (R)

The additional SDA assessment that does not include trees has shown a slightly increased compliance rate of c.97%. This indicates that trees have some level of impact on the compliance of daylight within the scheme. However, trees are an integral part of any scheme with regard to environmental and planning grounds along with biodiversity, whilst trees can contribute towards a reduction of daylight in these few units, they also reduce the risk of potential heat gain and can be considered to provide a favourable outlook for occupants.

Additionally, the childcare facility on the ground floor of Block A was assessed. Although it was not included in the published compliance rate, the 4 no. classrooms meet the assigned target value of 200 lux, whether trees are included or not.

I.S. EN 17037 sets out more onerous recommendations for SDA. As such, the number of habitable rooms achieving compliance under this standard is 282 in the assessment that includes trees. This gives a reduced circa compliance rate of c. 60%. The additional SDA assessment, under this standard, that does not include trees has shown a compliance rate of c. 63%.

In cases where rooms comply with the criteria of BR 209 but do not meet the criteria of I.S. EN 17037, it is the recommendation of 3D Design Bureau that these rooms will be adequately daylight. This recommendation is based on the fact that BR 209 provides room-specific criteria, unlike I.S. EN 17037. BR 209 considers the varying daylight requirements for different room types, which I.S. EN 17037 does not account for.

This report identifies where assessed rooms do not meet the daylight targets set in section 2.1 of the BRE Guidelines. It is intended to inform the planning authority's discretionary review, which is based on an assessment of the project's specific circumstances.

The following list details each unit and room that does not achieve the recommended daylight levels in BR 209. The project architect has provided a rationale and/or a compensatory design solution for each instance in the section below.

Table No. 3.2.3 - CDSs				
Unit Ref	Size Above Minimum	Orientation	Aspect	Adjoining Amenity Space
BA.04	+10%	North	Single	Public Park (North)
BA.05	+10%	North	Single	Public Park (North)
BA.10	+10%	North	Single	Public Park (North)
BB.40	+10%	North-East	Single	-
BB.41	+10%	North-East	Single	-
BB.43	+6%	East	Single	-
BB.44	+10%	East	Single	-
BB.47	+10%	West	Single	Communal O/S (West)
BB.54	+6%	East	Single	-
Duplex C.104	+10%	East / West	Dual Aspect	-
Duplex C.106	+10%	East / West	Dual Aspect	-
Duplex C.108	+10%	East / West	Dual Aspect	-
Duplex D.112	+10%	East / West	Dual Aspect	Communal O/S (West)
Duplex D.116	+10%	East / West	Dual Aspect	Communal O/S (West)
Duplex D.118	+10%	East / West	Dual Aspect	Communal O/S (West)
Duplex D.126	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex D.127	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex D.128	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex D.129	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex E.184	+10%	North / South	Dual Aspect	Communal O/S (South)
Duplex E.186	+10%	North / South	Dual Aspect	Communal O/S (South)
Duplex E.194	+10%	East / West	Dual Aspect	Communal O/S (West)
Duplex F.208	+10%	East / West	Dual Aspect	-
Duplex F.212	+10%	East / West	Dual Aspect	-
Duplex G.228	+10%	East / West	Dual Aspect	Communal O/S (West)
Duplex G.236	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex G.237	+10%	North / South	Dual Aspect	Communal O/S (North)
Duplex G.239	+10%	North / South	Dual Aspect	Communal O/S (North)

“Unit Size

Units containing rooms that fall below the BRE target values exceed the minimum floor area requirements outlined in the Apartment Guidelines (July 2023) by at least 6%.

Larger apartments provide enhanced internal residential amenity, improving furniture layout flexibility, circulation space, and storage capacity. The additional internal space offsets any perceived shortfall in daylight penetration, ensuring a high-quality living environment.

Justification: The provision of larger units offers a compensatory advantage, enhancing the usability and comfort of internal living areas beyond standard minimums.

Private Amenity Space

Every apartment benefits from direct access to a private balcony or terrace, ensuring residents have an easily accessible daylight outdoor space. Private balconies meet or exceed the minimum depth and area requirements, providing functional outdoor living space. While balconies slightly reduce daylight levels for lower-level units, their benefits as private outdoor retreats outweigh any minor daylight reduction.

Aspect and Orientation

A small number of units within the scheme are single-aspect north-facing, however those few look directly onto the Public Park at the north end of this scheme.

A significant portion of ground-floor units have direct frontage onto landscaped communal or public open spaces, enhancing visual connections with the external environment.

Ground-floor units enjoy direct access to these green areas, providing an immediate connection to nature and additional daylight reflection opportunities.

The compensatory measures outlined above effectively mitigate any minor shortfalls in SDA performance, ensuring that the overall residential quality remains exceptionally high. By integrating enhanced unit sizes, private and communal outdoor spaces, dual-aspect designs, increased ceiling heights for ground floor units, and strategic planted buffer zones, the development prioritises daylight access while balancing urban planning and sustainability objectives.”

The results for the study on SDA can be seen in section C.2 on page 58.

3.2.2 Sunlight Exposure (SE)

A sunlight exposure assessment has been carried out on all habitable rooms within the residential portion of the proposed development. For these assessments, trees have been included in the analytical model as opaque objects. The assessments have been carried out in two states:

- All trees (evergreen and deciduous) included in assessment model.
- Only evergreen trees included in the assessment model.

This approach is in accordance with section 3.1 of the BRE Guidelines.

In total, 163 no. units have been assessed. Using the rationale explained in section E.3 on page 129, the level of sunlight exposure for the assessed units is as follows:

In the assessment carried out with all trees considered as opaque objects:

- high: 105 no. (at least 4 hours)
- medium: 24 no. (at least 3 hours)
- minimum: 15 no. (at least 1.5 hours)
- below minimum recommendation: 19 no. (less than 1.5 hours)

When only evergreen trees included in the assessment model:

- high: 110 no. (at least 4 hours)
- medium: 20 no. (at least 3 hours)
- minimum: 14 no. (at least 1.5 hours)
- below minimum recommendation: 19 no. (less than 1.5 hours)

The SE assessment has shown that, regardless of the effect of trees, the circa compliance rate for the assessed units, in accordance with section G3.4 of the BRE Guidelines, is around 88%.

Note: For a unit to be compliant under BR 209, only one habitable room within the unit needs to meet the guideline values.

Whilst the criterion applies to rooms of all orientations, it should be noted that if a room faces significantly north of due east or west it is unlikely to be met. As such, it is not always possible to achieve full compliance, especially in developments that contain single aspect units.

No recommendation is made regarding the performance of a development as a whole for SE performance within the BRE Guidelines. However, it is the opinion of 3DDB that the proposed development performs favourably in this regard. A compliance rate of 80% or higher is deemed as a good outcome in this type of assessment.

The results for the study on SE in the habitable rooms of the proposed units can be seen in section C.3 on page 76.

3.2.3 Sun On Ground in Proposed Outdoor Amenity Areas

This study has assessed the level of sunlight on March 21st within the proposed amenity areas.

In total 12 no. spaces have been assessed, the creche outdoor play area, 7 no. communal areas (one for each block) and 4 no. public open spaces.

All these areas would meet the criteria as set out in section 3.3 of the BRE Guidelines.

The proposed development has been designed to optimise sunlight exposure across key areas, as highlighted in Figure 3.4. Its strategic layout, featuring generous spacing between buildings and thoughtfully planned massing, ensures that sunlight reaches all amenity areas effectively.

Notably, the modest building heights, combined with intentional setbacks from adjacent structures, reduce overshadowing and allow low-angle sunlight to penetrate deep into the site ensuring at least 2h of sunlight (the BRE recommendation) to these amenity outdoor areas.

In addition, the orientation of buildings plays a vital role; with blocks aligned along east-west and north-south axes and taller buildings positioned at the northern edge, sunlight access to shared spaces is maximised.

This is evident in the False Colour Plan, where minimal shadowing is observed throughout the site. The development also includes a generous amount of open space, particularly in public areas, which remain largely unobstructed, resulting in well-lit, functional outdoor environments throughout the day.

The results for the study on sunlighting in the proposed outdoor amenity spaces can be found in section C.4 on page 93.

A visual representation of these readings can be seen in the false colour plan on section C.4 on page 93 and in the hourly shadow diagrams for March 21st in section B.1 on page 36 of the appendix section of this report.

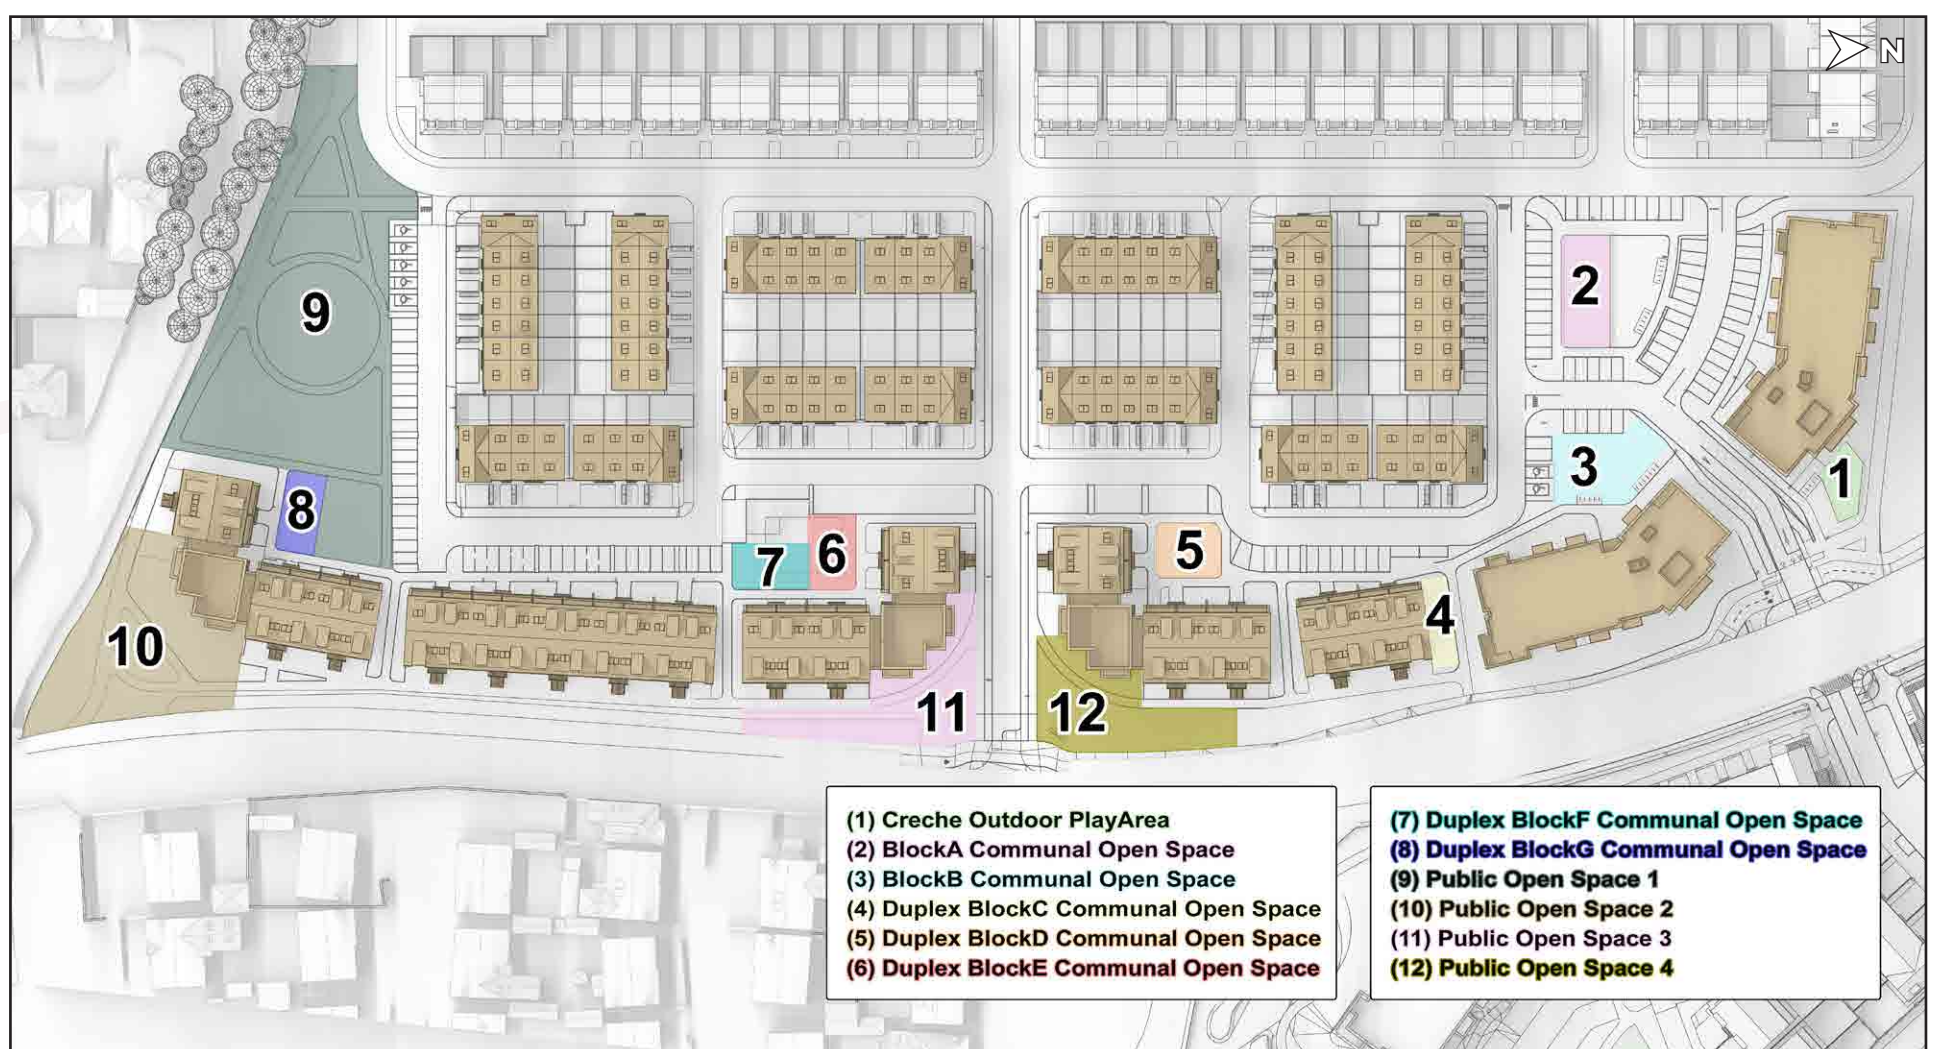


Figure 3.4: Public and Communal Amenity Areas assessed, including the Creche Play Area

4.0 Conclusion

3D Design Bureau (3DDB) were commissioned to carry out a daylight assessment, sunlight assessment and shadow study for the proposed apartment development at Kilwoghan Woods, Celbridge - Phase2.

The impact assessment for this report has quantified the effect the proposed development would have on the level of daylight and sunlight received by neighbouring properties/environment that fall under the criteria outlined in section “2.1 Impact Assessment, Window Selection Criteria” on page 8. One neighbouring property: “Phase 1, Unit 37”, was identified as requiring analysis under this criterion. Figure 4.1 below.



Figure 4.1: Scope of surrounding properties and environment assessed.

This property was assessed against multiple metrics: VSC, APSH, WPSH and NSL. The results show that all relevant windows and rooms remain within BRE 209 target values, with the impact classified as ‘negligible’ across all metrics.

No other neighbouring properties met the geometric trigger for assessment due to either their distance, orientation, or position relative to the proposed scheme.

The scheme performance assessment for this report has quantified the level of daylight and sunlight within the proposed development, demonstrating very favourable results across all the studies carried out.

For the SDA assessment 29 no. rooms fall below the recommended minimum with trees factored in. Compensatory design solutions have been provided for these rooms and are outlined on Page 20. Given the size of the scheme and the circa 94% compliance rate achieved, 3DDB is of the opinion that the scheme is performing favourably in terms of daylight performance.

The sunlight exposure (SE) analysis indicates an 88% compliance rate, which is considered a positive outcome, particularly given the range of unit types and layouts.

Additionally, communal and public amenity spaces within the development receive good levels of sunlight due to the scheme’s modest height, appropriate massing, and thoughtful orientation of blocks.

Overall, the proposed development performs strongly in both impact and internal daylight and sunlight performance. None of the neighbouring properties and associated gardens would be adversely affected by the proposed development, and a high number of the proposed units included in the assessments, would meet the required levels of daylight and sunlight.

Appendix - Results



☎ +353 (0) 1 288 0186

✉ info@3ddesignbureau.com

🌐 www.3ddesignbureau.com



**3D DESIGN
BUREAU**

Creative & Technical 3D Solutions in
Design, Planning & Marketing.

Appendix Contents

A.0	Impact Assessment Results	26
A.1	Effect on Vertical Sky Component (VSC).....	26
A.2	Effect on Annual/Winter Probable Sunlight Hours (APSH/WPSH)	28
A.3	Effect on No Sky Line (NSL).....	31
A.4	Effect on Sun On Ground (SOG) in Existing Outdoor Areas.....	33
B.0	Shadow Studies	36
B.1	Shadow Study 21 March.....	36
B.2	Shadow Study 21 June.....	39
B.3	Shadow Study 21 December.....	43
C.0	Scheme Performance	45
C.1	Proposed Floor Plans.....	45
C.2	Spatial Daylight Autonomy (SDA) in Proposed Units	58
C.3	Sunlight Exposure (SE) in Proposed Units	76
C.4	Sun On Ground (SOG) in Proposed Outdoor Amenity Areas	93
D.0	Supplementary Study Results.....	95
D.1	SDA study, under the I.S. EN 17037 criteria	95
D.2	Supplementary No Sky Line (NSL) assessment in proposed units.....	111
E.0	Glossary	127
F.0	Guidelines / Standards	130

Assessment criteria and detailed analysis of results can be found in the accompanying report.

A.0 Impact Assessment Results

A.1 Effect on Vertical Sky Component (VSC)

Below is an example of the table used to describe the effect on VSC.

Table Example. A.1 - VSC Impact Assessment						
Window Number	Baseline VSC Value	Proposed VSC Value	Ratio of Proposed VSC to Baseline VSC	Recommended Minimum VSC	Level of Compliance with BRE Guidelines	Effect of Proposed Development
A	B	C	D	E	F	G

A: Window Number

The number in this column will identify the assessed window. All windows are represented visually in the corresponding figure.

B: Baseline VSC Value

The *Baseline VSC Value* represents the VSC value of the assessed window which is calculated in the existing baseline model state (as explained in the “Building the Model States” on page 10).

C: Proposed VSC Value

The *Proposed VSC Value* represents the VSC value of the assessed window which is calculated in the proposed model state (as explained in the “Building the Model States” on page 10).

D: Ratio of Proposed VSC to Baseline VSC

This column expresses the ratio of change between the baseline VSC value and the proposed VSC value. Section 2.2.23 of the BRE Guidelines recommend that if the proposed value is less than 0.8 times the baseline value, then the reduction in daylight is more likely to be perceptible.

E: Recommended minimum VSC

The *BRE Target Value* for each window has been set according to section 2.2.23 of the BRE Guidelines. The Guidelines state that a proposed development could possibly have a noticeable effect on the daylight received by an existing window, if the VSC value **both** drops below the guideline value of 27% **and** the VSC value is less than 0.8 times the baseline value.

Therefore, to determine the *recommended minimum Value*, 80% of the *Baseline VSC value* has been calculated. If this value is above the 27% threshold, a target value of 27% will be applied. If 80% of the baseline value is below 27%, then 80% of the baseline value is the appropriate target value.

F: Level of Compliance with the BRE Guidelines

This column states the compliance of the *Proposed VSC Value* with the *recommended minimum VSC* as per the BRE Guidelines. In essence, it shows whether or not the assessed window would experience a perceptible level of impact. If the window complies with the BRE Guidelines this cell will state “*BRE Compliant*”. If the window does not meet the criteria as set out in the BRE Guidelines, a percentage of compliance with the *recommended minimum* will be stated.

G: Effect of Proposed Development

The levels of effect in this column describe the effect an assessed window will experience, based on its compliance with the *BRE Target Value*. A full list of definitions and a numerical rationale for each can be found in the section “*Definition of Effects*” on page 128.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

A.1.1 Phase 1 unit 37

Table No. A.1.1 - VSC Results:						
Window Number	Baseline VSC Value	Proposed VSC Value	Ratio of Proposed VSC to Baseline VSC	Recommended minimum VSC*	Level of Compliance with BRE Guidelines	Effect of Proposed Development**
Ka#1	19.75%	19.69%	1.00	15.80%	BRE Compliant	-
Ka#2	18.02%	18.02%	1.00	14.42%	BRE Compliant	-
Ka#3	29.56%	28.47%	0.96	23.65%	BRE Compliant	-
Ka#4	38.19%	26.32%	0.69	27.00%	97%	-
Ka#	26.75%	23.75%	0.89	21.40%	BRE Compliant	Negligible
Kb#1	38.51%	27.35%	0.71	27.00%	BRE Compliant	-
Kb#2	38.80%	38.72%	1.00	27.00%	BRE Compliant	-
Kb#	38.69%	34.43%	0.89	27.00%	BRE Compliant	Negligible
Kc	38.78%	29.41%	0.76	27.00%	BRE Compliant	Negligible
Kd#1	38.31%	29.16%	0.76	27.00%	BRE Compliant	-
Kd#2	39.06%	38.99%	1.00	27.00%	BRE Compliant	-
Kd#	38.71%	34.41%	0.89	27.00%	BRE Compliant	Negligible
Ke	38.95%	32.33%	0.83	27.00%	BRE Compliant	Negligible

* Section 2.2.23 of the BRE Guidelines states that in order for a proposed development to have a noticeable effect on the VSC of an existing window, the value needs to both drop below the stated target value of 27% **and** be less than 0.8 times the baseline value.

** For the interpretation of level of effects please refer to "E.2 Definition of Effects" on page 128.

If it can be determined or reasonably assumed that multiple windows serve the same room, each individual window is labelled with a hash-tag and a serial number (e.g. Xa#1, Xa#2). Each window is assessed, and a weighted average is calculated to determine the level of effect on the room. Rooms are identified with a hash-tag at the end (e.g. Xa#). In such cases, the 'effect of proposed development' column will display a dash (-) for the individual windows, with the overall level of effect indicated in the row corresponding to the room.

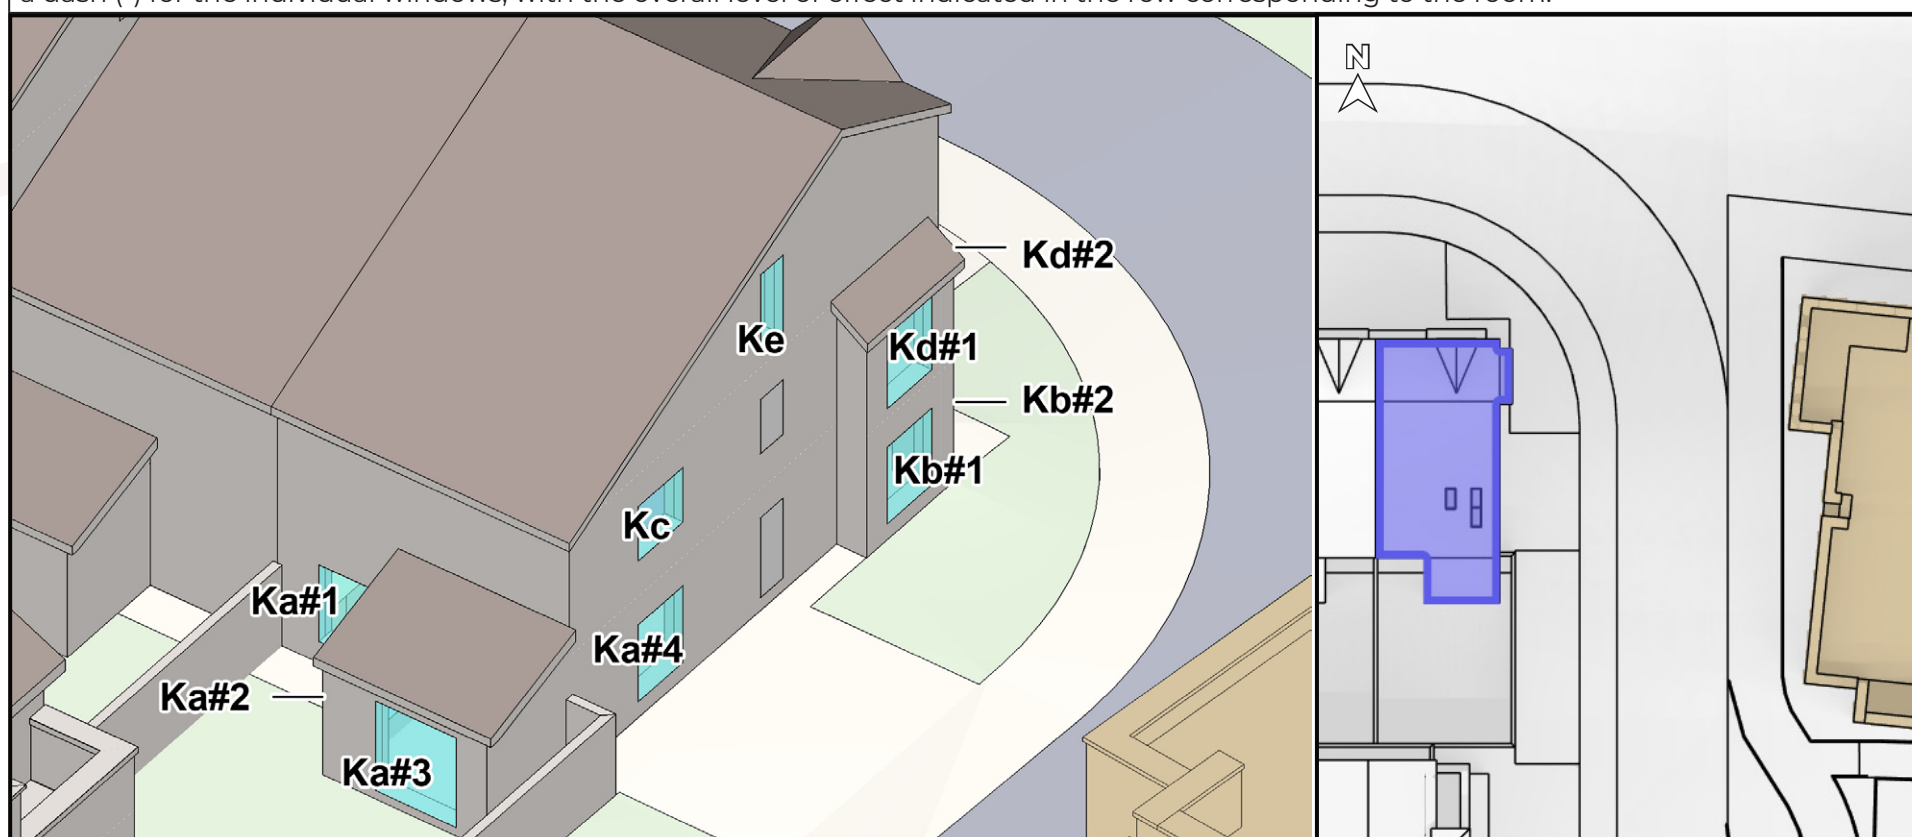


Figure A.1: Highlighted areas indicate the position of assessed windows (L), Aerial view of assessed location (R)

A.2 Effect on Annual/Winter Probable Sunlight Hours (APSH/WPSH)

Below is an example of the table used to describe the effect to the APSH/WPSH of existing windows / rooms.

Table Example. A.2 - APSH/WPSH Impact Assessment						
Window / Room Number	Baseline APSH/WPSH	Proposed APSH/WPSH	Ratio of Proposed to Baseline APSH/WPSH	Recommended Minimum APSH/WPSH	Level of Compliance with BRE Guidelines	Effect of Proposed Development
A	B	C	D	E	F	G

A: Window / Room Number

The number in this column will identify the assessed window / room. All windows / rooms are represented visually in the corresponding figure.

B: Baseline APSH/WPSH

The *Baseline APSH/WPSH Value* represents the percentage of the probable sunlight hours that the assessed window / room can receive, calculated in the existing baseline model state (as explained in the “Building the Model States” on page 10). The annual and winter assessments will be represented in separate tables.

C: Proposed APSH/WPSH

The *Proposed APSH/WPSH Value* represents the percentage of probable sunlight hours that the assessed window / room can receive, calculated in the proposed model state (as explained in the “Building the Model States” on page 10).

D: Ratio of Proposed to Baseline APSH/WPSH

This column expresses the ratio of change between the baseline APSH/WPSH value and the proposed APSH/WPSH value. Section 3.2.13 of the BRE Guidelines recommends that if the proposed value is less than 0.8 times the baseline value, then the reduction to sunlight is more likely to be perceptible.

E: Recommended Minimum APSH/WPSH

The *BRE Target Value* for each window / room has been set according to section 3.2.13 of the BRE Guidelines. The Guidelines state that a proposed development could possibly have a noticeable effect on the sunlight received by an existing window / room, if the APSH value drops below the annual (25%) or WPSH value below the winter (5%) guidelines; **and** the APSH/WPSH value is less than 0.8 times the baseline value; **and** there is a reduction of more than 4% to the APSH.

Therefore, to determine the *recommended minimum APSH Value* for the annual study, 80% of the *Baseline APSH value* has been calculated. If this value is above the 25% threshold, a target value of 25% will be applied. If 80% of the baseline value is below 25%, then 80% of the baseline value is the appropriate target value.

To determine the *recommended minimum WPSH Value* for the winter study, 80% of the *Baseline winter APSH value* has been calculated. If this value is above the 5% threshold, a target value of 5% will be applied. If 80% of the baseline value is below 5%, then 80% of the baseline value is the appropriate target value.

F: Level of Compliance with BRE Guidelines

This column states the compliance of the *Proposed APSH/WPSH Value* with the *recommended minimum APSH/WPSH* as per the BRE Guidelines. In essence, it shows whether or not the assessed window / room would experience a perceptible level of impact. If the window / room complies with the BRE Guidelines this cell will state “*BRE Compliant*”. If the window / room does not meet the criteria as set out in the BRE Guidelines, a percentage of compliance with the *recommended minimum* will be stated.

G: Effect of Proposed Development

The levels of effect in this column describe the effect an assessed window / room will experience, based on its compliance with the *BRE Target Value*. A full list of definitions and a numerical rationale for each can be found in the section “*Definition of Effects*” on page 128.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

A.2.1 Phase 1 unit 37 - Annual Probable Sunlight Hours

Table No. A.2.1 - APSH Results:						
Window / Room Number	Baseline APSH	Proposed APSH	Ratio of Proposed APSH to Baseline APSH	Recommended minimum APSH*	Level of Compliance with BRE Guidelines**	Effect of Proposed Development
Ka#	84.70%	70.24%	0.83	25.00%	BRE Compliant	Negligible

* Section 3.2 of the BRE Guidelines states that in order for a proposed development to have a noticeable effect on the APSH/WPSH of an existing window / room, the value needs to drop below the stated target value of 25% (annual) / 5% (winter) **and** be less than 0.8 times the baseline value **and** it has to have a reduction in sunlight received over the whole year greater than 4% of annual probable sunlight hours.

** For the interpretation of level of effects please refer to "E.2 Definition of Effects" on page 128.

If it can be determined or reasonably assumed that multiple windows are servicing the same room, APSH/WPSH has been calculated for the room rather than the individual windows.

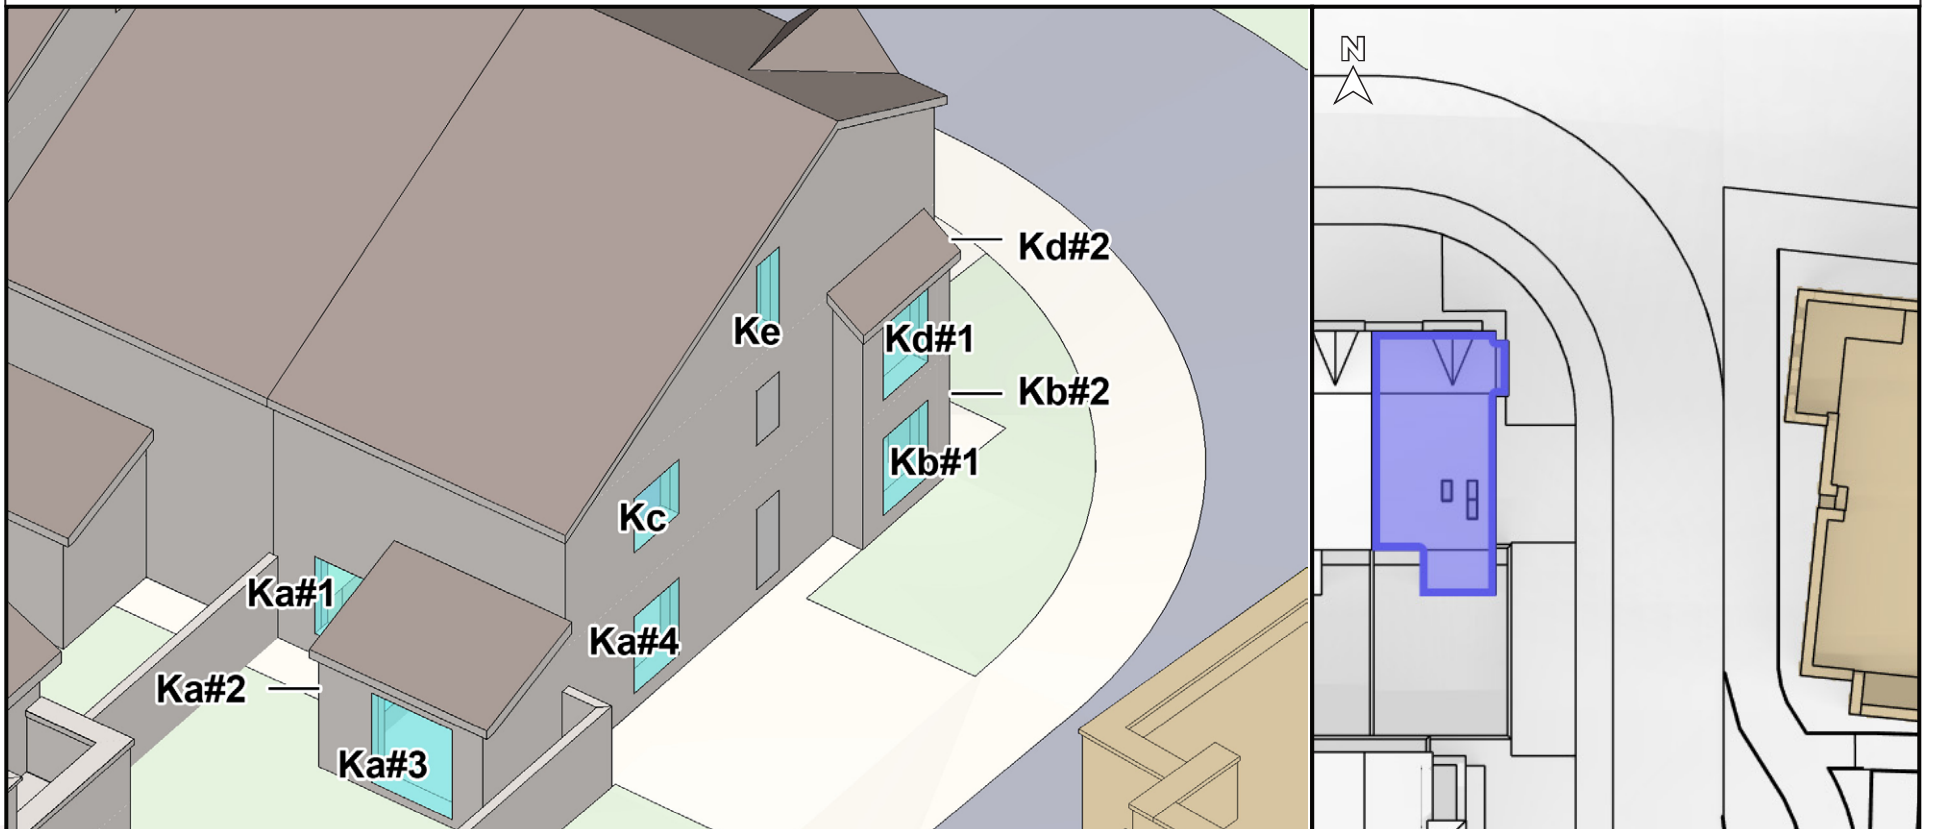


Figure A.2: Highlighted areas indicate the position of assessed windows (L), Aerial view of assessed location (R)

A.2.2 Phase 1 unit 37 - Winter Probable Sunlight Hours

Table No. A.2.2 - WPSH Results:						
Window / Room Number	Baseline WPSH	Proposed WPSH	Ratio of Proposed WPSH to Baseline WPSH	Recommended minimum WPSH*	Level of Compliance with BRE Guidelines**	Effect of Proposed Development
Ka#	23.60%	22.18%	0.94	5.00%	BRE Compliant	Negligible

* Section 3.2 of the BRE Guidelines states that in order for a proposed development to have a noticeable effect on the APSH/WPSH of an existing window / room, the value needs to drop below the stated target value of 25% (annual) / 5% (winter) **and** be less than 0.8 times the baseline value **and** it has to have a reduction in sunlight received over the whole year greater than 4% of annual probable sunlight hours.

** For the interpretation of level of effects please refer to "E.2 Definition of Effects" on page 128.

† Windows that have a reduction of less than 4% in the APSH assessment may be indicated as "n.a." in the WPSH assessment regardless of values.

If it can be determined or reasonably assumed that multiple windows are servicing the same room, APSH/WPSH has been calculated for the room rather than the individual windows.

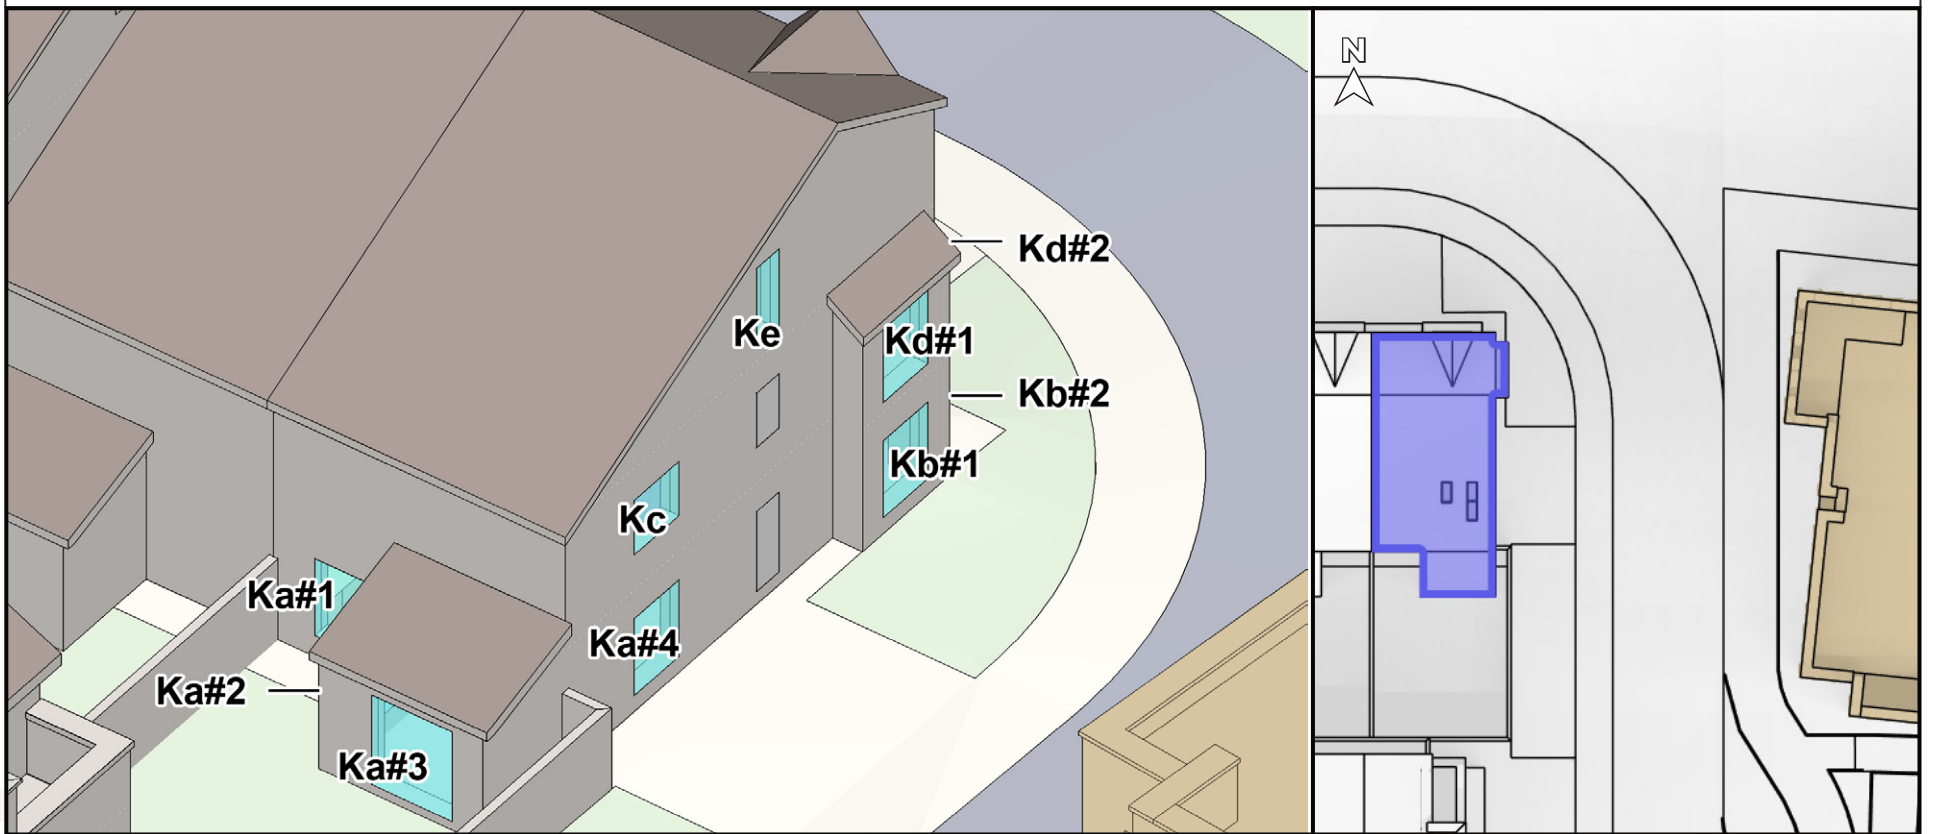


Figure A.3: Highlighted areas indicate the position of assessed windows (L), Aerial view of assessed location (R)

A.3 Effect on No Sky Line (NSL)

Below is an example of the table used to describe the effect on NSL.

Table Example. A.3 - NSL Impact Assessment						
Room Number	Baseline NSL Value	Proposed NSL Value	Ratio of Proposed NSL to Baseline NSL	Recommended minimum NSL	Level of Compliance with BRE Guidelines	Effect of Proposed Development
A	B	C	D	E	F	G

A: Room Number

The number in this column will identify the assessed room. The relevant façade of the assessed rooms are represented visually in the corresponding figure.

B: Baseline NSL Value

The *Baseline NSL Value* represents the NSL value of the assessed room which is calculated in the existing baseline model state (as explained in the “Building the Model States” on page 10).

C: Proposed NSL Value

The *Proposed NSL Value* represents the NSL value of the assessed room which is calculated in the proposed model state (as explained in the “Building the Model States” on page 10).

D: Ratio of Proposed NSL to Baseline NSL

This column expressed the ratio of change between the baseline NSL value and the proposed NSL value. The BRE Guidelines recommend that if the proposed value is less than 0.8 times the baseline value, then the reduction in daylight is more likely to be perceptible.

E: Recommended minimum NSL

The *BRE Target Value* for each room has been set according to the BRE Guidelines. The Guidelines state that a proposed development could possibly have a noticeable effect on the daylight received by an existing room, if the NSL value **both** drops below the guideline value of 80% **and** the NSL value is less than 0.8 times the baseline value.

Therefore, to determine the *recommended minimum Value*, 80% of the *Baseline NSL value* has been calculated. If this value is above the 80% threshold, then 80% of the baseline value is the appropriate target value.

F: Level of Compliance with the BRE Guidelines

This column states the compliance of the *Proposed NSL Value* with the *recommended minimum NSL* as per the BRE Guidelines. In essence, it shows whether or not the assessed room would experience a perceptible level of impact. If the room complies with the BRE Guidelines this cell will state “*BRE Compliant*”. If the room does not meet the criteria as set out in the BRE Guidelines, a percentage of compliance with the *recommended minimum* will be stated.

G: Effect of Proposed Development

The levels of effect in this column describe the effect an assessed room will experience, based on its compliance with the *BRE Target Value*. A full list of definitions and a numerical rationale for each can be found in the section “Definition of Effects” on page 128.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation on these figures may yield a negligible difference and should not be considered an error.

A.3.1 Phase 1 unit 37 - Effect on No Sky Line (NSL)

Room Number	Baseline NSL Value	Proposed NSL Value	Ratio of Proposed NSL to Baseline NSL	Recommended minimum NSL	Level of Compliance with BRE Guidelines	Effect of Proposed Development
Ka#	100.00%	99.78%	1.00	80.00%	BRE Compliant	Negligible
Kb#	99.67%	98.60%	0.99	79.73%	BRE Compliant	Negligible
Kc#	93.66%	82.47%	0.88	74.92%	BRE Compliant	Negligible
Kd#	99.44%	97.86%	0.98	79.55%	BRE Compliant	Negligible
Ke#	99.80%	99.80%	1.00	79.84%	BRE Compliant	Negligible

* The BRE Guidelines state that in order for a proposed development to have a noticeable effect on the daylight received by an existing room, the value needs to both drop below the guideline value of 80% **and** be less than 0.8 times the baseline value.

** For the interpretation of level of effects please refer to "E.2 Definition of Effects" on page 128.

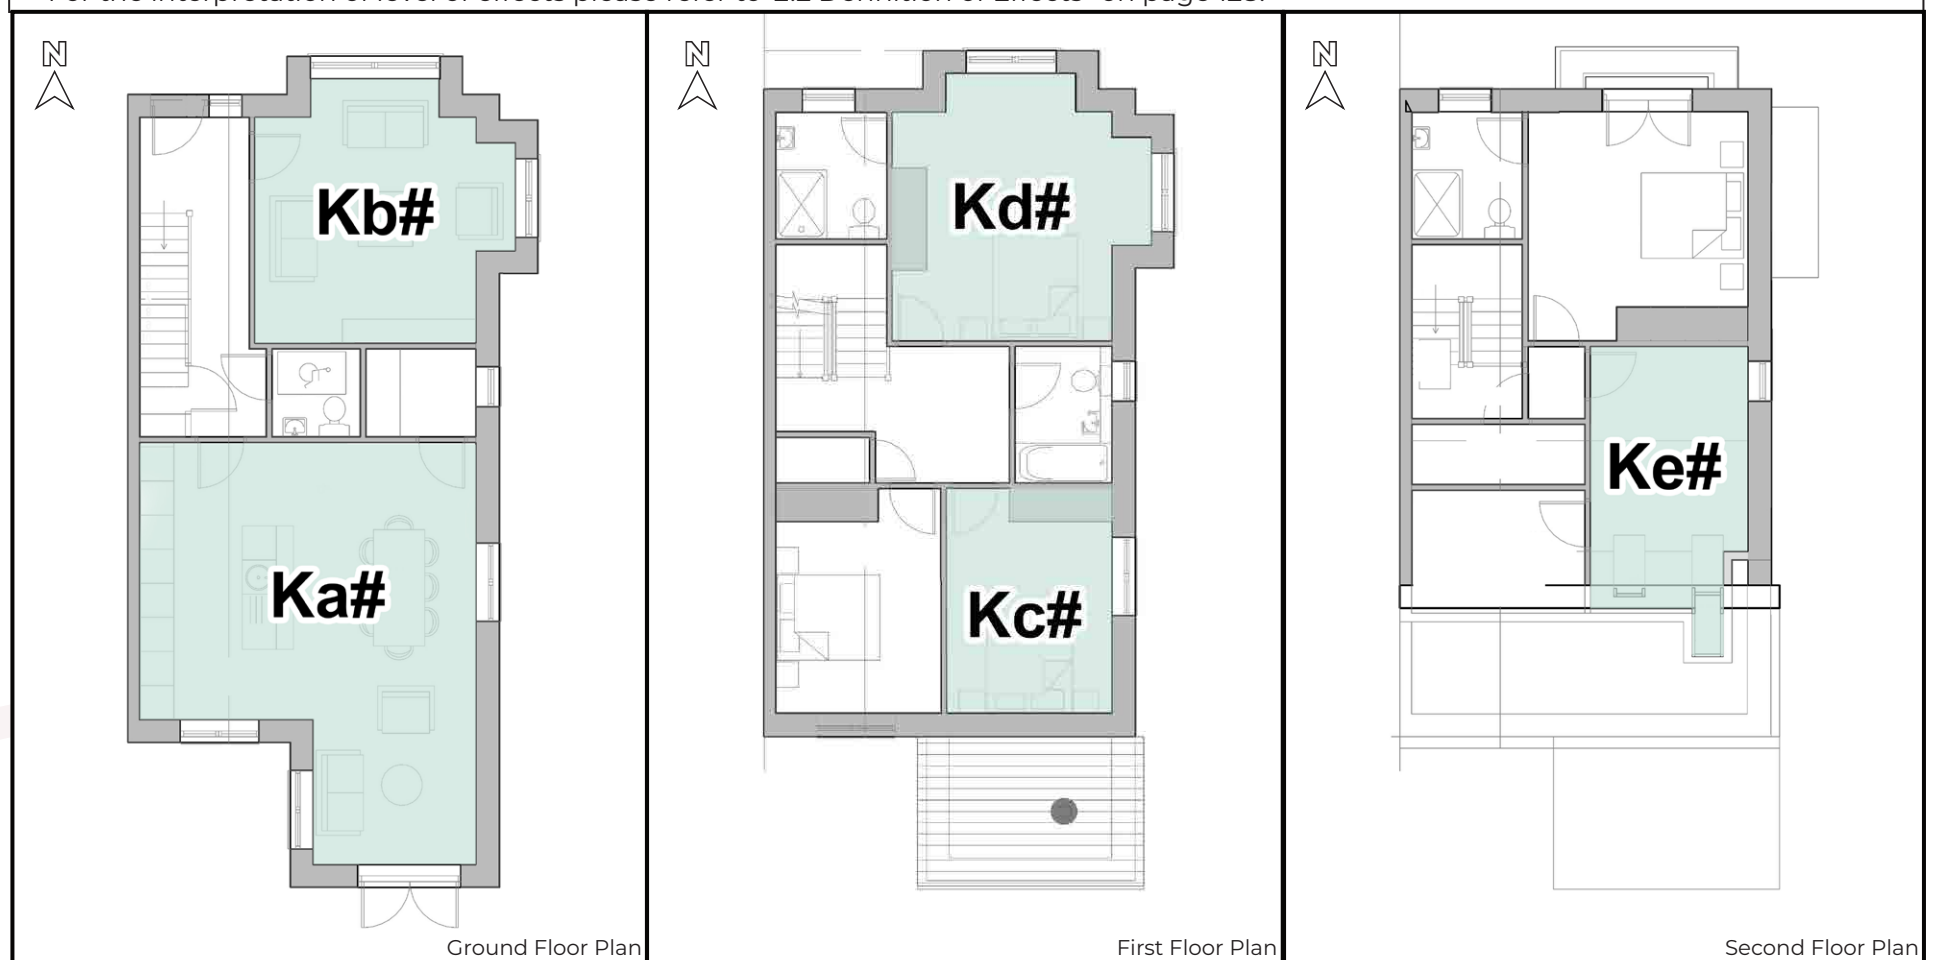


Figure A.4: Highlighted areas indicate the assessed rooms.

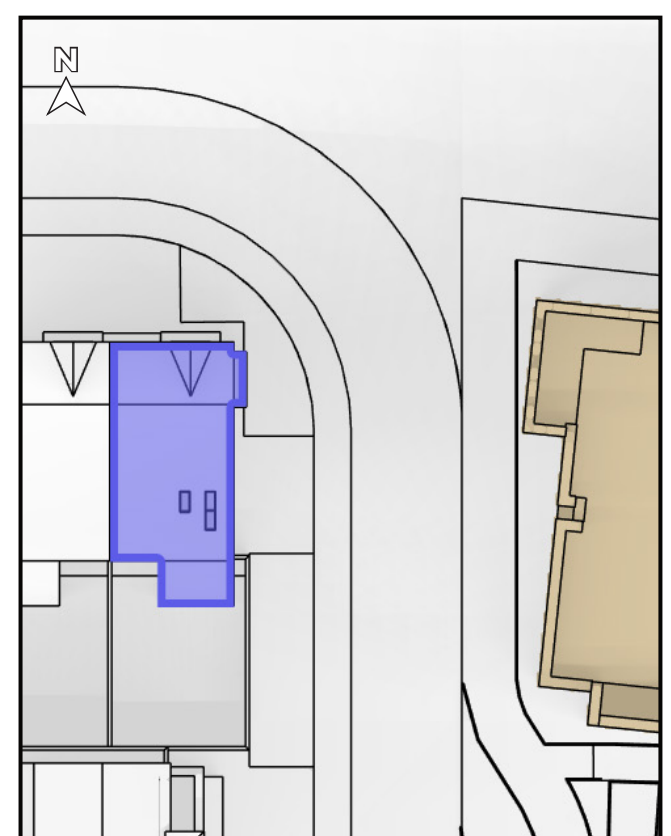


Figure A.5: Aerial view of assessed location.

A.4 Effect on Sun On Ground (SOG) in Existing Outdoor Areas

Below is an example of the table used to describe the effect on SOG in existing gardens and amenity spaces.

Table Example. A.4 - SOG Impact Assessment							
Assigned Area Number	Address	% of Area to Receive Above 2 Hours Sunlight on March 21st (Target >50%)				Level of Compliance with BRE Guidelines	Effect of Proposed Development
		Baseline	Proposed	Ratio of Proposed to Baseline	Recommended Minimum as per BRE Guidelines		
A	B	C	D	E	F	G	H

A: Assigned Area Number

This column indicates the number that 3DDB have assigned to the assessed areas, which is included for the sole purpose of aiding in the identification of the corresponding space shown in the corresponding figure.

B: Address

This column contains the address of the assessed garden/amenity space. The locations of the gardens and amenity spaces assessed are visually represented in the corresponding figure.

C: Baseline

Baseline represents the percentage of the assessed space's area that can receive more than 2 hours of sunlight on March 21st, calculated in the existing baseline model state (as explained in the "Building the Model States" on page 7).

D: Proposed

Proposed represents the percentage of the assessed space's area that can receive more than 2 hours of sunlight on March 21st, calculated in the proposed model state (as explained in the "Building the Model States" on page 7).

E: Ratio of Proposed to Baseline

This column expresses the ratio of change between the baseline and the proposed values. The BRE Guidelines recommend that if the proposed value is less than 0.8 times the baseline value, then the reduction to sunlight is more likely to be perceptible.

F: Recommended Minimum as per the BRE Guidelines

The BRE Guidelines indicate that a proposed development could possibly have a noticeable effect on the sunlight received by an existing garden and/or amenity area, if half the area of the space does not receive at least two hours of sunlight during the spring equinox; **and** the area that receives more than two hours of sun on the spring equinox is less than 0.8 times its former value.

To determine the *recommended minimum*, 80% of the *Baseline* value has been calculated. If this value is above the 50% threshold, a target value of 50% will be applied. If 80% of the baseline value is below 50%, then 80% of the baseline value is the appropriate target value.

G: Level of BRE Compliance

This column states the compliance of the *Proposed* sunlight value with the *recommended minimum as per the BRE Guidelines*. In essence, it shows whether or not the assessed garden or amenity area would experience a perceptible level of impact. If the garden or amenity area complies with the BRE Guidelines this cell will state "*BRE Compliant*". If the garden or amenity area does not meet the criteria as set out in the BRE Guidelines, a percentage of compliance with the *recommended minimum* will be stated.

H: Effect of Proposed Development

The levels of effect in this column describe the effect an assessed area will experience, based on its compliance with the *BRE Target Value*. A full list of definitions and a numerical rationale for each can be found in the section "*Definition of Effects*" on page 128.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

A.4.1 Existing Amenity Areas

Table No. A.4.1 - SOG Results:							
Assigned Area Number	Address	% of Area to Receive Above 2 Hours Sunlight on March 21st (Target >50%)				Level of Compliance with BRE Guidelines*	Effect of Proposed Development**
		Baseline	Proposed	Ratio of Proposed to Baseline	Recommended minimum		
1	U37_Ph1_BackGarden	60.55%	60.55%	1.00	48.44%	BRE Compliant	Negligible
2	Ard Rath View	89.64%	89.48%	1.00	50.00%	BRE Compliant	Negligible
3	76A Crodaun Forest Park	64.84%	64.84%	1.00	50.00%	BRE Compliant	Negligible

* The BRE guidelines state that in order for a proposed development to have a noticeable effect on the amount of sunlight received in an existing garden or amenity area, the value needs to both drop below the stated target value of 50% **and** be reduced by more than 20% of the existing value.

** For the interpretation of level of effects please refer to "E.2 Definition of Effects" on page 128.





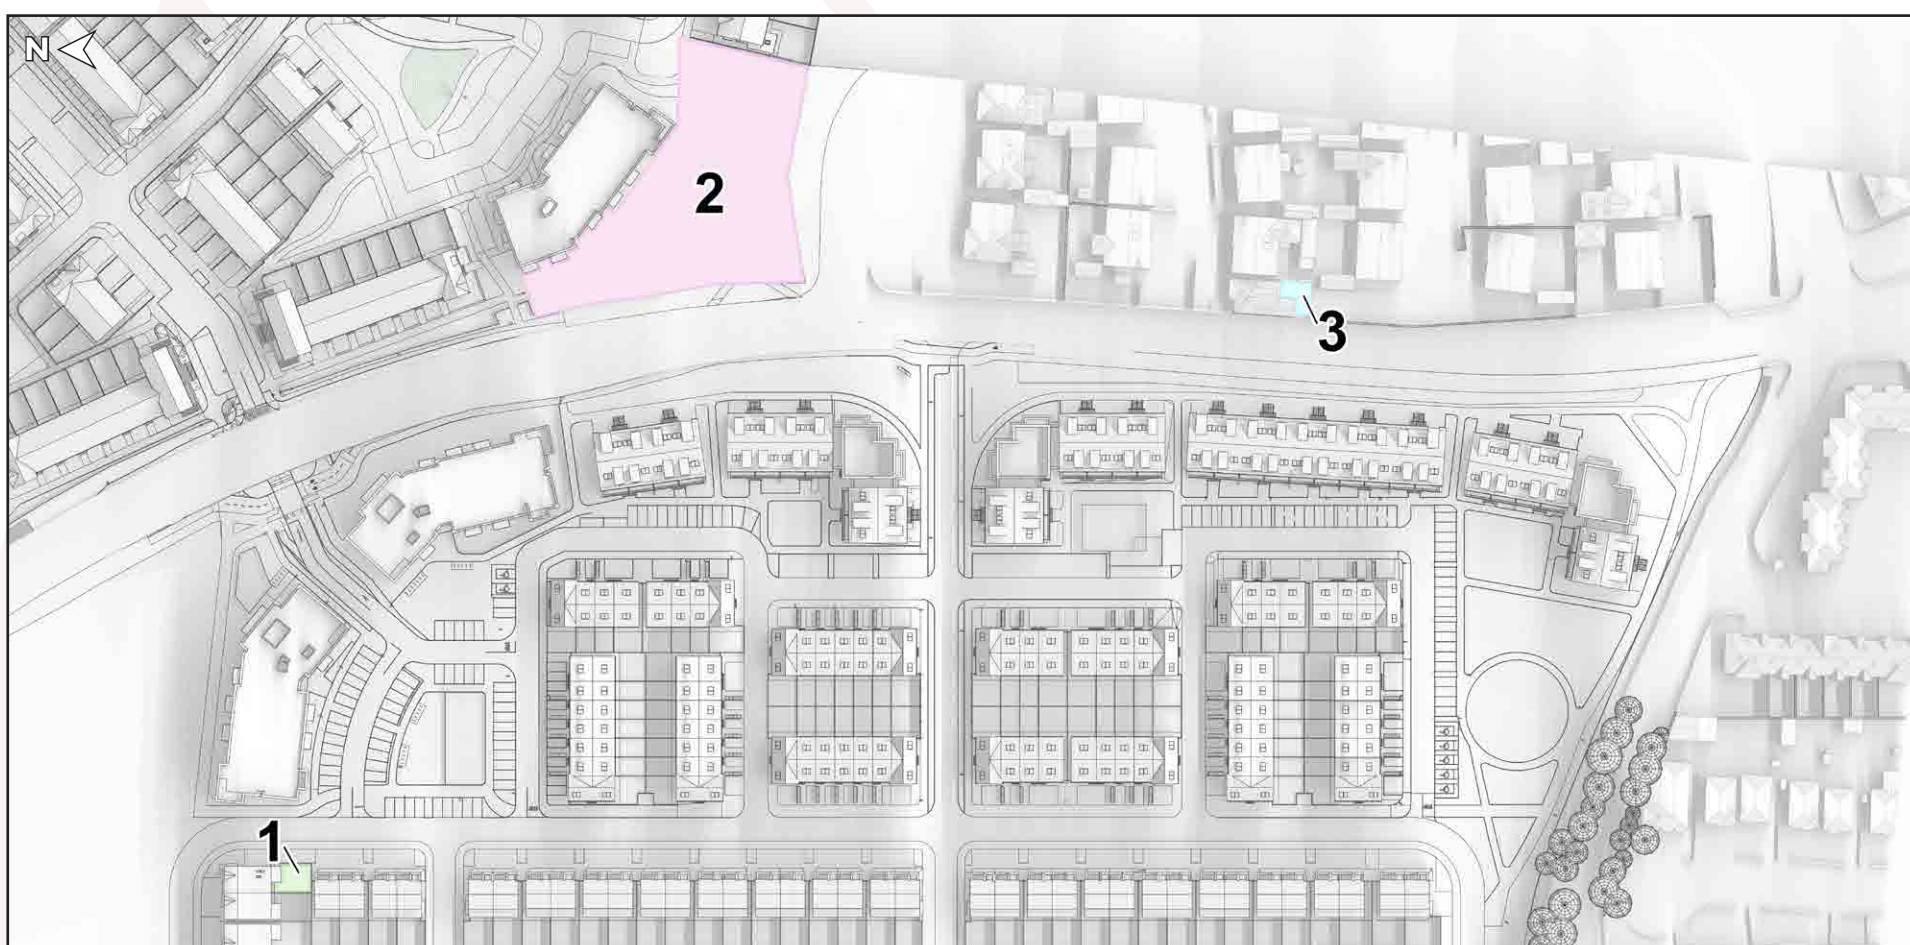


Figure A.6: Indication of the existing areas that have been analysed

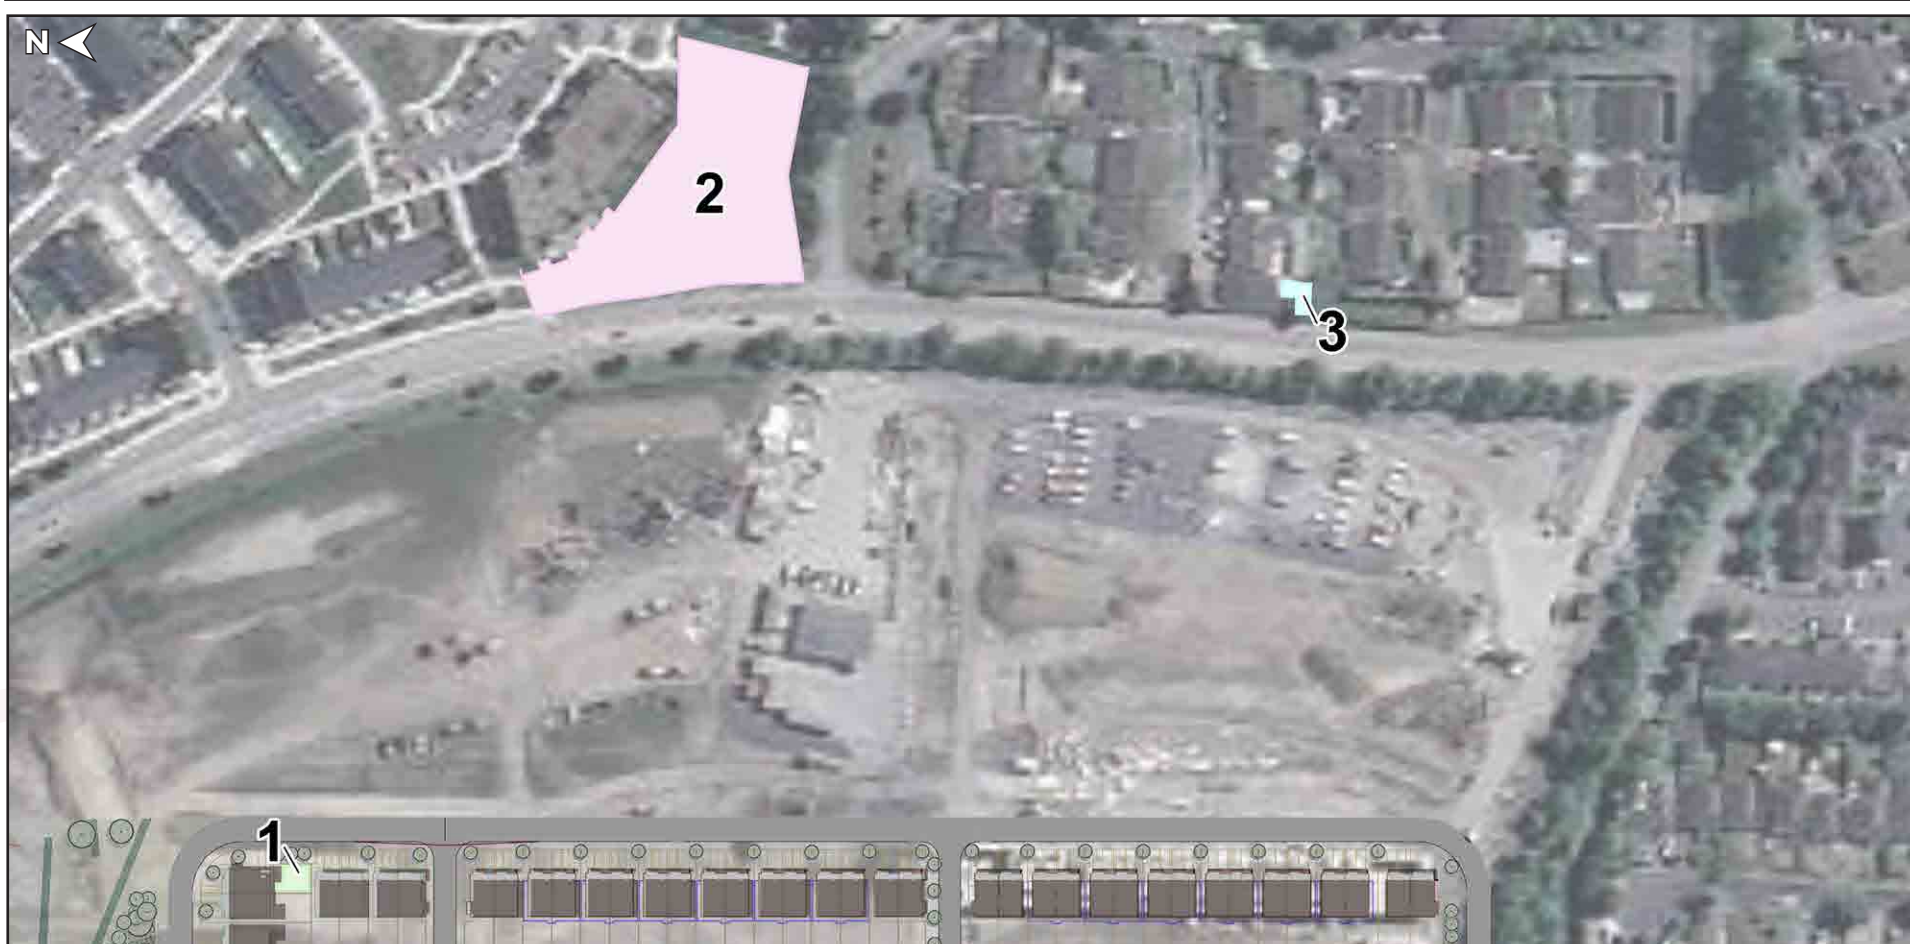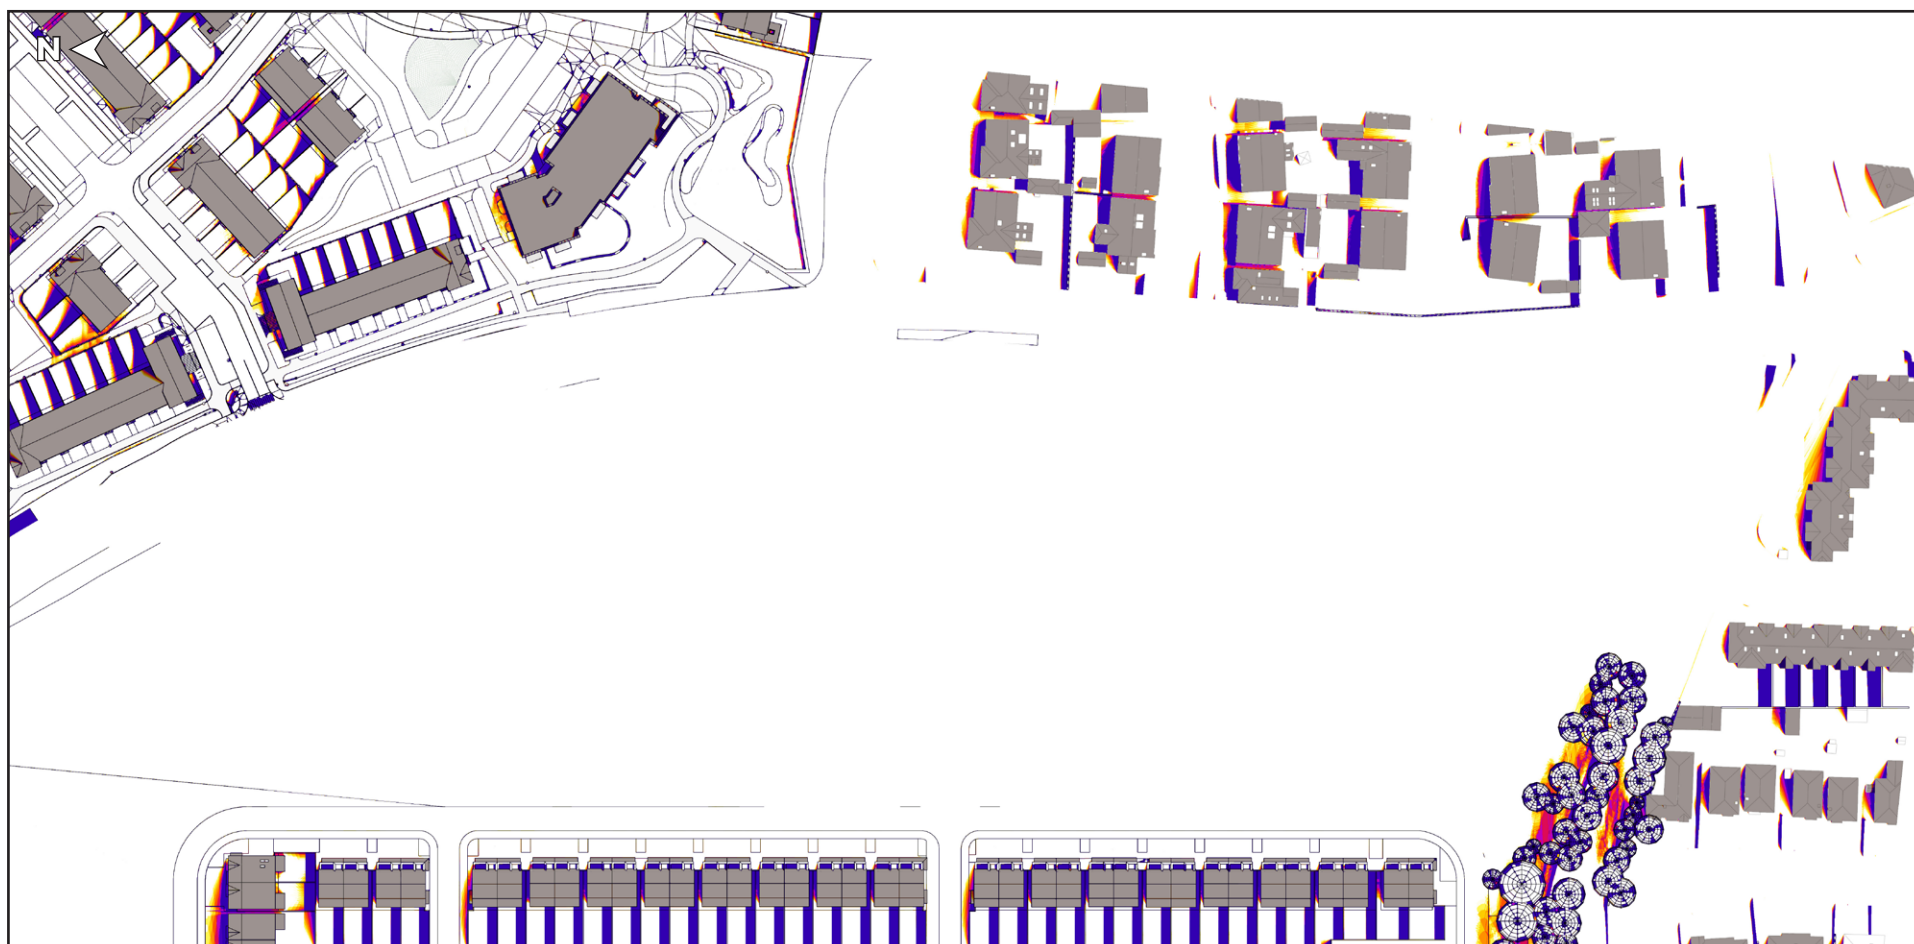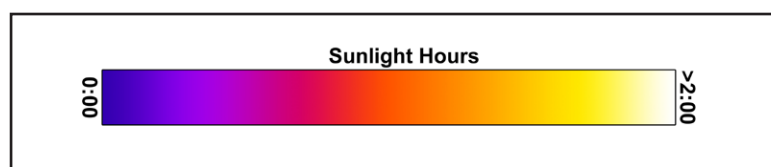

Baseline

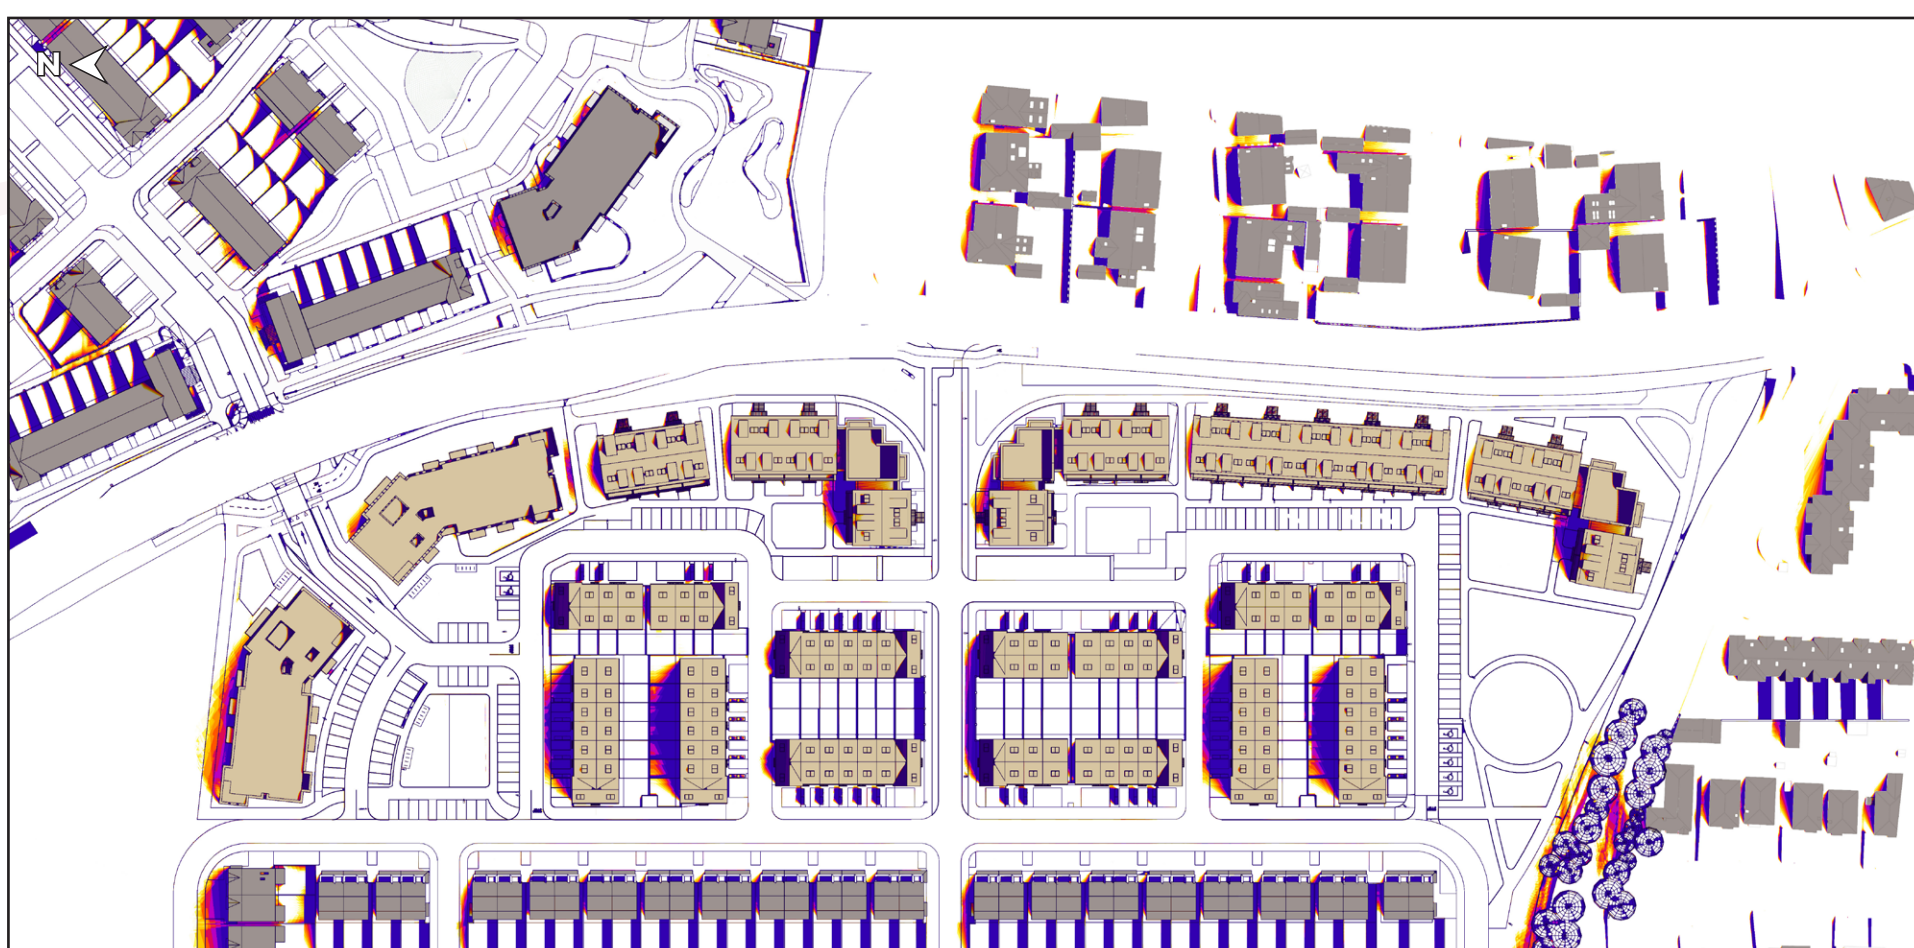

Proposed

Figure A.7: False colour plans. White area indicates the area capable of receiving 2 hours of sunlight on March 21st.



Baseline

Proposed

March 21st 7:00



March 21st 8:00



March 21st 9:00



March 21st 10:00



B.0
B.1

Shadow Studies
Shadow Study 21 March

Project: Apart Dev Kilwoghan Woods

Proposed

March 21st
Sunrise 6:31 | Sunset 18:35

Applicant: Seattle Construction Limited





Baseline

Proposed

March 21st 11:00



March 21st 12:00



March 21st 13:00



March 21st 14:00



Project: Apart Dev Kilwoghan Woods

Proposed

March 21st
Sunrise 6:31 | Sunset 18:35

Applicant: Seattle Construction Limited





Baseline

Proposed

March 21st 15:00



March 21st 16:00



March 21st 17:00



March 21st 18:00



Project: Apart Dev Kilwoghan Woods

Proposed

March 21st
Sunrise 6:31 | Sunset 18:35

Applicant: Seattle Construction Limited





Baseline

Proposed

June 21st 6:00



June 21st 7:00



June 21st 8:00



June 21st 9:00



B.2	Shadow Study 21 June	Project: Apart Dev Kilwoghan Woods	Proposed
	June 21st Sunrise 5:05 Sunset 21:51	Applicant: Seattle Construction Limited	 3D DESIGN BUREAU



Baseline

Proposed

June 21st 10:00



June 21st 11:00



June 21st 12:00



June 21st 13:00



Project: Apart Dev Kilwoghan Woods

Proposed

June 21st
Sunrise 5:05 | Sunset 21:51

Applicant: Seattle Construction Limited





Baseline

Proposed

June 21st 14:00



June 21st 15:00



June 21st 16:00



June 21st 17:00



Project: Apart Dev Kilwoghan Woods		Proposed
June 21st Sunrise 5:05 Sunset 21:51	Applicant: Seattle Construction Limited	 3D DESIGN BUREAU




Baseline

Proposed

June 21st 18:00



June 21st 19:00

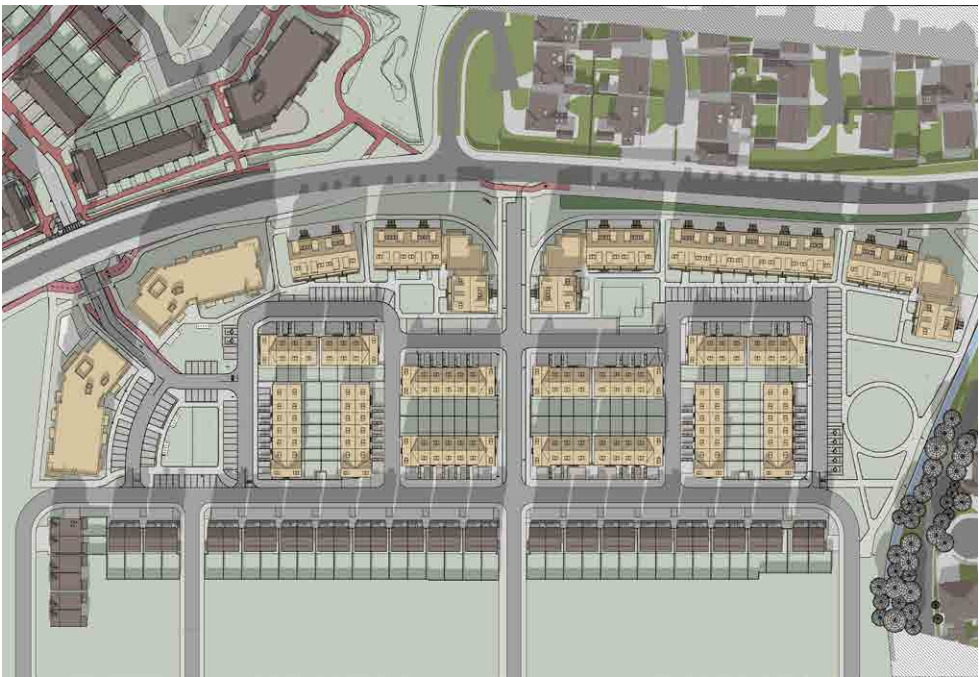

June 21st 20:00



June 21st 21:00





Baseline

Proposed

December 21st 9:00



December 21st 10:00



December 21st 11:00



December 21st 12:00





Baseline

Proposed


December 21st 13:00



December 21st 14:00



December 21st 15:00

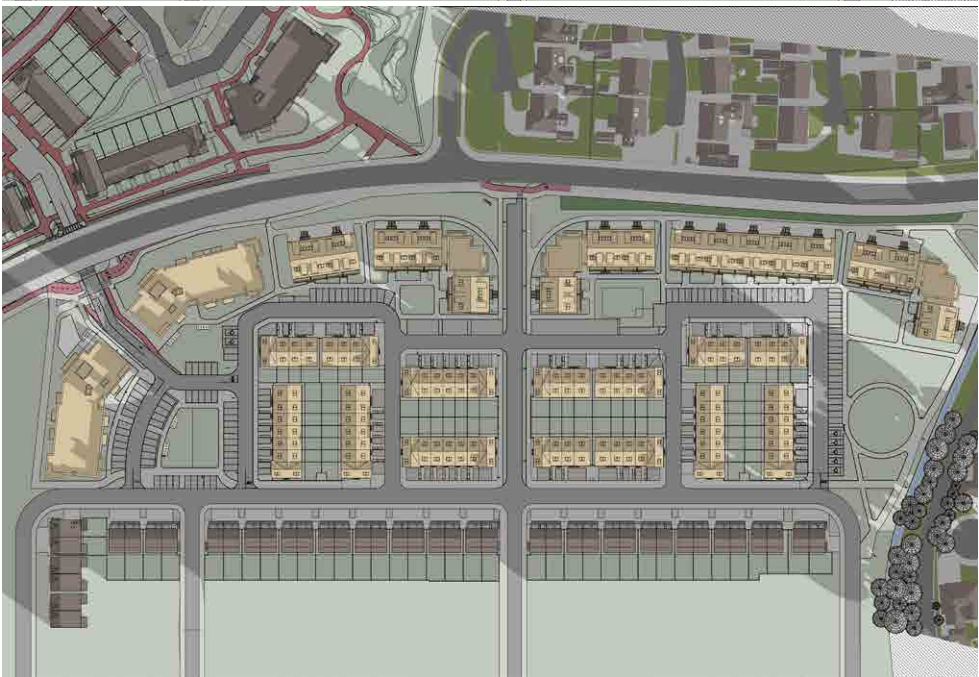

December 21st 16:00



Project: Apart Dev Kilwoghan Woods

Proposed

December 21st
Sunrise 8:47 | Sunset 16:02

Applicant: Seattle Construction Limited



C.0 Scheme Performance

C.1 Proposed Floor Plans

C.1.1 Proposed Apartment Floor Plans - Block A

Figure C.1: Block A - Site Location

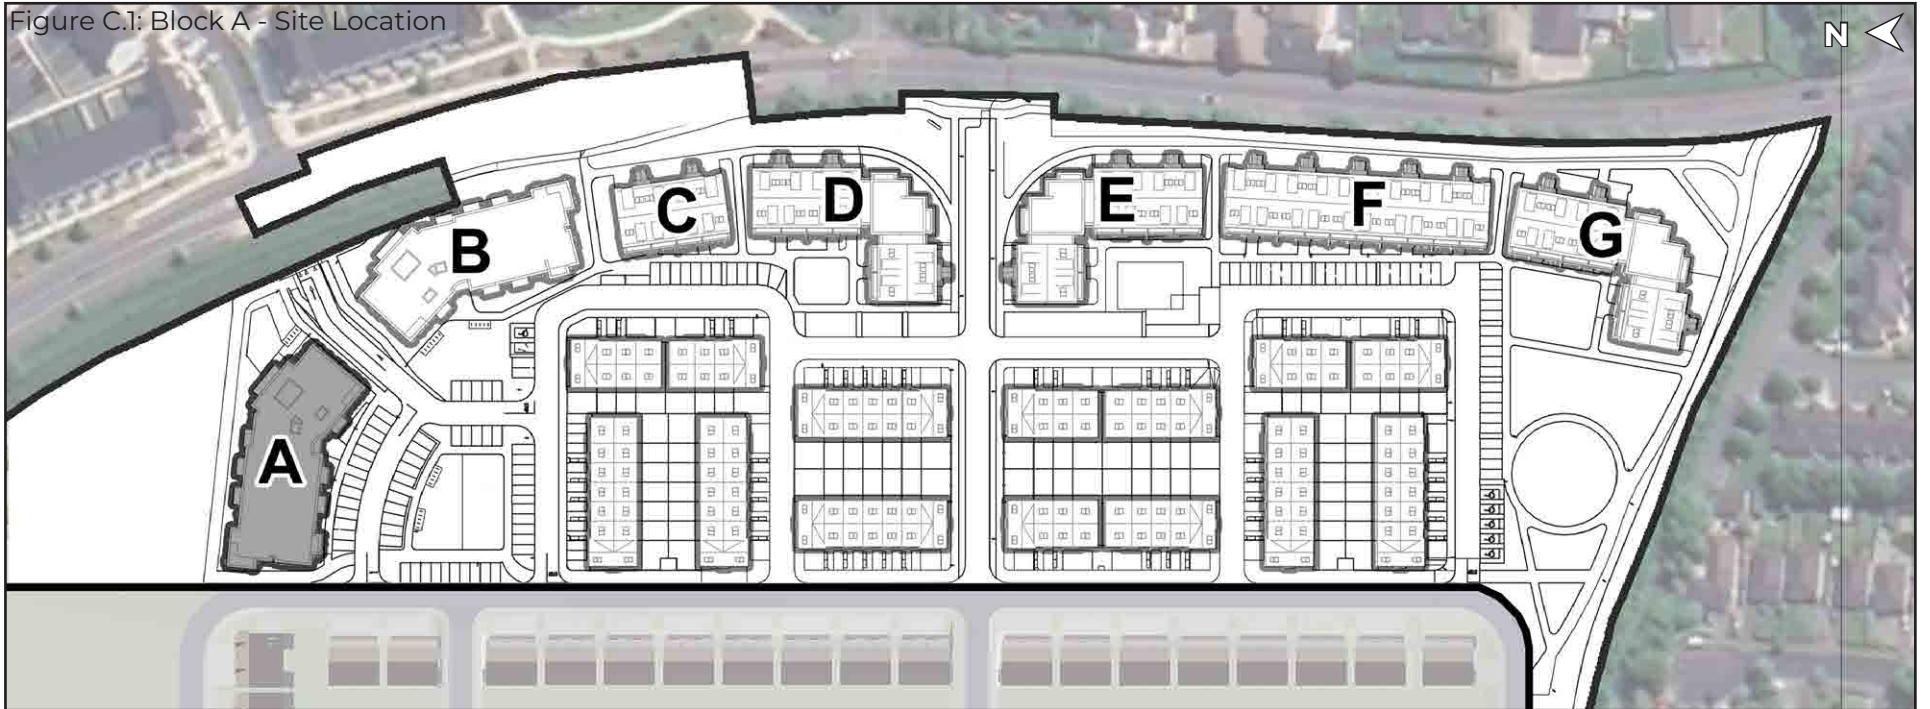


Figure C.2: Block A - Ground Floor

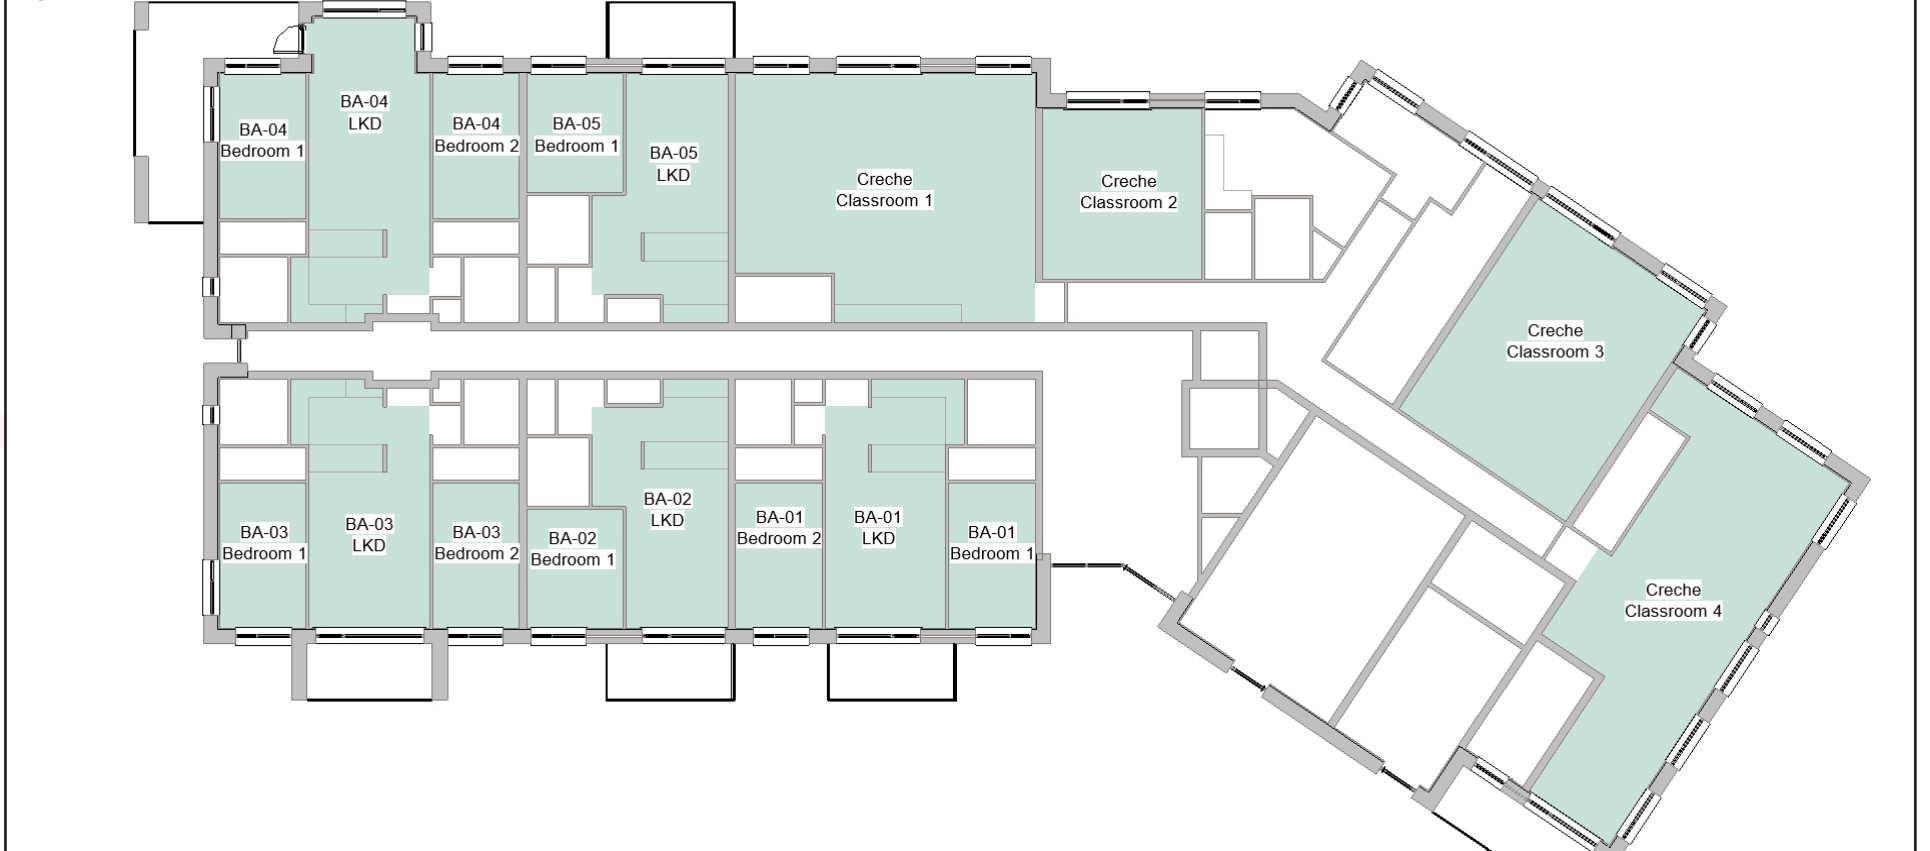


Figure C.3: Block A - First Floor



Figure C.4: Block A - Second Floor



Figure C.5: Block A - Third Floor



C.1.2 Proposed Apartment Floor Plans - Block B

Figure C.6: Block B - Site Location

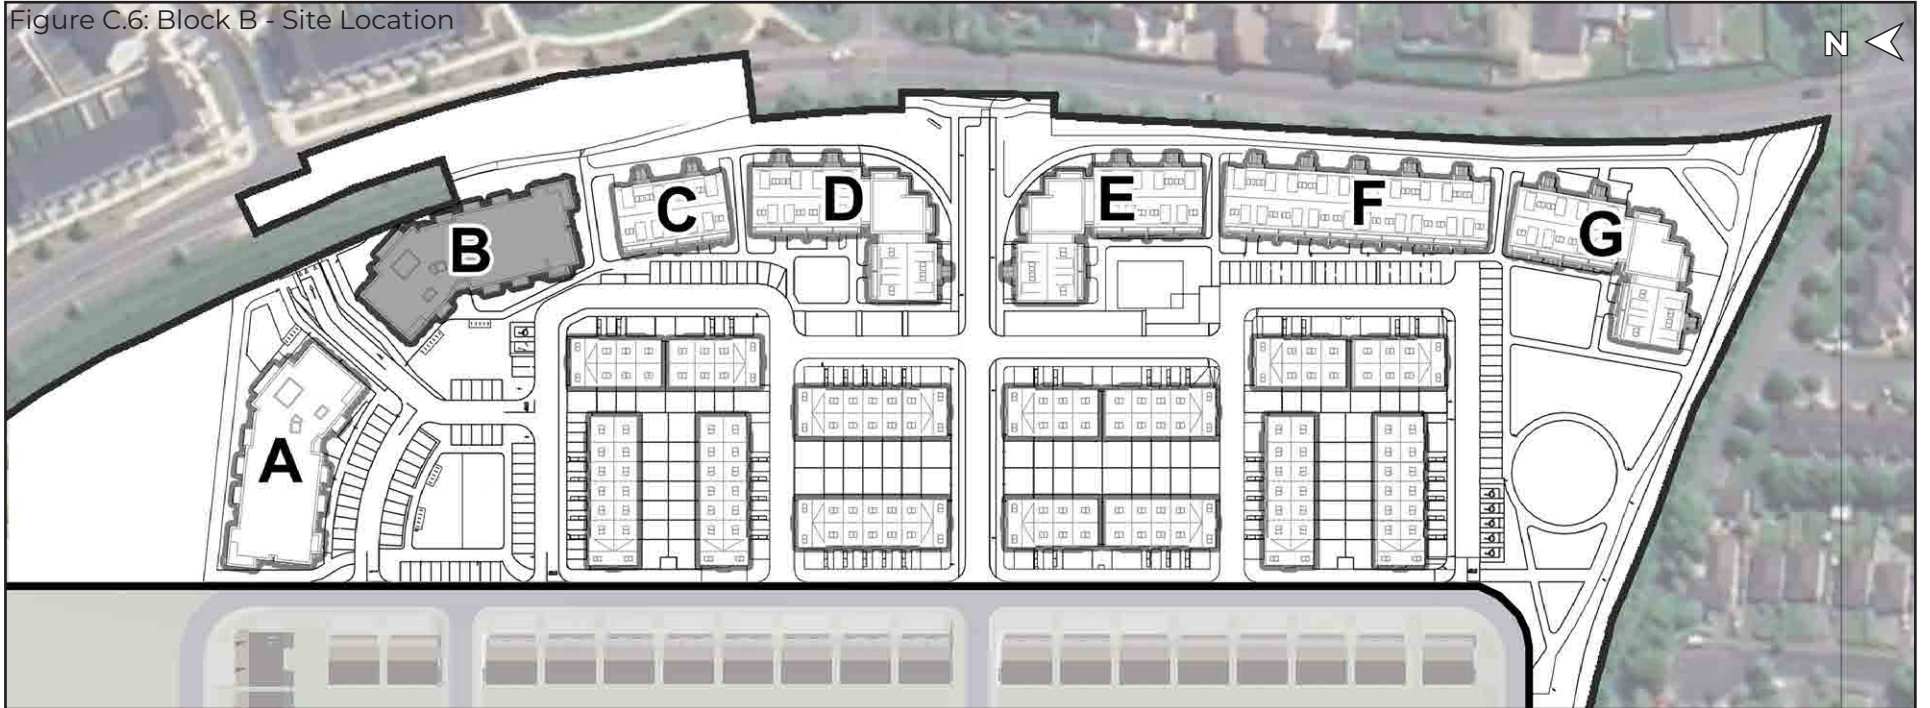


Figure C.7: Block B - Ground Floor



Figure C.8: Block B - First Floor



Figure C.9: Block B - Second Floor



Figure C.10: Block B - Third Floor



C.1.3 Proposed Duplex Floor Plans - Block C

Figure C.11: Duplex Block C - Site Location

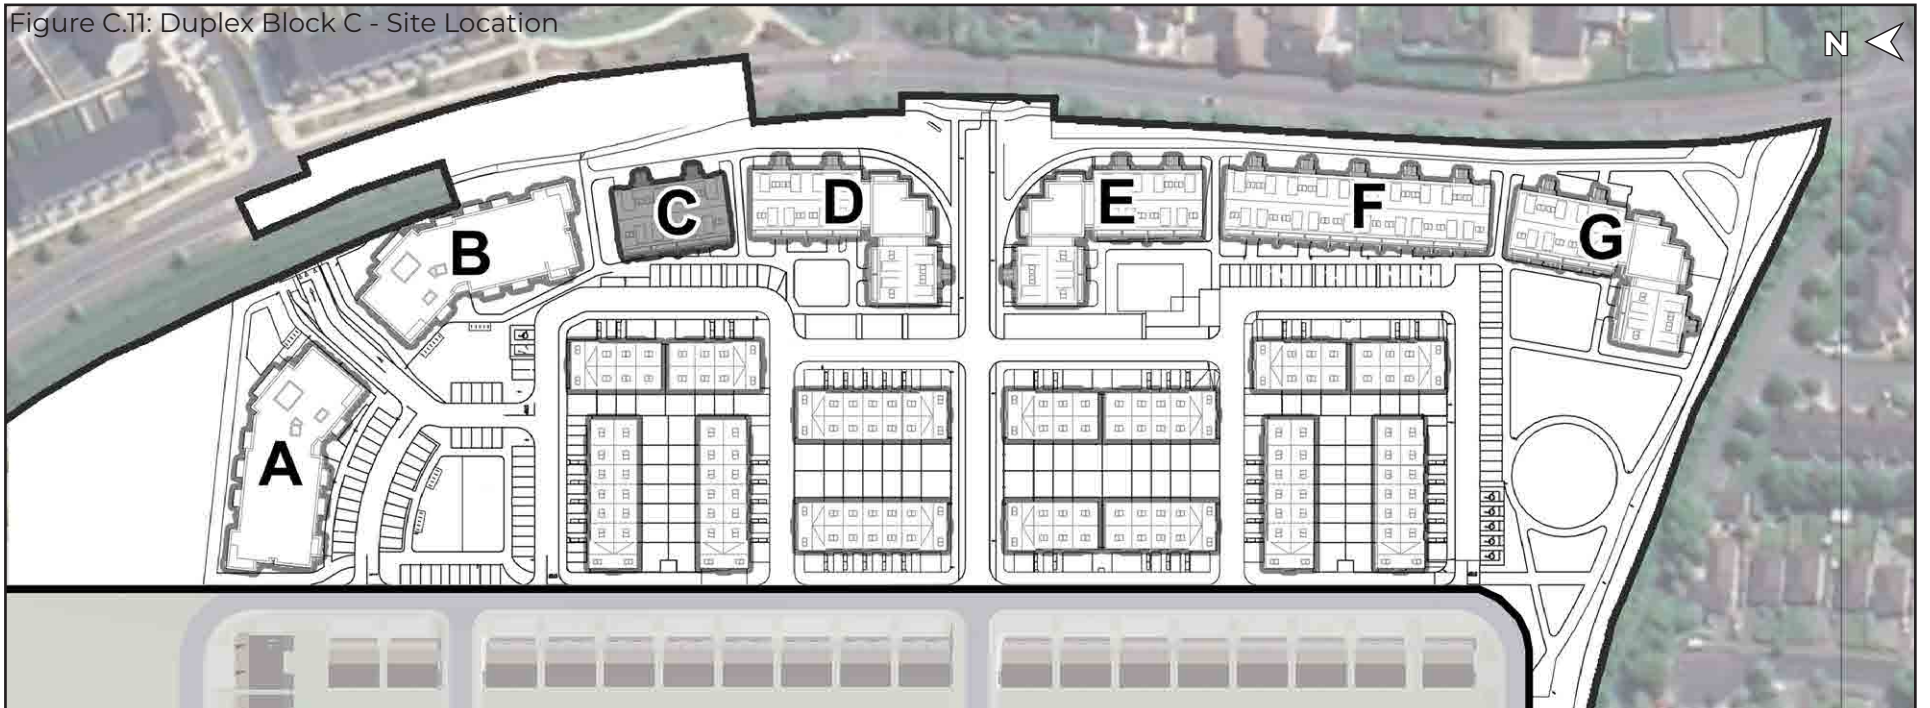


Figure C.12: Duplex Block C - Ground Floor

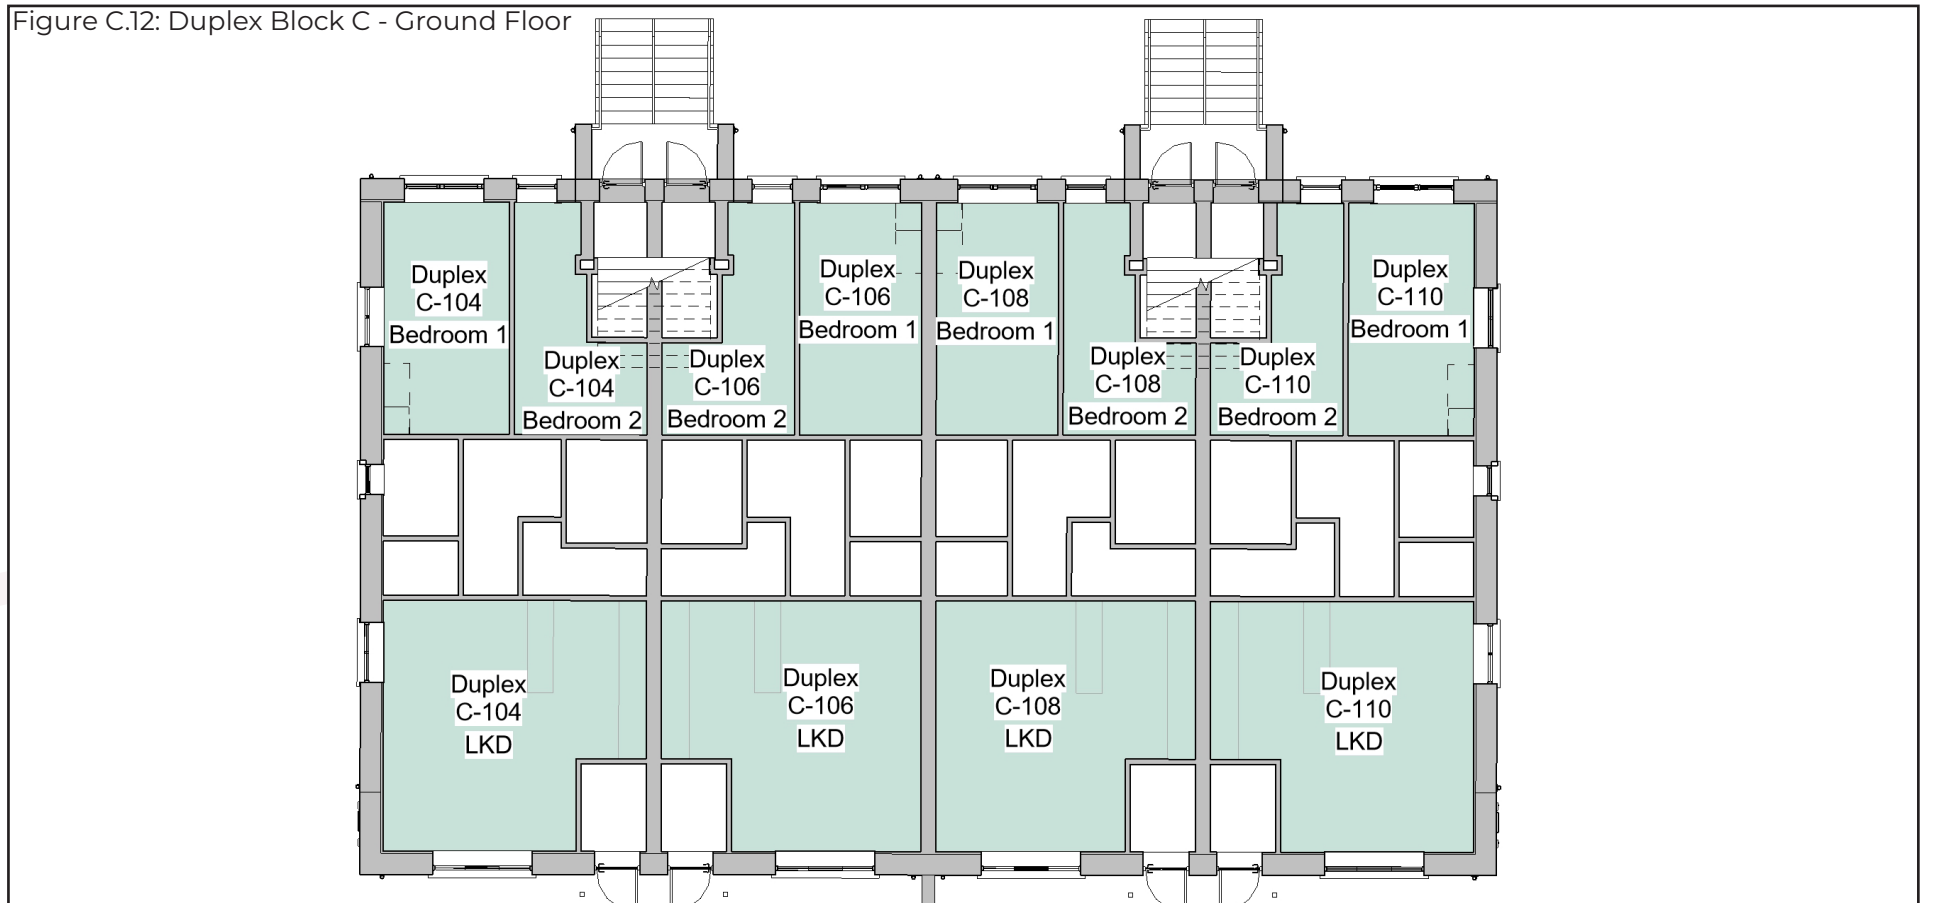


Figure C.13: Duplex Block C - First Floor


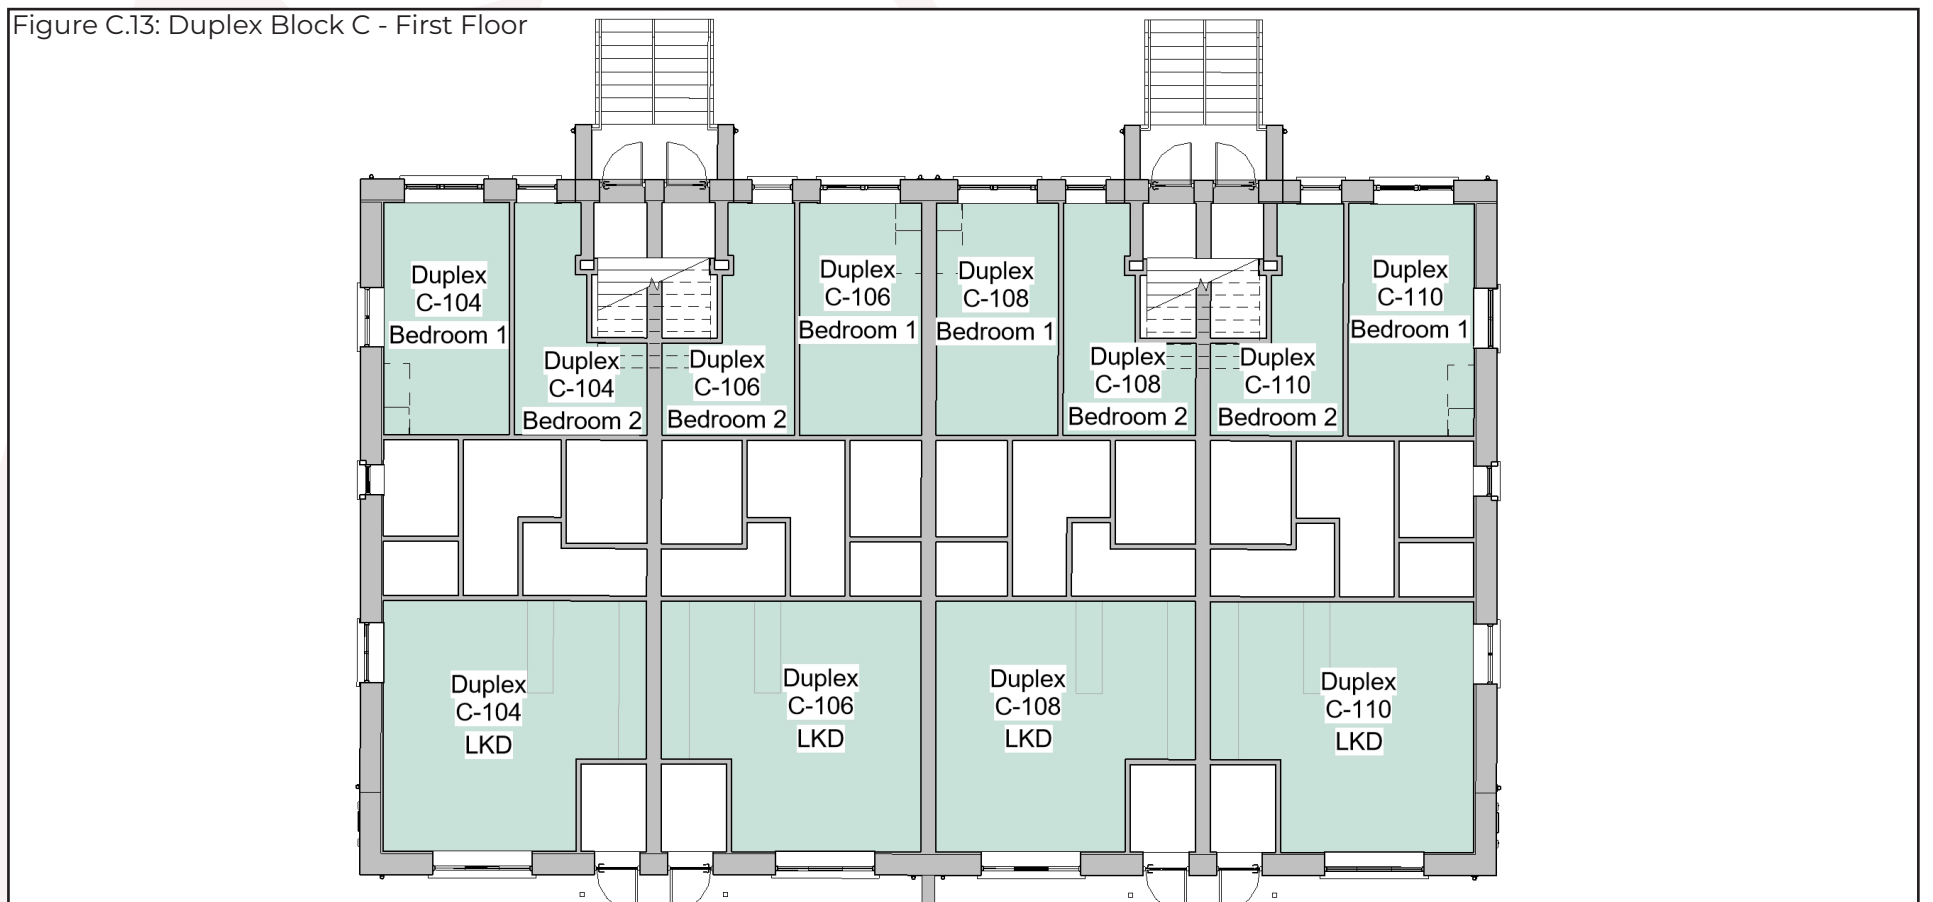


Figure C.14: Duplex Block C - Second Floor

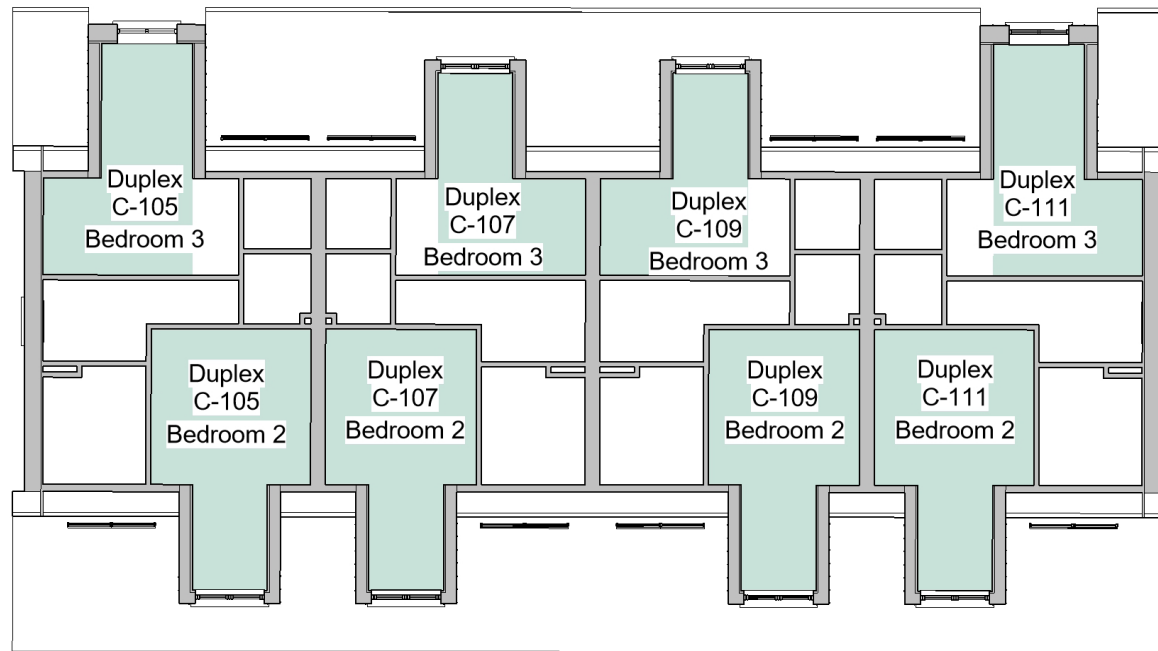

C.1.4 Proposed Duplex Floor Plans - Block D


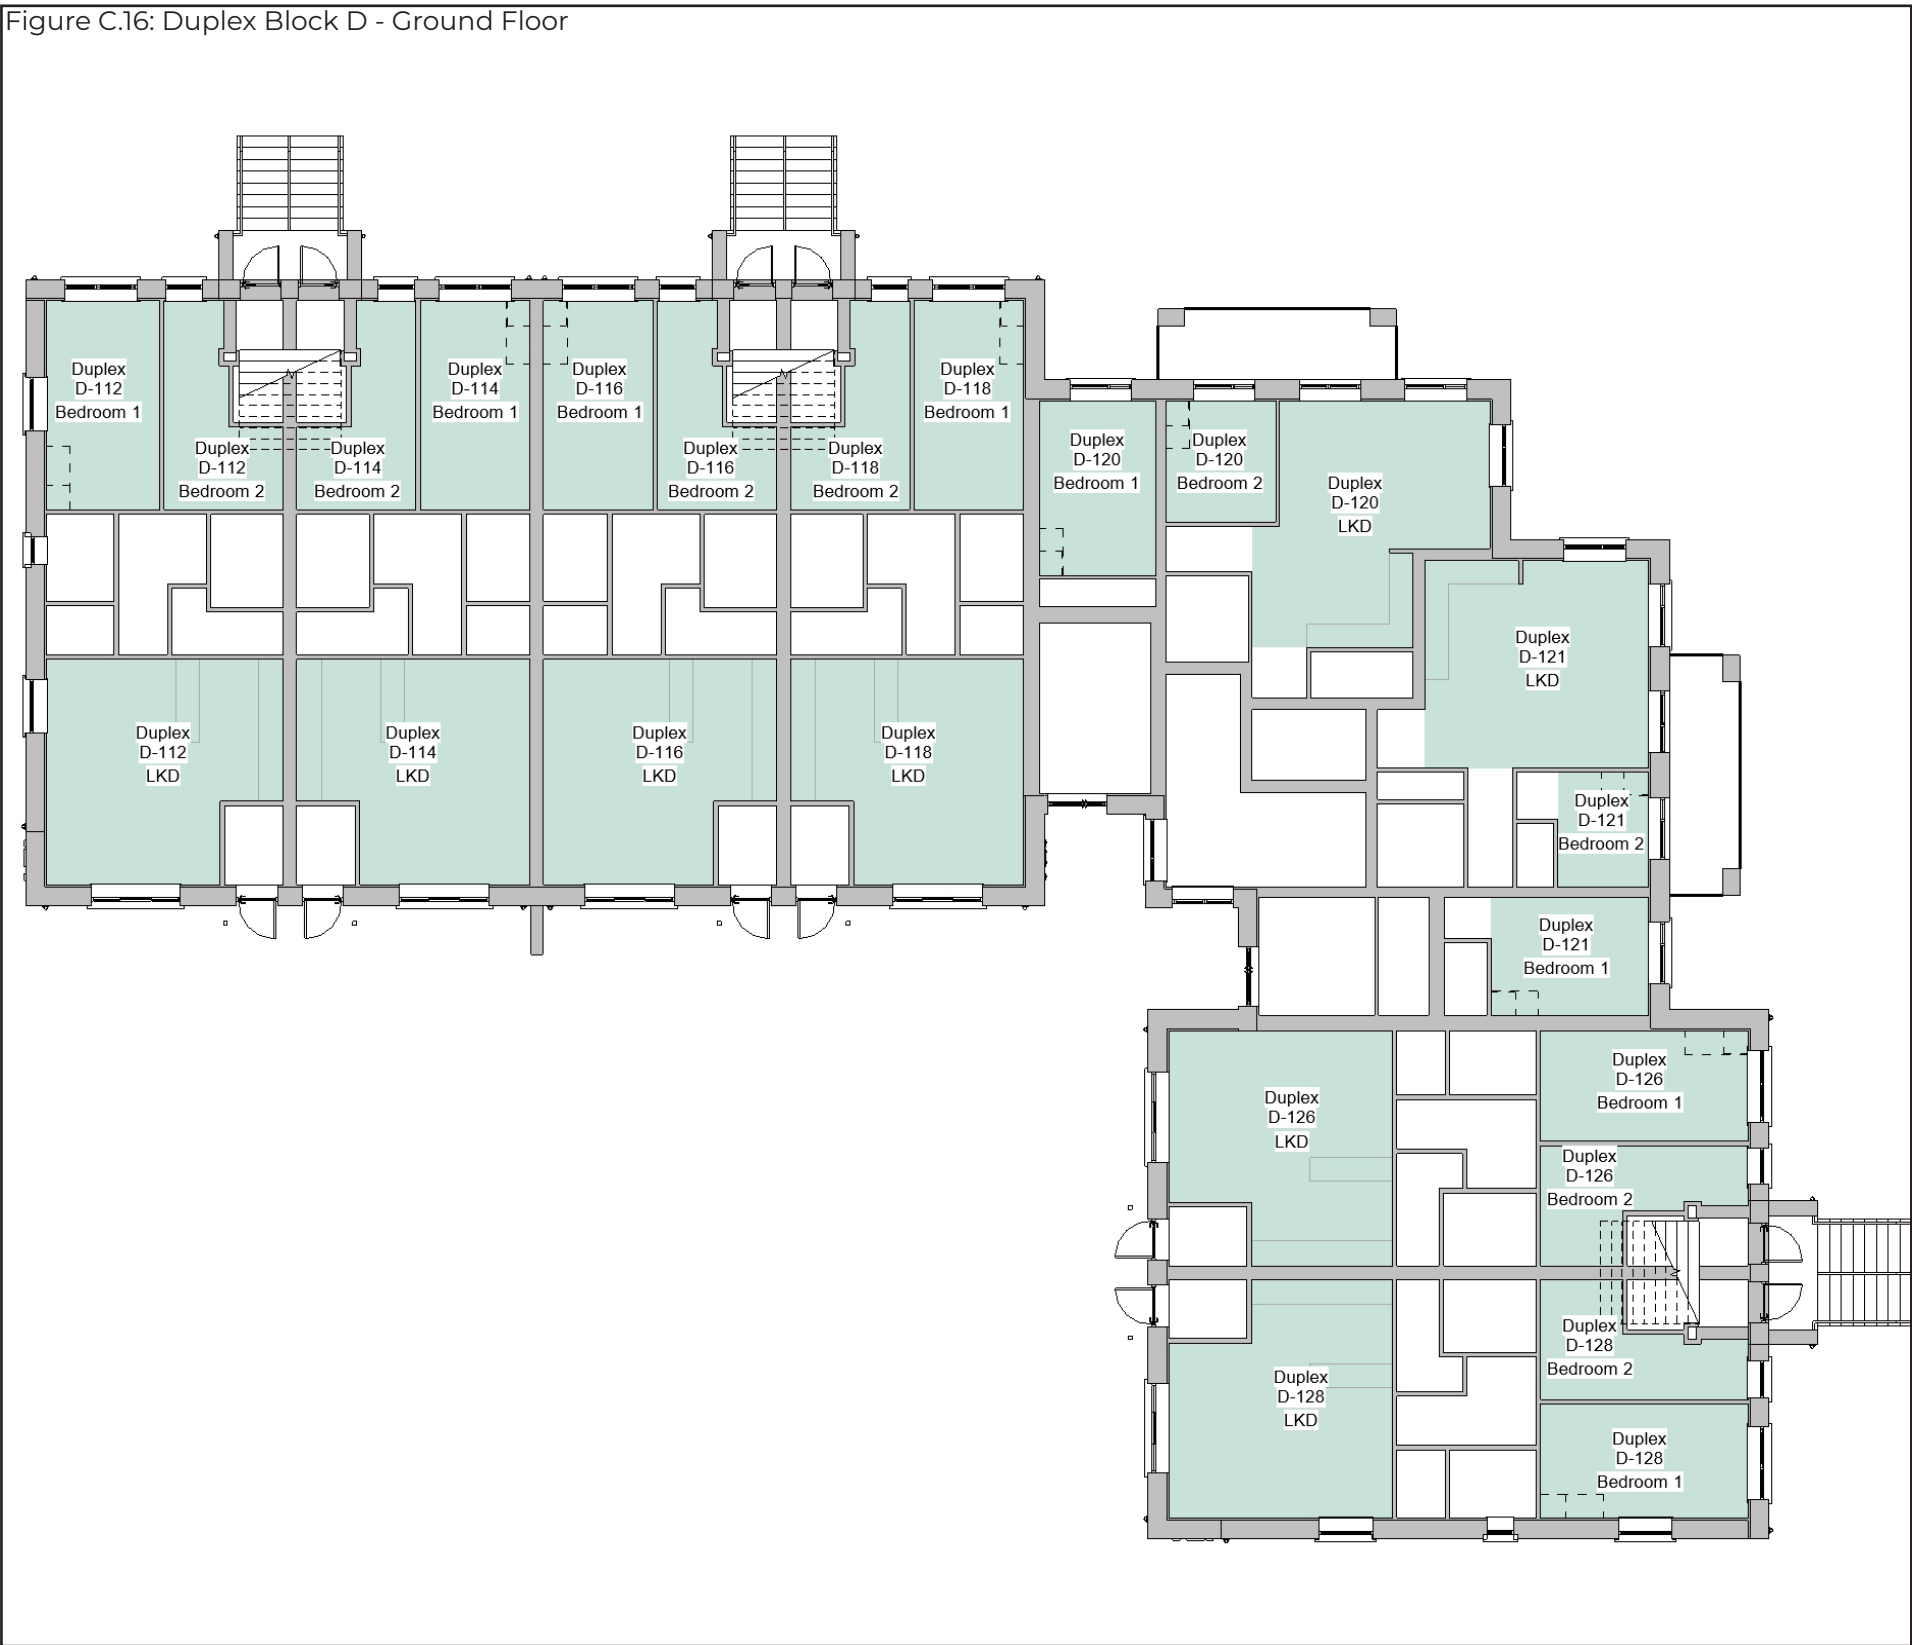


Figure C.17: Duplex Block D - First Floor



Figure C.18: Duplex Block D - Second Floor

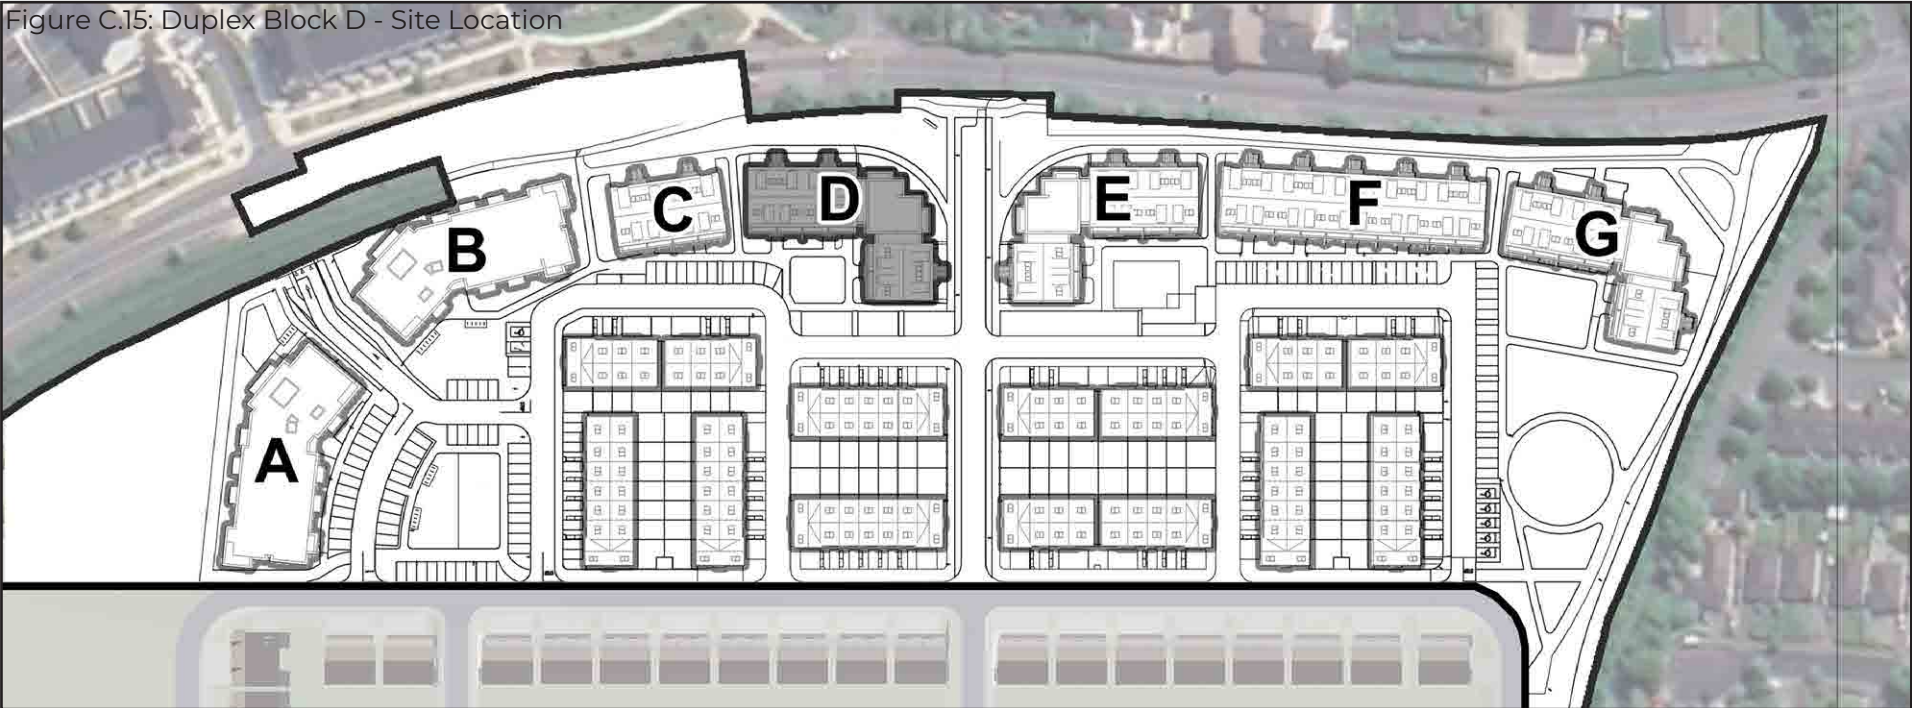

C.1.5 Proposed Duplex Floor Plans - Block E

Figure C.19: Duplex Block E - Site Location

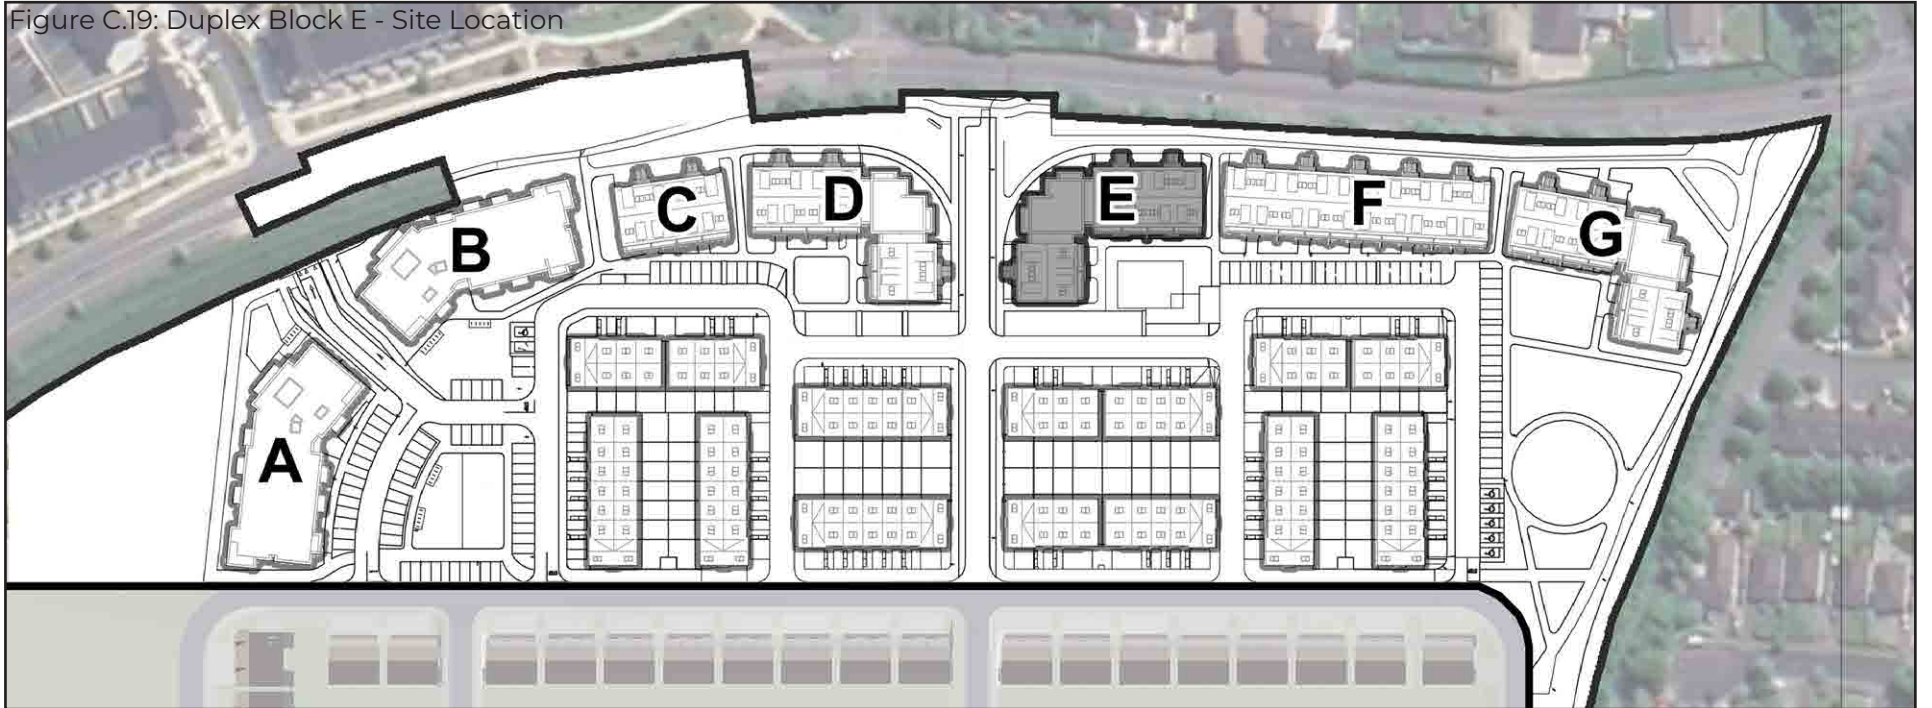


Figure C.20: Duplex Block E - Ground Floor

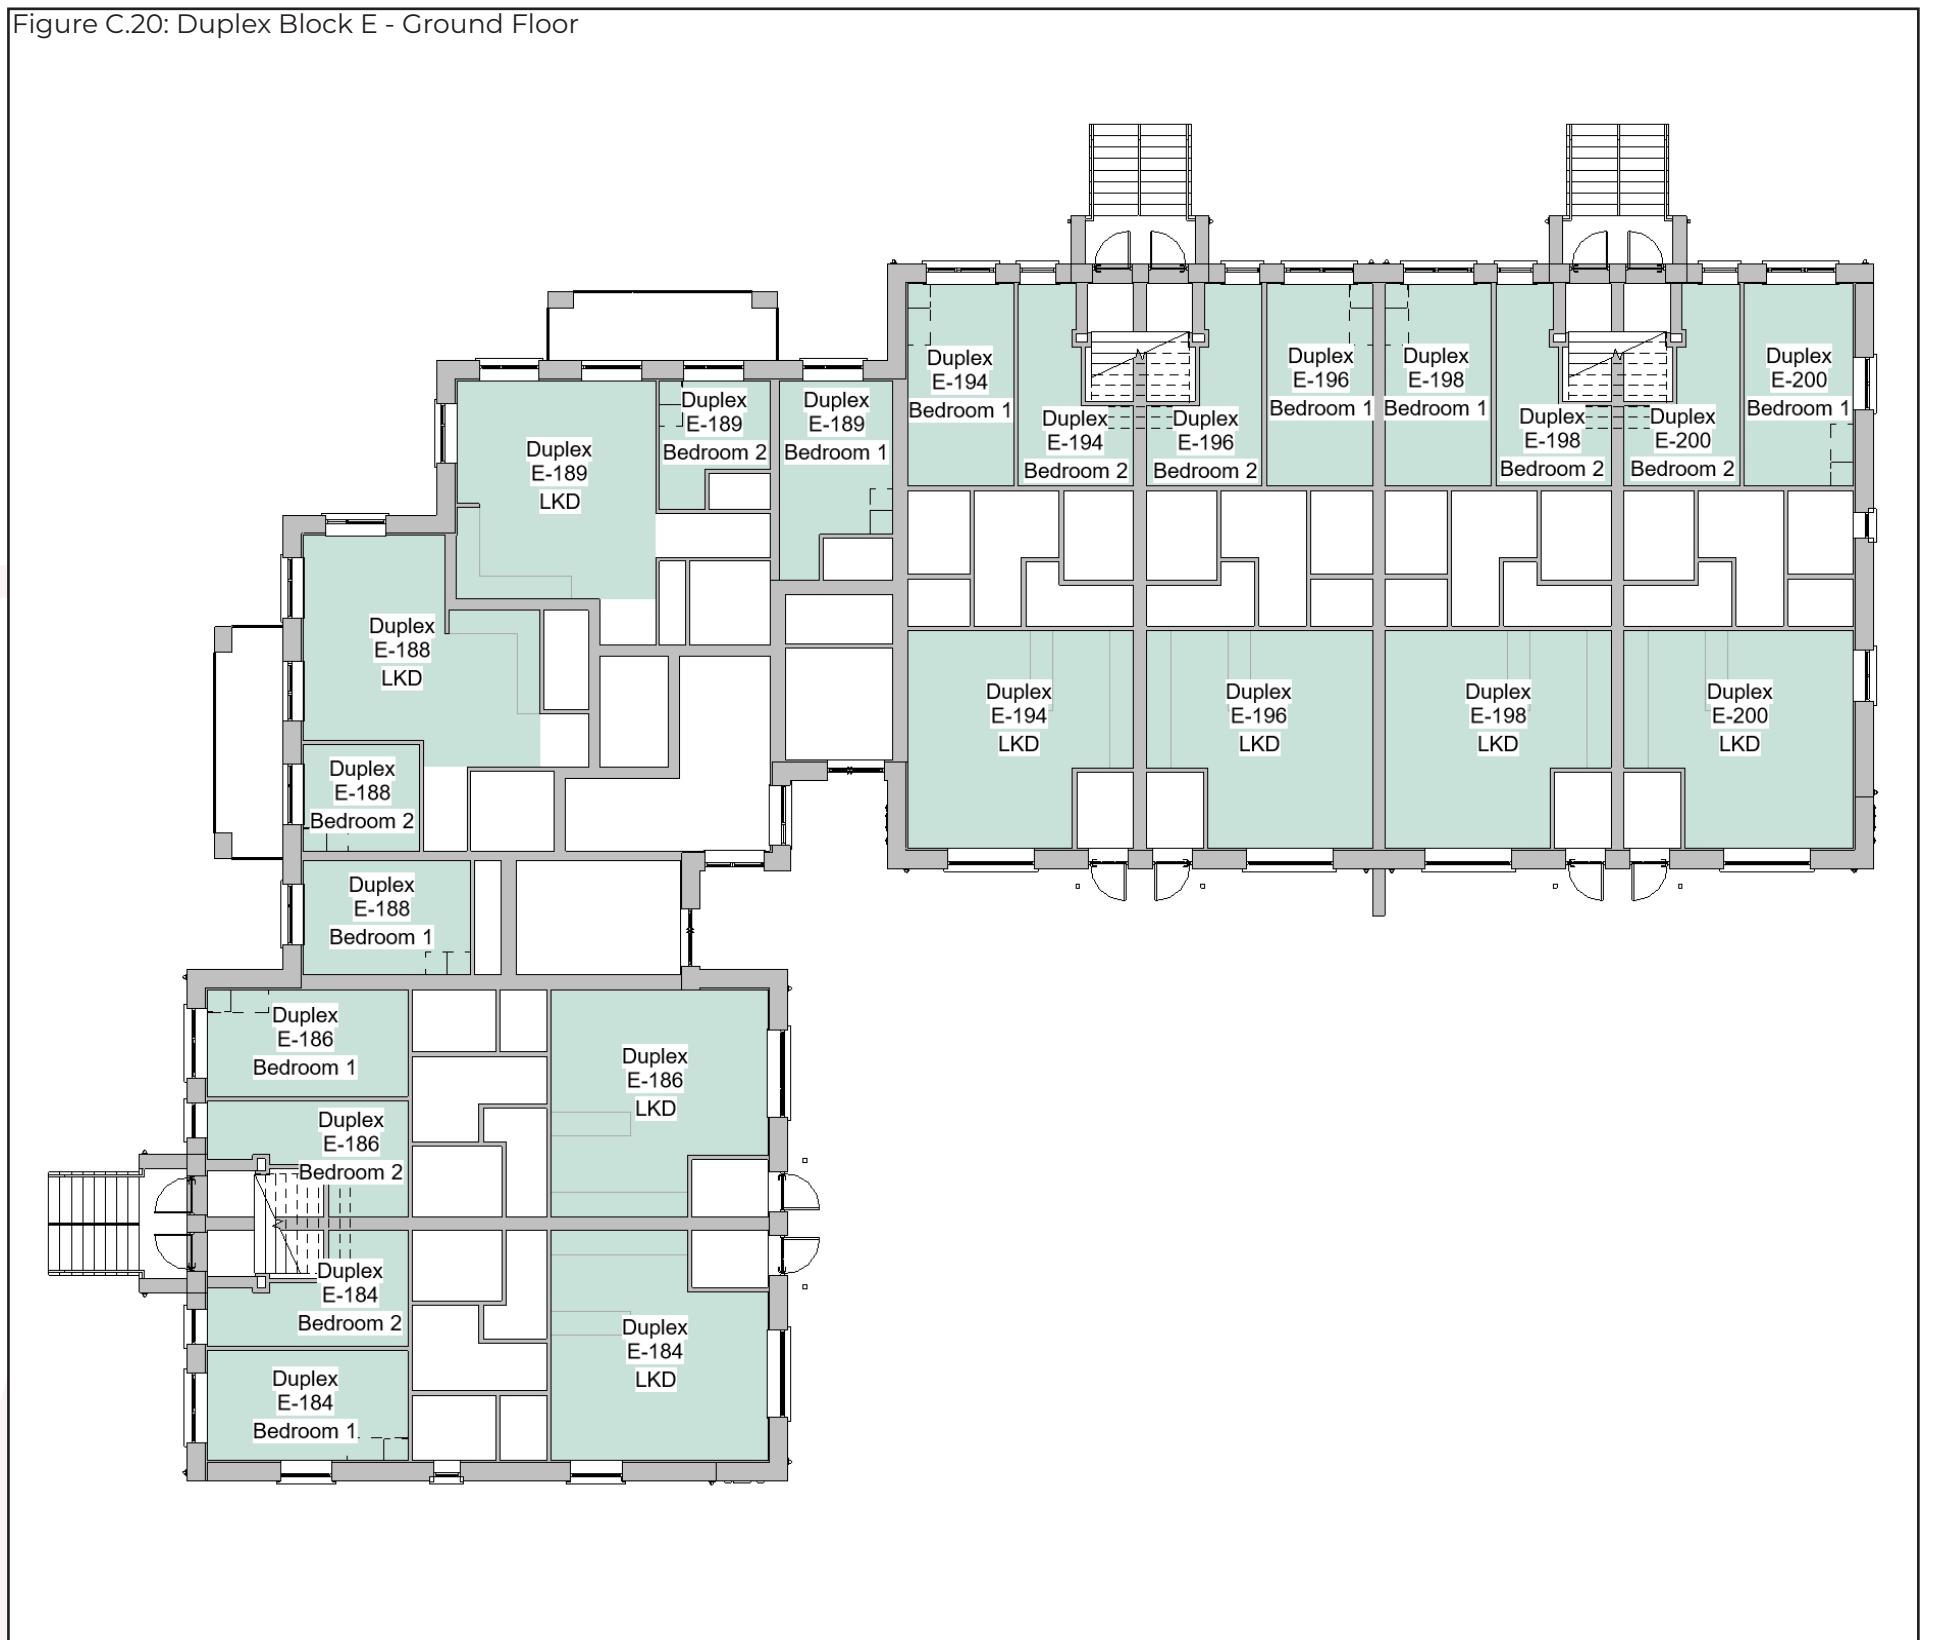


Figure C.21: Duplex Block E - First Floor



Figure C.22: Duplex Block E - Second Floor



C.1.6 Proposed Duplex Floor Plans - Block F

Figure C.23: Duplex Block F - Site Location

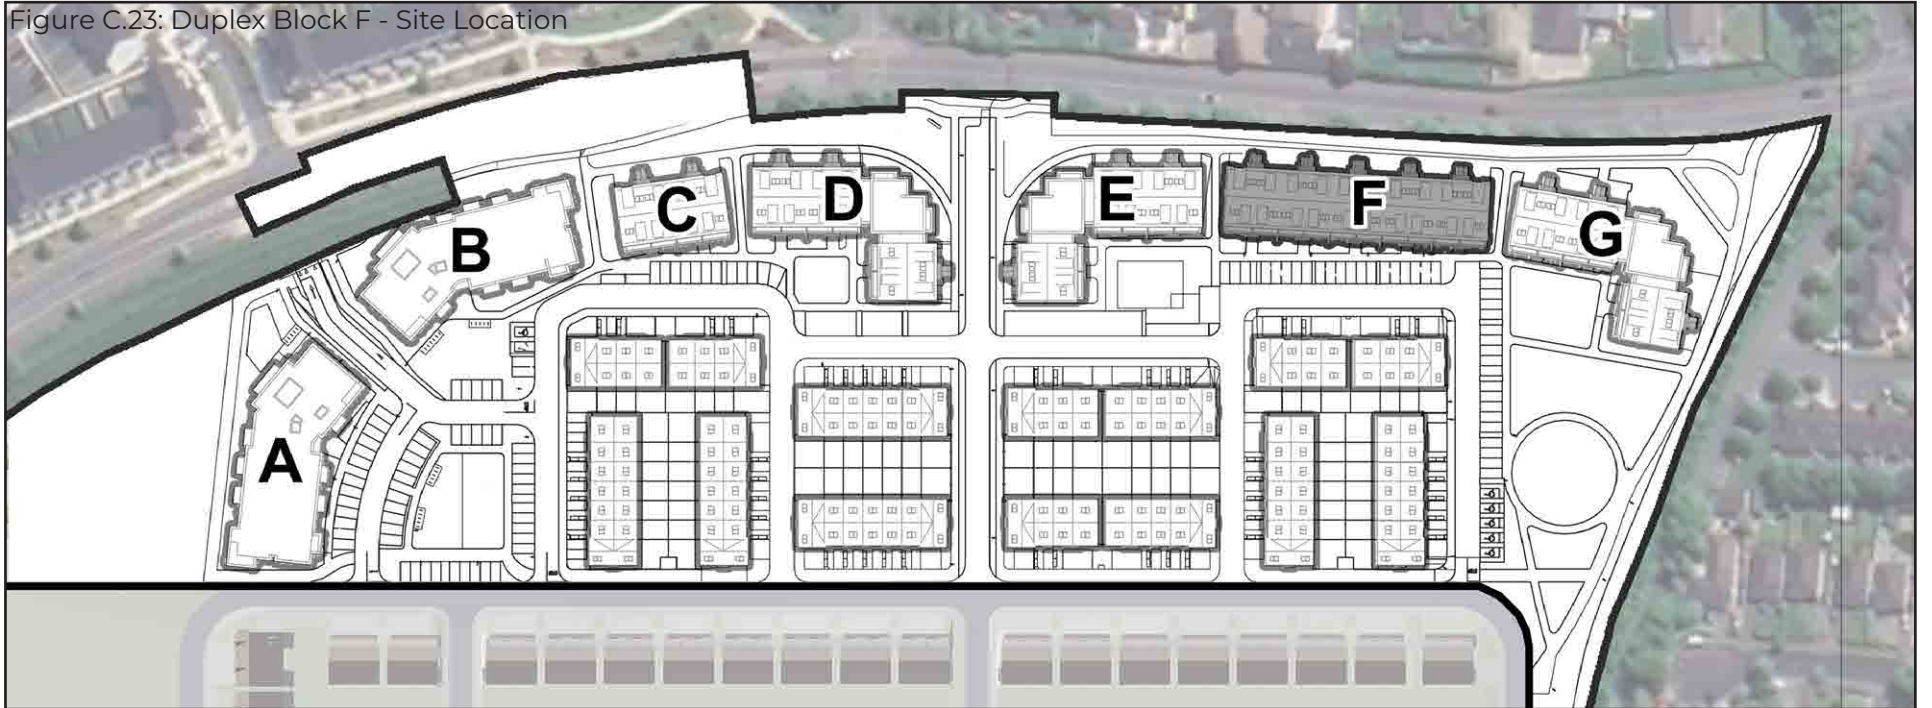


Figure C.24: Duplex Block F - Ground Floor

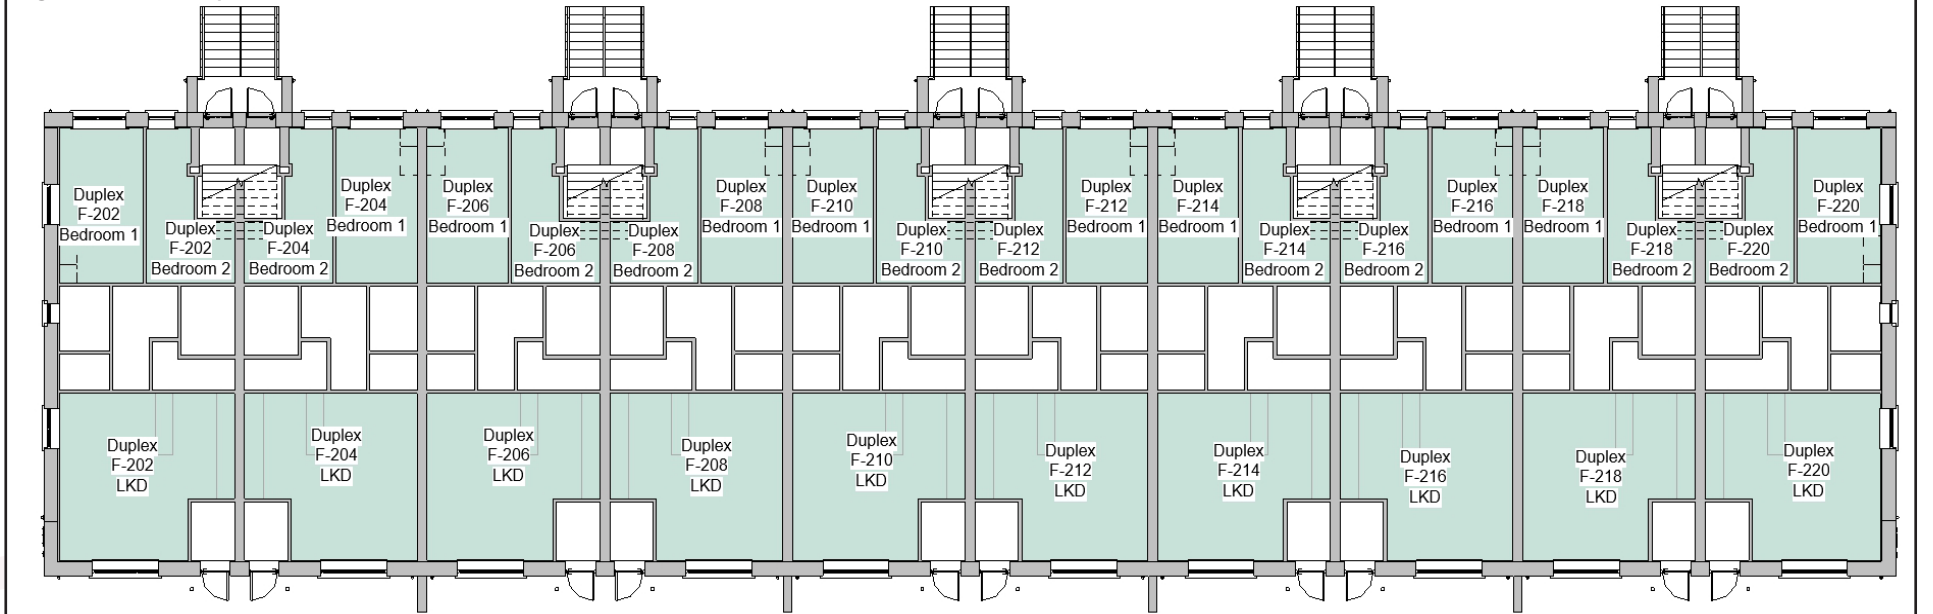


Figure C.25: Duplex Block F - First Floor


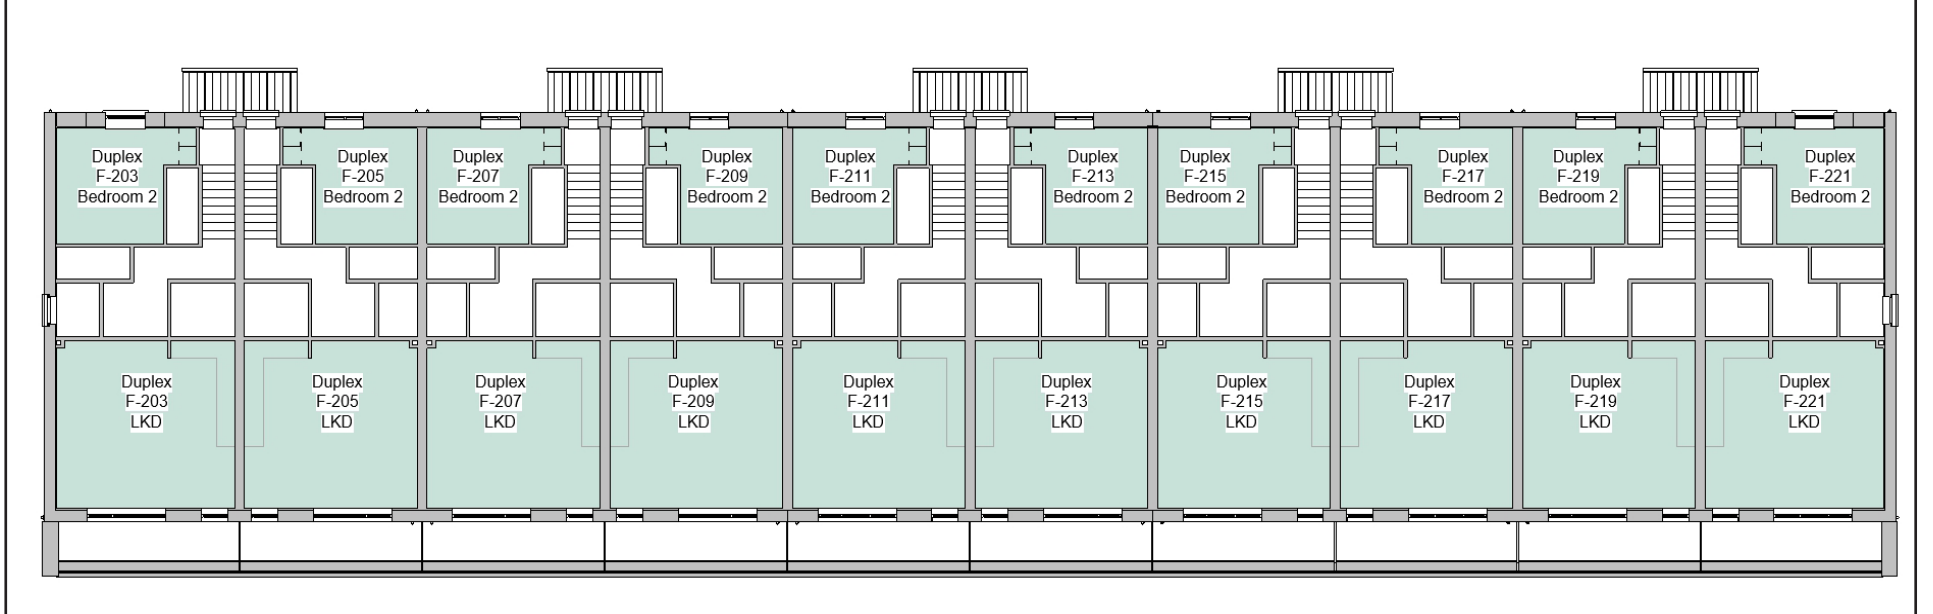


Figure C.26: Duplex Block F - Second Floor

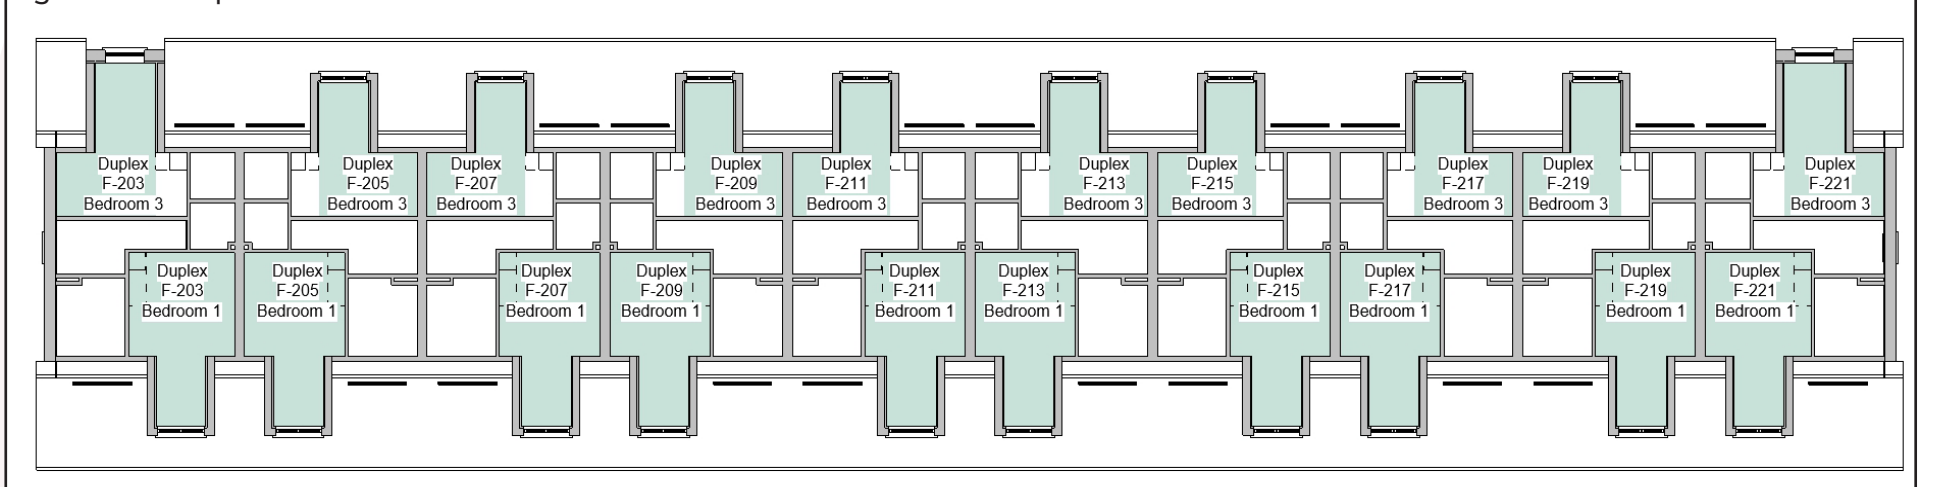

C.1.7 Proposed Duplex Floor Plans - Block G

Figure C.27: Duplex Block G - Site Location

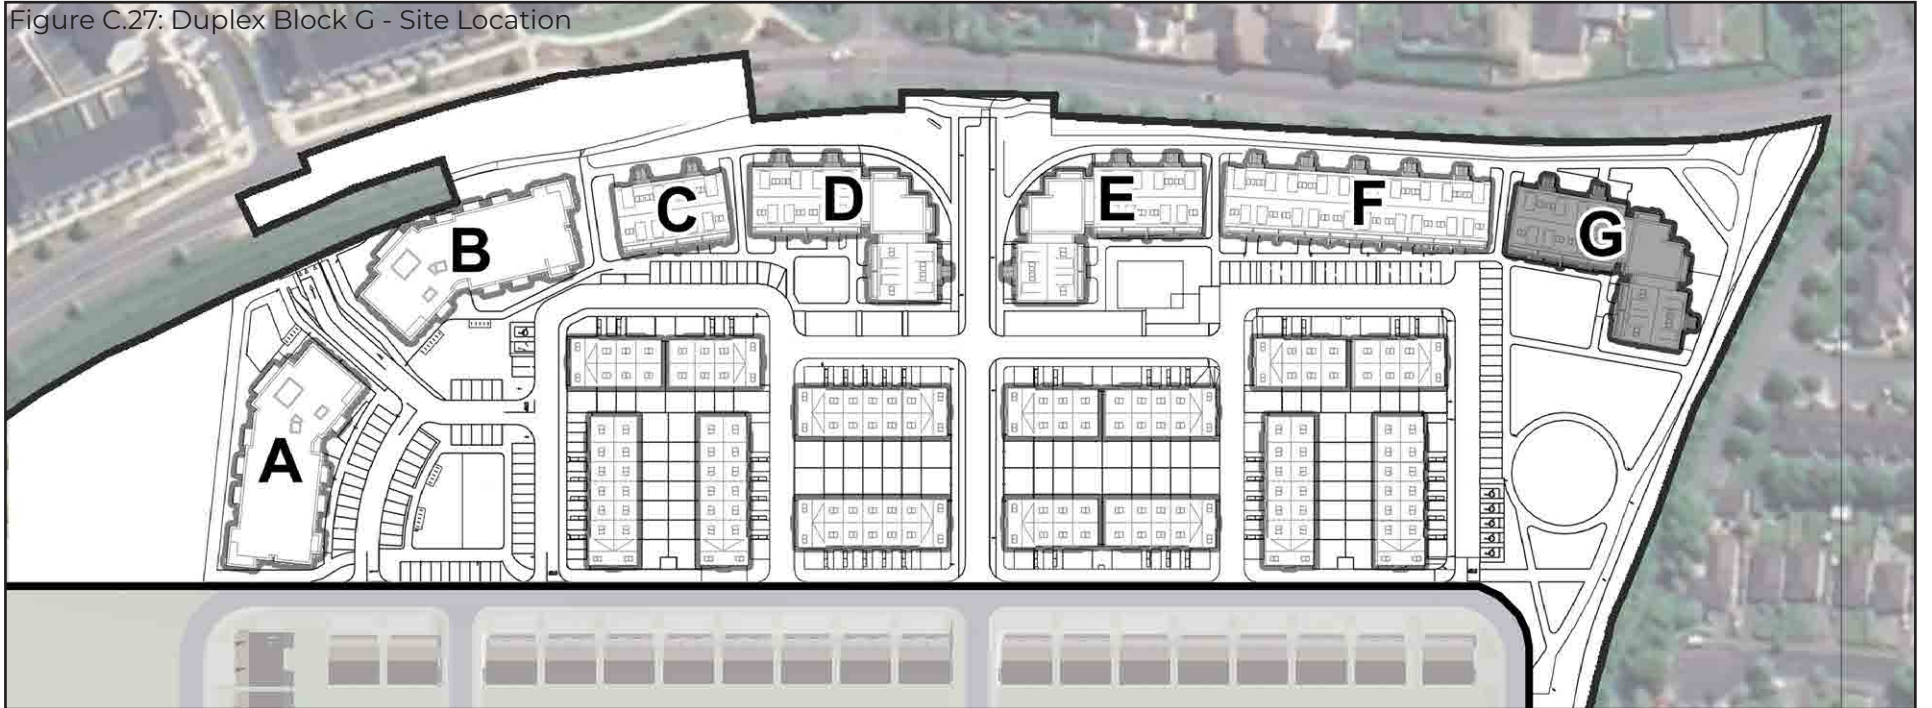


Figure C.28: Duplex Block G - Ground Floor

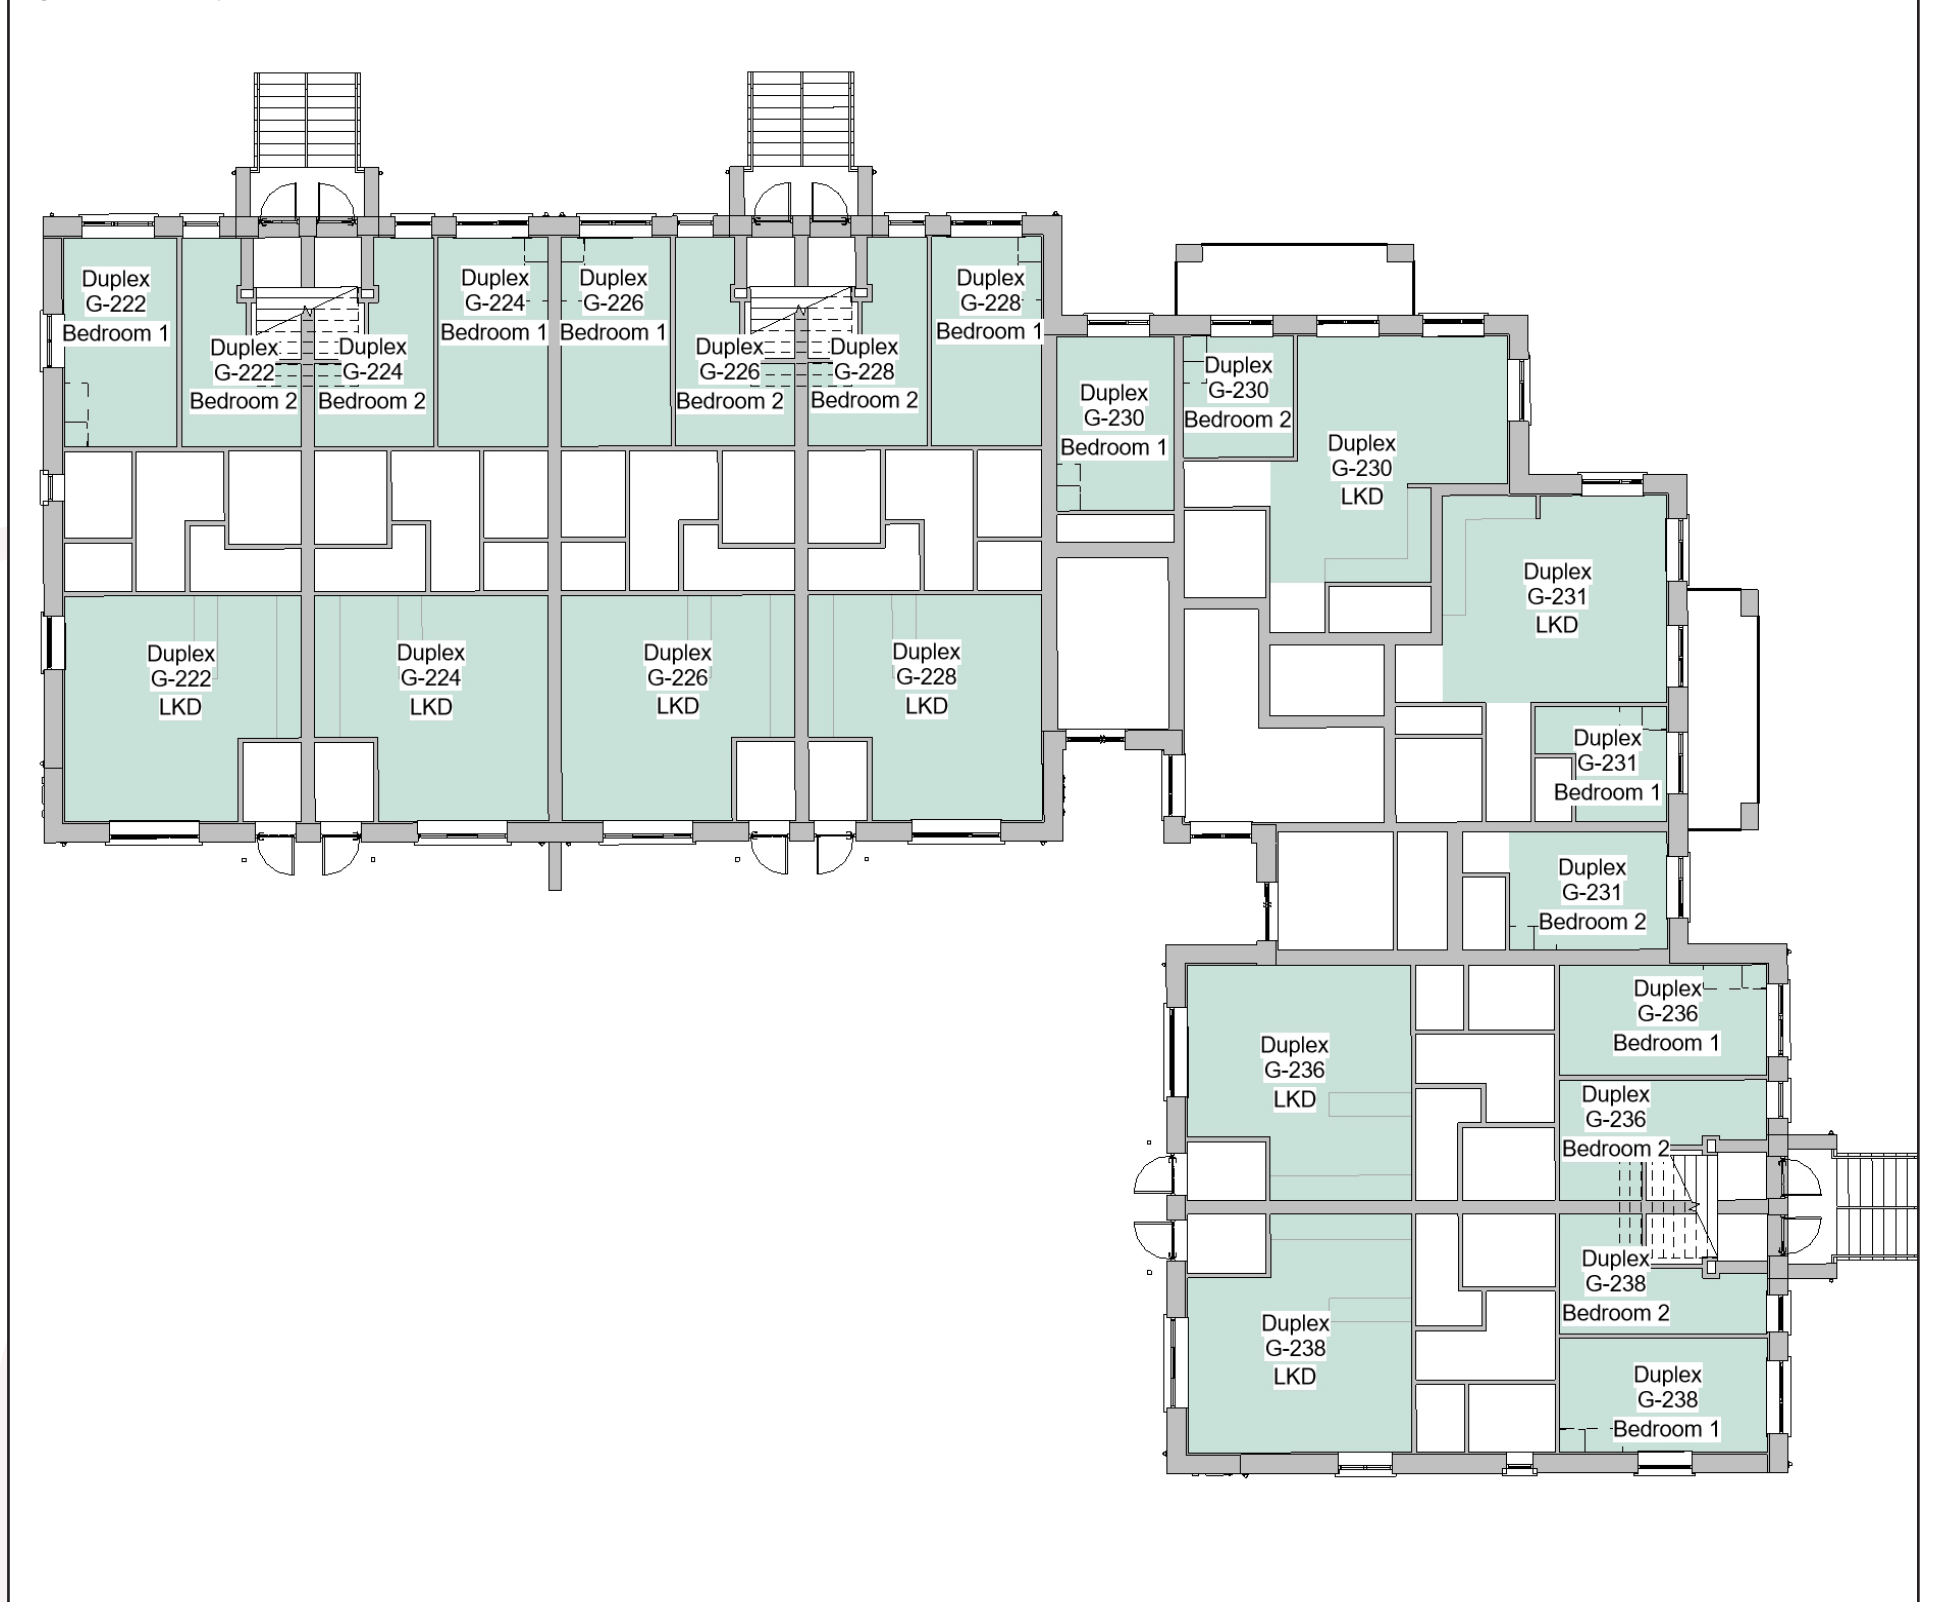


Figure C.29: Duplex Block G - First Floor



Figure C.30: Duplex Block G - Second Floor



C.2 Spatial Daylight Autonomy (SDA) in Proposed Units

Below is an example of the table used to describe the spatial daylight autonomy results in proposed units.

Table Example. C.2 - Scheme Performance SDA					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria
			Without Trees	With Trees	
A	B	C	D	E	F

A: Unit Number

This column identifies the assessed unit. All unit numbers are determined by the architect's drawings, unless otherwise stated.

B: Room Description

Room Description details which room in the unit has been assessed, e.g. bedroom, LKD, etc.

C: Target Lux

Under BR 209 the appropriate target lux levels to be achieved across 50% of the working plane of a room differ depending on the room type. Kitchens have a target lux of 200, living rooms have a target lux of 150 and bedrooms have a target lux of 100. In a room providing more than one function, such as an LKD, the higher target value should be taken i.e. 200 Lux.

D: % of area above target Lux (Without Trees)

BR 209 recommends target lux levels to be achieved across at least 50% of the working plane for at least half the daylight hours. The target values differ depending on the room function, 200 lux for Kitchens, 150 lux for Living Rooms or 100 lux for Bedrooms.

This column states percentage of the working plane of the assessed room that is capable of receiving more than the appropriate target lux for at least half the daylight hours with trees excluded from the analytical model. The figures shown in this column should be considered part of a supplementary study that helps identify if trees are having an effect on daylight within the proposed units.

E: % of area above target Lux (With Trees)

BR 209 recommends target lux levels to be achieved across at least 50% of the working plane for at least half the daylight hours. The target values differ depending on the room function, 200 lux for Kitchens, 150 lux for Living Rooms or 100 lux for Bedrooms.

This column states percentage of the working plane of the assessed room that is capable of receiving more than the appropriate target lux for at least half the daylight hours with the foliage of deciduous trees varied to account for summer and winter conditions, i.e. full leaf and bare branch.

F: Compliance with BR 209 Criteria

This column states if the assessed room achieves the recommended level of daylight as per BR 209 with consideration to the various tree states.

If the target lux level is achieved across more than 50% of the working plane, for half the daylight hours, both with and without trees, this column will state: *'Compliant'*.

If the target lux level is not achieved across more than 50% of the working plane, for half the daylight hours, both with and without trees, this column will state: *'Non-compliant'*.

If the target lux level is achieved across more than 50% of the working plane, for half the daylight hours, without trees but is not achieved with trees, this column will state: *'Trees affecting compliance'*.

Compliance rates will be stated for SDA, both with and without trees.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

C.2.1 SDA Results: Block A/Ground Floor

Table No. C.2.1 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-01	LKD	200	73%	73%	Compliant
BA-01	Bedroom 1	100	100%	100%	Compliant
BA-01	Bedroom 2	100	100%	100%	Compliant
BA-02	LKD	200	70%	69%	Compliant
BA-02	Bedroom 1	100	100%	100%	Compliant
BA-03	LKD	200	77%	76%	Compliant
BA-03	Bedroom 1	100	100%	100%	Compliant
BA-03	Bedroom 2	100	100%	100%	Compliant
BA-04	LKD	200	55%	47%	Trees affecting compliance
BA-04	Bedroom 1	100	100%	100%	Compliant
BA-04	Bedroom 2	100	100%	100%	Compliant
BA-05	LKD	200	48%	45%	Non-compliant
BA-05	Bedroom 1	100	100%	100%	Compliant
Creche	Classroom 1	200	93%	77%	Compliant
Creche	Classroom 2	200	98%	88%	Compliant
Creche	Classroom 3	200	95%	73%	Compliant
Creche	Classroom 4	200	100%	100%	Compliant

C.2.2 SDA Results: Block A/First Floor

Table No. C.2.2 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-06	LKD	200	75%	74%	Compliant
BA-06	Bedroom 1	100	100%	100%	Compliant
BA-06	Bedroom 2	100	100%	100%	Compliant
BA-07	LKD	200	71%	71%	Compliant
BA-07	Bedroom 1	100	100%	100%	Compliant
BA-08	LKD	200	78%	77%	Compliant
BA-08	Bedroom 1	100	100%	100%	Compliant
BA-08	Bedroom 2	100	100%	100%	Compliant
BA-09	LKD	200	59%	55%	Compliant
BA-09	Bedroom 1	100	100%	100%	Compliant
BA-09	Bedroom 2	100	100%	100%	Compliant
BA-10	LKD	200	50%	47%	Trees affecting compliance
BA-10	Bedroom 1	100	100%	100%	Compliant
BA-11	LKD	200	55%	54%	Compliant
BA-11	Bedroom 1	100	100%	100%	Compliant
BA-11	Bedroom 2	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.3 SDA Results: BlockA/First Floor

Table No. C.2.3 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-12	LKD	200	82%	77%	Compliant
BA-12	Bedroom 1	100	100%	100%	Compliant
BA-13	LKD	200	52%	50%	Compliant
BA-13	Bedroom 1	100	100%	100%	Compliant
BA-14	LKD	200	54%	53%	Compliant
BA-14	Bedroom 1	100	100%	100%	Compliant
BA-15	LKD	200	100%	100%	Compliant
BA-15	Bedroom 1	100	100%	100%	Compliant
BA-15	Bedroom 2	100	100%	100%	Compliant
BA-16	LKD	200	74%	73%	Compliant
BA-16	Bedroom 1	100	100%	100%	Compliant
BA-16	Bedroom 2	100	100%	100%	Compliant

C.2.4 SDA Results: BlockA/Second Floor

Table No. C.2.4 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-17	LKD	200	77%	77%	Compliant
BA-17	Bedroom 1	100	100%	100%	Compliant
BA-17	Bedroom 2	100	100%	100%	Compliant
BA-18	LKD	200	74%	73%	Compliant
BA-18	Bedroom 1	100	100%	100%	Compliant
BA-19	LKD	200	81%	79%	Compliant
BA-19	Bedroom 1	100	100%	100%	Compliant
BA-19	Bedroom 2	100	100%	100%	Compliant
BA-20	LKD	200	60%	60%	Compliant
BA-20	Bedroom 1	100	100%	100%	Compliant
BA-20	Bedroom 2	100	100%	100%	Compliant
BA-21	LKD	200	51%	51%	Compliant
BA-21	Bedroom 1	100	100%	100%	Compliant
BA-22	LKD	200	57%	57%	Compliant
BA-22	Bedroom 1	100	100%	100%	Compliant
BA-22	Bedroom 2	100	100%	100%	Compliant
BA-23	LKD	200	89%	85%	Compliant
BA-23	Bedroom 1	100	100%	100%	Compliant
BA-24	LKD	200	54%	53%	Compliant
BA-24	Bedroom 1	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.5 SDA Results: BlockA/Second Floor

Table No. C.2.5 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-25	LKD	200	56%	56%	Compliant
BA-25	Bedroom 1	100	100%	100%	Compliant
BA-26	LKD	200	100%	100%	Compliant
BA-26	Bedroom 1	100	100%	100%	Compliant
BA-26	Bedroom 2	100	100%	100%	Compliant
BA-27	LKD	200	75%	75%	Compliant
BA-27	Bedroom 1	100	100%	100%	Compliant
BA-27	Bedroom 2	100	100%	100%	Compliant

C.2.6 SDA Results: BlockA/Third Floor

Table No. C.2.6 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-28	LKD	200	79%	78%	Compliant
BA-28	Bedroom 1	100	100%	100%	Compliant
BA-28	Bedroom 2	100	100%	100%	Compliant
BA-29	LKD	200	77%	77%	Compliant
BA-29	Bedroom 1	100	100%	100%	Compliant
BA-30	LKD	200	88%	87%	Compliant
BA-30	Bedroom 1	100	100%	100%	Compliant
BA-31	LKD	200	64%	63%	Compliant
BA-31	Bedroom 1	100	100%	100%	Compliant
BA-31	Bedroom 2	100	100%	100%	Compliant
BA-32	LKD	200	53%	52%	Compliant
BA-32	Bedroom 1	100	100%	100%	Compliant
BA-32	Bedroom 2	100	100%	100%	Compliant
BA-33	LKD	200	59%	58%	Compliant
BA-33	Bedroom 1	100	100%	100%	Compliant
BA-33	Bedroom 2	100	100%	100%	Compliant
BA-34	LKD	200	93%	91%	Compliant
BA-34	Bedroom 1	100	100%	100%	Compliant
BA-35	LKD	200	55%	54%	Compliant
BA-35	Bedroom 1	100	100%	100%	Compliant
BA-36	LKD	200	58%	58%	Compliant
BA-36	Bedroom 1	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.7 SDA Results: BlockA/Third Floor

Table No. C.2.7 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BA-37	LKD	200	100%	100%	Compliant
BA-37	Bedroom 1	100	100%	100%	Compliant
BA-37	Bedroom 2	100	100%	100%	Compliant
BA-38	LKD	200	78%	78%	Compliant
BA-38	Bedroom 1	100	100%	100%	Compliant
BA-38	Bedroom 2	100	100%	100%	Compliant

C.2.8 SDA Results: BlockB/Ground Floor

Table No. C.2.8 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BB-39	LKD	200	88%	82%	Compliant
BB-39	Bedroom1	100	100%	100%	Compliant
BB-39	Bedroom2	100	100%	100%	Compliant
BB-40	LKD	200	48%	46%	Non-compliant
BB-40	Bedroom1	100	100%	100%	Compliant
BB-41	LKD	200	47%	45%	Non-compliant
BB-41	Bedroom1	100	100%	100%	Compliant
BB-42	LKD	200	80%	56%	Compliant
BB-42	Bedroom1	100	100%	100%	Compliant
BB-43	LKD	200	56%	27%	Trees affecting compliance
BB-43	Bedroom1	100	100%	100%	Compliant
BB-43	Bedroom2	100	100%	100%	Compliant
BB-44	LKD	200	52%	41%	Trees affecting compliance
BB-44	Bedroom1	100	100%	100%	Compliant
BB-45	LKD	200	56%	51%	Compliant
BB-45	Bedroom1	100	100%	100%	Compliant
BB-45	Bedroom2	100	100%	100%	Compliant
BB-46	LKD	200	61%	55%	Compliant
BB-46	Bedroom1	100	100%	100%	Compliant
BB-46	Bedroom2	100	100%	100%	Compliant
BB-47	LKD	200	51%	48%	Trees affecting compliance
BB-47	Bedroom1	100	100%	100%	Compliant
BB-48	LKD	200	60%	53%	Compliant
BB-48	Bedroom1	100	100%	100%	Compliant
BB-48	Bedroom2	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.9 SDA Results: BlockB/First Floor

Table No. C.2.9 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BB-49	LKD	200	69%	68%	Compliant
BB-49	Bedroom1	100	100%	100%	Compliant
BB-49	Bedroom2	100	100%	100%	Compliant
BB-50	LKD	200	92%	92%	Compliant
BB-50	Bedroom1	100	100%	100%	Compliant
BB-50	Bedroom2	100	100%	100%	Compliant
BB-51	LKD	200	53%	52%	Compliant
BB-51	Bedroom1	100	100%	100%	Compliant
BB-52	LKD	200	53%	53%	Compliant
BB-52	Bedroom1	100	100%	100%	Compliant
BB-53	LKD	200	96%	89%	Compliant
BB-53	Bedroom1	100	100%	100%	Compliant
BB-54	LKD	200	63%	47%	Trees affecting compliance
BB-54	Bedroom1	100	100%	100%	Compliant
BB-54	Bedroom2	100	100%	100%	Compliant
BB-55	LKD	200	58%	52%	Compliant
BB-55	Bedroom1	100	100%	100%	Compliant
BB-56	LKD	200	68%	65%	Compliant
BB-56	Bedroom1	100	100%	100%	Compliant
BB-56	Bedroom2	100	100%	100%	Compliant
BB-57	LKD	200	71%	68%	Compliant
BB-57	Bedroom1	100	100%	100%	Compliant
BB-57	Bedroom2	100	100%	100%	Compliant
BB-58	LKD	200	57%	56%	Compliant
BB-58	Bedroom1	100	100%	100%	Compliant
BB-59	LKD	200	65%	65%	Compliant
BB-59	Bedroom1	100	100%	100%	Compliant
BB-59	Bedroom2	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.10 SDA Results: BlockB/Second Floor

Table No. C.2.10 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BB-60	LKD	200	74%	74%	Compliant
BB-60	Bedroom1	100	100%	100%	Compliant
BB-60	Bedroom2	100	100%	100%	Compliant
BB-61	LKD	200	99%	98%	Compliant
BB-61	Bedroom1	100	100%	100%	Compliant
BB-61	Bedroom2	100	100%	100%	Compliant
BB-62	LKD	200	55%	55%	Compliant
BB-62	Bedroom1	100	100%	100%	Compliant
BB-63	LKD	200	56%	56%	Compliant
BB-63	Bedroom1	100	100%	100%	Compliant
BB-64	LKD	200	98%	97%	Compliant
BB-64	Bedroom1	100	100%	100%	Compliant
BB-65	LKD	200	67%	64%	Compliant
BB-65	Bedroom1	100	100%	100%	Compliant
BB-65	Bedroom2	100	100%	100%	Compliant
BB-66	LKD	200	62%	60%	Compliant
BB-66	Bedroom1	100	100%	100%	Compliant
BB-67	LKD	200	71%	71%	Compliant
BB-67	Bedroom1	100	100%	100%	Compliant
BB-67	Bedroom2	100	100%	100%	Compliant
BB-68	LKD	200	75%	75%	Compliant
BB-68	Bedroom1	100	100%	100%	Compliant
BB-68	Bedroom2	100	100%	100%	Compliant
BB-69	LKD	200	61%	61%	Compliant
BB-69	Bedroom1	100	100%	100%	Compliant
BB-70	LKD	200	68%	68%	Compliant
BB-70	Bedroom1	100	100%	100%	Compliant
BB-70	Bedroom2	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.11 SDA Results: BlockB/Third Floor

Table No. C.2.11 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
BB-71	LKD	200	78%	78%	Compliant
BB-71	Bedroom1	100	100%	100%	Compliant
BB-71	Bedroom2	100	100%	100%	Compliant
BB-72	LKD	200	100%	100%	Compliant
BB-72	Bedroom1	100	100%	100%	Compliant
BB-72	Bedroom2	100	100%	100%	Compliant
BB-73	LKD	200	57%	57%	Compliant
BB-73	Bedroom1	100	100%	100%	Compliant
BB-74	LKD	200	57%	57%	Compliant
BB-74	Bedroom1	100	100%	100%	Compliant
BB-75	LKD	200	99%	99%	Compliant
BB-75	Bedroom1	100	100%	100%	Compliant
BB-76	LKD	200	68%	67%	Compliant
BB-76	Bedroom1	100	100%	100%	Compliant
BB-76	Bedroom2	100	100%	100%	Compliant
BB-77	LKD	200	64%	63%	Compliant
BB-77	Bedroom1	100	100%	100%	Compliant
BB-78	LKD	200	73%	72%	Compliant
BB-78	Bedroom1	100	100%	100%	Compliant
BB-78	Bedroom2	100	100%	100%	Compliant
BB-79	LKD	200	78%	78%	Compliant
BB-79	Bedroom1	100	100%	100%	Compliant
BB-79	Bedroom2	100	100%	100%	Compliant
BB-80	LKD	200	64%	64%	Compliant
BB-80	Bedroom1	100	100%	100%	Compliant
BB-81	LKD	200	72%	71%	Compliant
BB-81	Bedroom1	100	100%	100%	Compliant
BB-81	Bedroom2	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.12 SDA Results: Duplex Block C/Ground Floor

Table No. C.2.12 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex C-104	LKD	200	91%	77%	Compliant
Duplex C-104	Bedroom 1	100	100%	100%	Compliant
Duplex C-104	Bedroom 2	100	47%	44%	Non-compliant
Duplex C-106	LKD	200	72%	65%	Compliant
Duplex C-106	Bedroom 1	100	100%	100%	Compliant
Duplex C-106	Bedroom 2	100	58%	48%	Trees affecting compliance
Duplex C-108	LKD	200	70%	61%	Compliant
Duplex C-108	Bedroom 1	100	100%	100%	Compliant
Duplex C-108	Bedroom 2	100	47%	45%	Non-compliant
Duplex C-110	LKD	200	94%	90%	Compliant
Duplex C-110	Bedroom 1	100	100%	100%	Compliant
Duplex C-110	Bedroom 2	100	58%	52%	Compliant

C.2.13 SDA Results: Duplex Block C/First Floor

Table No. C.2.13 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex C-105	LKD	200	100%	100%	Compliant
Duplex C-105	Bedroom 1	100	98%	98%	Compliant
Duplex C-107	LKD	200	100%	100%	Compliant
Duplex C-107	Bedroom 1	100	98%	98%	Compliant
Duplex C-109	LKD	200	100%	100%	Compliant
Duplex C-109	Bedroom 1	100	98%	98%	Compliant
Duplex C-111	LKD	200	100%	100%	Compliant
Duplex C-111	Bedroom 1	100	98%	98%	Compliant

C.2.14 SDA Results: Duplex Block C/Second Floor

Table No. C.2.14 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex C-105	Bedroom 2	100	96%	92%	Compliant
Duplex C-105	Bedroom 3	100	91%	89%	Compliant
Duplex C-107	Bedroom 2	100	95%	94%	Compliant
Duplex C-107	Bedroom 3	100	78%	77%	Compliant
Duplex C-109	Bedroom 2	100	95%	94%	Compliant
Duplex C-109	Bedroom 3	100	83%	82%	Compliant
Duplex C-111	Bedroom 2	100	93%	91%	Compliant
Duplex C-111	Bedroom 3	100	88%	87%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.15 SDA Results: Duplex Block D/Ground Floor

Table No. C.2.15 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex D-112	LKD	200	86%	83%	Compliant
Duplex D-112	Bedroom 1	100	100%	100%	Compliant
Duplex D-112	Bedroom 2	100	48%	38%	Non-compliant
Duplex D-114	LKD	200	61%	55%	Compliant
Duplex D-114	Bedroom 1	100	100%	100%	Compliant
Duplex D-114	Bedroom 2	100	63%	52%	Compliant
Duplex D-116	LKD	200	55%	52%	Compliant
Duplex D-116	Bedroom 1	100	100%	100%	Compliant
Duplex D-116	Bedroom 2	100	50%	45%	Trees affecting compliance
Duplex D-118	LKD	200	50%	47%	Trees affecting compliance
Duplex D-118	Bedroom 1	100	100%	100%	Compliant
Duplex D-118	Bedroom 2	100	66%	56%	Compliant
Duplex D-120	LKD	200	95%	76%	Compliant
Duplex D-120	Bedroom 1	100	100%	100%	Compliant
Duplex D-120	Bedroom 2	100	100%	100%	Compliant
Duplex D-121	LKD	200	100%	92%	Compliant
Duplex D-121	Bedroom 1	100	100%	100%	Compliant
Duplex D-121	Bedroom 2	100	100%	100%	Compliant
Duplex D-126	LKD	200	37%	37%	Non-compliant
Duplex D-126	Bedroom 1	100	100%	100%	Compliant
Duplex D-126	Bedroom 2	100	42%	40%	Non-compliant
Duplex D-128	LKD	200	85%	80%	Compliant
Duplex D-128	Bedroom 1	100	100%	100%	Compliant
Duplex D-128	Bedroom 2	100	52%	43%	Trees affecting compliance

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
 ** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.
 *** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.
 The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.16 SDA Results: Duplex Block D/First Floor

Table No. C.2.16 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex D-113	LKD	200	100%	100%	Compliant
Duplex D-113	Bedroom 1	100	100%	100%	Compliant
Duplex D-115	LKD	200	100%	99%	Compliant
Duplex D-115	Bedroom 1	100	100%	100%	Compliant
Duplex D-117	LKD	200	100%	98%	Compliant
Duplex D-117	Bedroom 1	100	100%	100%	Compliant
Duplex D-119	LKD	200	90%	89%	Compliant
Duplex D-119	Bedroom 1	100	100%	100%	Compliant
Duplex D-122	LKD	200	100%	97%	Compliant
Duplex D-122	Bedroom 1	100	100%	100%	Compliant
Duplex D-123	LKD	200	100%	100%	Compliant
Duplex D-123	Bedroom 1	100	100%	100%	Compliant
Duplex D-127	LKD	200	64%	63%	Compliant
Duplex D-127	Bedroom 1	100	100%	100%	Compliant
Duplex D-129	LKD	200	67%	67%	Compliant
Duplex D-129	Bedroom 1	100	100%	100%	Compliant

C.2.17 SDA Results: Duplex Block D/Second Floor

Table No. C.2.17 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex D-113	Bedroom 2	100	83%	81%	Compliant
Duplex D-113	Bedroom 3	100	83%	83%	Compliant
Duplex D-115	Bedroom 2	100	88%	84%	Compliant
Duplex D-115	Bedroom 3	100	80%	78%	Compliant
Duplex D-117	Bedroom 2	100	81%	79%	Compliant
Duplex D-117	Bedroom 3	100	83%	83%	Compliant
Duplex D-119	Bedroom 2	100	80%	73%	Compliant
Duplex D-119	Bedroom 3	100	80%	80%	Compliant
Duplex D-124	LKD	200	100%	100%	Compliant
Duplex D-124	Bedroom 1	100	100%	100%	Compliant
Duplex D-125	LKD	200	100%	100%	Compliant
Duplex D-125	Bedroom 1	100	100%	100%	Compliant
Duplex D-127	Bedroom 2	100	38%	37%	Non-compliant
Duplex D-127	Bedroom 3	100	86%	86%	Compliant
Duplex D-129	Bedroom 2	100	40%	39%	Non-compliant
Duplex D-129	Bedroom 3	100	86%	86%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.18 SDA Results: Duplex Block E/Ground Floor

Table No. C.2.18 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex E-184	LKD	200	100%	99%	Compliant
Duplex E-184	Bedroom 1	100	100%	100%	Compliant
Duplex E-184	Bedroom 2	100	37%	32%	Non-compliant
Duplex E-186	LKD	200	75%	72%	Compliant
Duplex E-186	Bedroom 1	100	100%	100%	Compliant
Duplex E-186	Bedroom 2	100	35%	30%	Non-compliant
Duplex E-188	LKD	200	72%	66%	Compliant
Duplex E-188	Bedroom 1	100	100%	95%	Compliant
Duplex E-188	Bedroom 2	100	100%	100%	Compliant
Duplex E-189	LKD	200	99%	87%	Compliant
Duplex E-189	Bedroom 1	100	100%	100%	Compliant
Duplex E-189	Bedroom 2	100	100%	100%	Compliant
Duplex E-194	LKD	200	63%	60%	Compliant
Duplex E-194	Bedroom 1	100	100%	100%	Compliant
Duplex E-194	Bedroom 2	100	52%	48%	Trees affecting compliance
Duplex E-196	LKD	200	64%	61%	Compliant
Duplex E-196	Bedroom 1	100	100%	100%	Compliant
Duplex E-196	Bedroom 2	100	70%	68%	Compliant
Duplex E-198	LKD	200	64%	59%	Compliant
Duplex E-198	Bedroom 1	100	100%	100%	Compliant
Duplex E-198	Bedroom 2	100	52%	52%	Compliant
Duplex E-200	LKD	200	86%	82%	Compliant
Duplex E-200	Bedroom 1	100	100%	100%	Compliant
Duplex E-200	Bedroom 2	100	72%	72%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
 ** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.
 *** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.
 The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.19 SDA Results: Duplex Block E/First Floor

Table No. C.2.19 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex E-185	LKD	200	100%	100%	Compliant
Duplex E-185	Bedroom 1	100	100%	99%	Compliant
Duplex E-187	LKD	200	100%	100%	Compliant
Duplex E-187	Bedroom 1	100	100%	98%	Compliant
Duplex E-190	LKD	200	83%	80%	Compliant
Duplex E-190	Bedroom 1	100	100%	100%	Compliant
Duplex E-191	LKD	200	100%	100%	Compliant
Duplex E-191	Bedroom 1	100	100%	100%	Compliant
Duplex E-195	LKD	200	100%	100%	Compliant
Duplex E-195	Bedroom 1	100	100%	100%	Compliant
Duplex E-197	LKD	200	100%	100%	Compliant
Duplex E-197	Bedroom 1	100	100%	100%	Compliant
Duplex E-199	LKD	200	100%	100%	Compliant
Duplex E-199	Bedroom 1	100	100%	100%	Compliant
Duplex E-201	LKD	200	100%	100%	Compliant
Duplex E-201	Bedroom 1	100	100%	100%	Compliant

C.2.20 SDA Results: Duplex Block E/Second Floor

Table No. C.2.20 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex E-185	Bedroom 2	100	96%	96%	Compliant
Duplex E-185	Bedroom 3	100	74%	74%	Compliant
Duplex E-187	Bedroom 2	100	97%	97%	Compliant
Duplex E-187	Bedroom 3	100	71%	71%	Compliant
Duplex E-192	LKD	200	89%	87%	Compliant
Duplex E-192	Bedroom 1	100	100%	100%	Compliant
Duplex E-193	LKD	200	100%	100%	Compliant
Duplex E-193	Bedroom 1	100	100%	100%	Compliant
Duplex E-195	Bedroom 2	100	86%	83%	Compliant
Duplex E-195	Bedroom 3	100	86%	84%	Compliant
Duplex E-197	Bedroom 2	100	86%	85%	Compliant
Duplex E-197	Bedroom 3	100	81%	81%	Compliant
Duplex E-199	Bedroom 2	100	83%	81%	Compliant
Duplex E-199	Bedroom 3	100	84%	84%	Compliant
Duplex E-201	Bedroom 2	100	83%	81%	Compliant
Duplex E-201	Bedroom 3	100	86%	84%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.21 SDA Results: Duplex Block F/Ground Floor

Table No. C.2.21 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex F-202	LKD	200	88%	86%	Compliant
Duplex F-202	Bedroom 1	100	100%	100%	Compliant
Duplex F-202	Bedroom 2	100	60%	53%	Compliant
Duplex F-204	LKD	200	63%	58%	Compliant
Duplex F-204	Bedroom 1	100	100%	100%	Compliant
Duplex F-204	Bedroom 2	100	77%	73%	Compliant
Duplex F-206	LKD	200	58%	53%	Compliant
Duplex F-206	Bedroom 1	100	100%	100%	Compliant
Duplex F-206	Bedroom 2	100	58%	58%	Compliant
Duplex F-208	LKD	200	56%	47%	Trees affecting compliance
Duplex F-208	Bedroom 1	100	100%	100%	Compliant
Duplex F-208	Bedroom 2	100	73%	70%	Compliant
Duplex F-210	LKD	200	56%	51%	Compliant
Duplex F-210	Bedroom 1	100	100%	100%	Compliant
Duplex F-210	Bedroom 2	100	60%	52%	Compliant
Duplex F-212	LKD	200	58%	49%	Trees affecting compliance
Duplex F-212	Bedroom 1	100	100%	100%	Compliant
Duplex F-212	Bedroom 2	100	78%	77%	Compliant
Duplex F-214	LKD	200	59%	50%	Compliant
Duplex F-214	Bedroom 1	100	100%	100%	Compliant
Duplex F-214	Bedroom 2	100	60%	58%	Compliant
Duplex F-216	LKD	200	61%	54%	Compliant
Duplex F-216	Bedroom 1	100	100%	100%	Compliant
Duplex F-216	Bedroom 2	100	75%	73%	Compliant
Duplex F-218	LKD	200	71%	50%	Compliant
Duplex F-218	Bedroom 1	100	100%	100%	Compliant
Duplex F-218	Bedroom 2	100	60%	60%	Compliant
Duplex F-220	LKD	200	95%	88%	Compliant
Duplex F-220	Bedroom 1	100	100%	100%	Compliant
Duplex F-220	Bedroom 2	100	80%	78%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
 ** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.
 *** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.
 The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.22 SDA Results: Duplex Block F/First Floor

Table No. C.2.22 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex F-203	LKD	200	100%	100%	Compliant
Duplex F-203	Bedroom 1	100	100%	100%	Compliant
Duplex F-205	LKD	200	100%	100%	Compliant
Duplex F-205	Bedroom 1	100	100%	100%	Compliant
Duplex F-207	LKD	200	100%	100%	Compliant
Duplex F-207	Bedroom 1	100	100%	100%	Compliant
Duplex F-209	LKD	200	100%	99%	Compliant
Duplex F-209	Bedroom 1	100	100%	100%	Compliant
Duplex F-211	LKD	200	100%	99%	Compliant
Duplex F-211	Bedroom 1	100	100%	100%	Compliant
Duplex F-213	LKD	200	100%	98%	Compliant
Duplex F-213	Bedroom 1	100	100%	100%	Compliant
Duplex F-215	LKD	200	100%	99%	Compliant
Duplex F-215	Bedroom 1	100	100%	100%	Compliant
Duplex F-217	LKD	200	100%	100%	Compliant
Duplex F-217	Bedroom 1	100	100%	100%	Compliant
Duplex F-219	LKD	200	100%	98%	Compliant
Duplex F-219	Bedroom 1	100	100%	100%	Compliant
Duplex F-221	LKD	200	100%	99%	Compliant
Duplex F-221	Bedroom 1	100	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.23 SDA Results: Duplex Block F/Second Floor

Table No. C.2.23 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex F-203	Bedroom 2	100	82%	80%	Compliant
Duplex F-203	Bedroom 3	100	92%	91%	Compliant
Duplex F-205	Bedroom 2	100	84%	81%	Compliant
Duplex F-205	Bedroom 3	100	81%	81%	Compliant
Duplex F-207	Bedroom 2	100	87%	84%	Compliant
Duplex F-207	Bedroom 3	100	86%	86%	Compliant
Duplex F-209	Bedroom 2	100	89%	85%	Compliant
Duplex F-209	Bedroom 3	100	81%	81%	Compliant
Duplex F-211	Bedroom 2	100	84%	84%	Compliant
Duplex F-211	Bedroom 3	100	84%	84%	Compliant
Duplex F-213	Bedroom 2	100	88%	83%	Compliant
Duplex F-213	Bedroom 3	100	81%	81%	Compliant
Duplex F-215	Bedroom 2	100	84%	81%	Compliant
Duplex F-215	Bedroom 3	100	84%	84%	Compliant
Duplex F-217	Bedroom 2	100	88%	84%	Compliant
Duplex F-217	Bedroom 3	100	81%	81%	Compliant
Duplex F-219	Bedroom 2	100	83%	81%	Compliant
Duplex F-219	Bedroom 3	100	84%	84%	Compliant
Duplex F-221	Bedroom 2	100	82%	79%	Compliant
Duplex F-221	Bedroom 3	100	94%	94%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.24 SDA Results: Duplex Block G/Ground Floor

Table No. C.2.24 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex G-222	LKD	200	91%	87%	Compliant
Duplex G-222	Bedroom 1	100	100%	100%	Compliant
Duplex G-222	Bedroom 2	100	66%	62%	Compliant
Duplex G-224	LKD	200	65%	58%	Compliant
Duplex G-224	Bedroom 1	100	100%	100%	Compliant
Duplex G-224	Bedroom 2	100	78%	73%	Compliant
Duplex G-226	LKD	200	60%	53%	Compliant
Duplex G-226	Bedroom 1	100	100%	100%	Compliant
Duplex G-226	Bedroom 2	100	59%	53%	Compliant
Duplex G-228	LKD	200	51%	48%	Trees affecting compliance
Duplex G-228	Bedroom 1	100	100%	100%	Compliant
Duplex G-228	Bedroom 2	100	77%	72%	Compliant
Duplex G-230	LKD	200	100%	80%	Compliant
Duplex G-230	Bedroom 1	100	100%	100%	Compliant
Duplex G-230	Bedroom 2	100	100%	100%	Compliant
Duplex G-231	LKD	200	100%	100%	Compliant
Duplex G-231	Bedroom 1	100	100%	100%	Compliant
Duplex G-231	Bedroom 2	100	100%	100%	Compliant
Duplex G-236	LKD	200	38%	37%	Non-compliant
Duplex G-236	Bedroom 1	100	100%	100%	Compliant
Duplex G-236	Bedroom 2	100	79%	77%	Compliant
Duplex G-238	LKD	200	97%	87%	Compliant
Duplex G-238	Bedroom 1	100	100%	100%	Compliant
Duplex G-238	Bedroom 2	100	85%	84%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
 ** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.
 *** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.
 The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.2.25 SDA Results: Duplex Block G/First Floor

Table No. C.2.25 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex G-223	LKD	200	100%	99%	Compliant
Duplex G-223	Bedroom 1	100	100%	100%	Compliant
Duplex G-225	LKD	200	100%	98%	Compliant
Duplex G-225	Bedroom 1	100	100%	100%	Compliant
Duplex G-227	LKD	200	99%	97%	Compliant
Duplex G-227	Bedroom 1	100	100%	100%	Compliant
Duplex G-229	LKD	200	89%	87%	Compliant
Duplex G-229	Bedroom 1	100	100%	100%	Compliant
Duplex G-232	LKD	200	100%	100%	Compliant
Duplex G-232	Bedroom 1	100	100%	100%	Compliant
Duplex G-233	LKD	200	100%	100%	Compliant
Duplex G-233	Bedroom 1	100	100%	100%	Compliant
Duplex G-237	LKD	200	63%	63%	Compliant
Duplex G-237	Bedroom 1	100	100%	100%	Compliant
Duplex G-239	LKD	200	70%	69%	Compliant
Duplex G-239	Bedroom 1	100	100%	100%	Compliant

C.2.26 SDA Results: Duplex Block G/Second Floor

Table No. C.2.26 - SDA Results:					
Unit Number	Room Description	Target Lux*	% of area above target Lux* (recommendation >50%)		Compliance with BR 209 Criteria*
			Without Trees***	With Trees**	
Duplex G-223	Bedroom 2	100	71%	67%	Compliant
Duplex G-223	Bedroom 3	100	86%	86%	Compliant
Duplex G-225	Bedroom 2	100	73%	71%	Compliant
Duplex G-225	Bedroom 3	100	81%	81%	Compliant
Duplex G-227	Bedroom 2	100	73%	61%	Compliant
Duplex G-227	Bedroom 3	100	86%	86%	Compliant
Duplex G-229	Bedroom 2	100	64%	60%	Compliant
Duplex G-229	Bedroom 3	100	81%	81%	Compliant
Duplex G-234	LKD	200	100%	100%	Compliant
Duplex G-234	Bedroom 1	100	100%	100%	Compliant
Duplex G-235	LKD	200	100%	100%	Compliant
Duplex G-235	Bedroom 1	100	100%	100%	Compliant
Duplex G-237	Bedroom 2	100	38%	37%	Non-compliant
Duplex G-237	Bedroom 3	100	94%	92%	Compliant
Duplex G-239	Bedroom 2	100	39%	39%	Non-compliant
Duplex G-239	Bedroom 3	100	96%	95%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.

** Under the BR 209 study the SDA has been calculated with indicative trees represented accounting for annual foliage.

*** The SDA assessment without trees indicates the level of daylight within the proposed development when trees are not included in the analytical model. This study provides an understanding of how trees affect daylight within the proposed development.

The SDA circa compliance rates across the entire scheme can be found in section 3.2.1 on page 19.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.3 Sunlight Exposure (SE) in Proposed Units

Below is an example of the table used to describe the SE performance of proposed habitable rooms.

Table Example. C.3 - Scheme Performance Sunlight Exposure							
Unit Number	Room Description	Deciduous Trees as Opaque Objects			Without Deciduous Trees		
		SE Hours on March 21st	Level of SE on March 21st	Unit compliance based on highest performing room	SE Hours on March 21st	Level of SE on March 21st	Unit compliance based on highest performing room
A	B	C	D	E	F	G	H

A: Unit Number

This column identifies the assessed unit. All unit numbers are determined by the architect's drawings, unless otherwise stated.

B: Room Description

Room Description details which room of the unit has been assessed, e.g. bedroom, living room, etc.

C: SE Hours on March 21st (Deciduous Trees as Opaque Objects)

This column will state the number of hours the assessed room can expect to receive on March 21st with the assessment carried out with deciduous trees as opaque objects.

D: Level of SE on March 21st (Deciduous Trees as Opaque Objects)

BR 209 recommends a minimum sunlight exposure of 1.5 hours for a proposed unit with preference given to main living rooms. BR 209 categorise sunlight exposure as minimum, medium and high, this column will categorise the level of sunlight exposure with deciduous trees as opaque objects based on the following:

- Less than 1.5 hours: *Below minimum*,
- Between 1.5 hours and 3 hours: *Minimum*
- Between 3 hours and 4 hours: *Medium*
- More than 4 hours: *High*

E: Unit compliance based on highest performing room (Deciduous Trees as Opaque Objects)

A proposed unit is considered to be compliant provided any habitable room within the unit is capable of receiving at least 1.5 hours of sunlight on the assessment date. This column will identify the highest performing room within a unit and state compliance for the associated unit based on that room with the assessment carried out with deciduous trees as opaque objects.

Typically unit compliance will be stated for the best performing room per unit only, with lesser performing rooms indicated with a dash (-).

F: SE Hours on March 21st (Without Deciduous Trees)

This column will state the number of hours the assessed room can expect to receive on March 21st with the assessment carried out without deciduous trees.

G: Level of SE on March 21st (Without Deciduous Trees)

BR 209 recommends a minimum sunlight exposure of 1.5 hours for a proposed unit with preference given to main living rooms. BR 209 categorise sunlight exposure as minimum, medium and high, this column will categorise the level of sunlight exposure without deciduous trees using the same criteria as the study with deciduous trees as opaque objects.

H: Unit compliance based on highest performing room (Without Deciduous Trees)

A proposed unit is considered to be compliant provided any habitable room within the unit is capable of receiving at least 1.5 hours of sunlight on March 21st. This column will identify the highest performing room within a unit and state compliance for the associated unit based on that room with the assessment carried out without deciduous trees. Typically only one room per unit will be populated in this column, with lesser performing rooms indicated with a dash (-).

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

C.3.1 SE Results: Block A/Ground Floor

Table No. C.3.1 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BA-01	LKD	8.10	High	Compliant	8.10	High	Compliant
BA-01	Bedroom 1	7.60	High	-	7.60	High	-
BA-01	Bedroom 2	6.50	High	-	6.50	High	-
BA-02	LKD	8.20	High	Compliant	8.20	High	Compliant
BA-02	Bedroom 1	6.30	High	-	6.30	High	-
BA-03	LKD	5.00	High	Compliant	5.00	High	Compliant
BA-03	Bedroom 1	4.80	High	-	4.80	High	-
BA-03	Bedroom 2	5.00	High	-	5.00	High	-
BA-04	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-04	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-04	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-05	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-05	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-

C.3.2 SE Results: Block A/First Floor

Table No. C.3.2 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BA-06	LKD	6.00	High	-	6.00	High	-
BA-06	Bedroom 1	7.60	High	Compliant	7.60	High	Compliant
BA-06	Bedroom 2	5.90	High	-	5.90	High	-
BA-07	LKD	6.60	High	Compliant	6.60	High	Compliant
BA-07	Bedroom 1	5.60	High	-	5.60	High	-
BA-08	LKD	3.20	Medium	-	3.20	Medium	-
BA-08	Bedroom 1	5.60	High	Compliant	5.60	High	Compliant
BA-08	Bedroom 2	5.00	High	-	5.00	High	-
BA-09	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-09	Bedroom 1	0.50	Below Minimum	Non-Compliant	0.50	Below Minimum	Non-Compliant
BA-09	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-10	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-10	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-11	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-11	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-11	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-12	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-12	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-13	LKD	0.20	Below Minimum	-	0.20	Below Minimum	-
BA-13	Bedroom 1	0.30	Below Minimum	Non-Compliant	0.30	Below Minimum	Non-Compliant

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. C.3.2 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BA-14	LKD	0.90	Below Minimum	-	0.90	Below Minimum	-
BA-14	Bedroom 1	2.10	Minimum	Compliant	2.10	Minimum	Compliant
BA-15	LKD	5.90	High	Compliant	6.60	High	Compliant
BA-15	Bedroom 1	0.40	Below Minimum	-	0.40	Below Minimum	-
BA-15	Bedroom 2	5.50	High	-	5.50	High	-
BA-16	LKD	4.00	High	-	4.20	High	-
BA-16	Bedroom 1	6.20	High	Compliant	6.20	High	Compliant
BA-16	Bedroom 2	5.10	High	-	5.60	High	-

C.3.3 SE Results: Block A/Second Floor

Table No. C.3.3 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BA-17	LKD	8.60	High	Compliant	8.60	High	-
BA-17	Bedroom 1	7.50	High	-	9.40	High	Compliant
BA-17	Bedroom 2	8.10	High	-	8.10	High	-
BA-18	LKD	5.70	High	Compliant	5.70	High	Compliant
BA-18	Bedroom 1	4.90	High	-	5.50	High	-
BA-19	LKD	6.20	High	Compliant	8.20	High	-
BA-19	Bedroom 1	4.80	High	-	9.10	High	Compliant
BA-19	Bedroom 2	1.30	Below Minimum	-	4.20	High	-
BA-20	LKD	7.00	High	Compliant	7.10	High	Compliant
BA-20	Bedroom 1	3.40	Medium	-	3.40	Medium	-
BA-20	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-21	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-21	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-22	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-22	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-22	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-23	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-23	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-24	LKD	0.80	Below Minimum	-	0.80	Below Minimum	-
BA-24	Bedroom 1	2.20	Minimum	Compliant	2.20	Minimum	Compliant
BA-25	LKD	1.00	Below Minimum	-	1.00	Below Minimum	-
BA-25	Bedroom 1	6.10	High	Compliant	6.10	High	Compliant
BA-26	LKD	8.30	High	Compliant	9.20	High	Compliant
BA-26	Bedroom 1	0.80	Below Minimum	-	0.80	Below Minimum	-
BA-26	Bedroom 2	6.00	High	-	6.00	High	-
BA-27	LKD	3.40	Medium	-	5.10	High	-
BA-27	Bedroom 1	6.50	High	Compliant	6.50	High	Compliant
BA-27	Bedroom 2	2.30	Minimum	-	2.70	Minimum	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.4 SE Results: Block A/Third Floor

Table No. C.3.4 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BA-28	LKD	5.00	High	-	8.10	High	-
BA-28	Bedroom 1	9.20	High	Compliant	9.20	High	Compliant
BA-28	Bedroom 2	4.20	High	-	4.20	High	-
BA-29	LKD	8.40	High	Compliant	8.40	High	Compliant
BA-29	Bedroom 1	8.20	High	-	8.20	High	-
BA-30	LKD	6.80	High	Compliant	6.80	High	Compliant
BA-30	Bedroom 1	6.20	High	-	6.20	High	-
BA-31	LKD	6.30	High	Compliant	6.30	High	Compliant
BA-31	Bedroom 1	0.70	Below Minimum	-	0.70	Below Minimum	-
BA-31	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-32	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-32	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-32	Bedroom 2	8.20	High	Compliant	8.60	High	Compliant
BA-33	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-33	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-33	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-34	LKD	0.00	Below Minimum	Non-Compliant	0.00	Below Minimum	Non-Compliant
BA-34	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-35	LKD	0.30	Below Minimum	Non-Compliant	0.30	Below Minimum	-
BA-35	Bedroom 1	0.10	Below Minimum	-	0.80	Below Minimum	Non-Compliant
BA-36	LKD	1.10	Below Minimum	-	1.10	Below Minimum	-
BA-36	Bedroom 1	5.80	High	Compliant	5.80	High	Compliant
BA-37	LKD	9.40	High	Compliant	9.40	High	Compliant
BA-37	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
BA-37	Bedroom 2	5.80	High	-	5.80	High	-
BA-38	LKD	6.50	High	Compliant	6.50	High	Compliant
BA-38	Bedroom 1	6.50	High	-	6.50	High	-
BA-38	Bedroom 2	6.50	High	-	6.50	High	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.5 SE Results: Block B/Ground Floor

Table No. C.3.5 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BB-39	LKD	6.30	High	Compliant	6.30	High	Compliant
BB-39	Bedroom1	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-39	Bedroom2	1.70	Minimum	-	1.70	Minimum	-
BB-40	LKD	1.00	Below Minimum	Non-Compliant	1.00	Below Minimum	Non-Compliant
BB-40	Bedroom1	0.10	Below Minimum	-	0.10	Below Minimum	-
BB-41	LKD	0.20	Below Minimum	-	0.20	Below Minimum	-
BB-41	Bedroom1	6.10	High	Compliant	6.10	High	Compliant
BB-42	LKD	1.80	Minimum	Compliant	1.80	Minimum	Compliant
BB-42	Bedroom1	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-43	LKD	2.90	Minimum	-	2.90	Minimum	-
BB-43	Bedroom1	3.10	Medium	Compliant	3.10	Medium	Compliant
BB-43	Bedroom2	2.90	Minimum	-	2.90	Minimum	-
BB-44	LKD	2.90	Minimum	Compliant	2.90	Minimum	Compliant
BB-44	Bedroom1	2.90	Minimum	-	2.90	Minimum	-
BB-45	LKD	8.80	High	Compliant	8.80	High	Compliant
BB-45	Bedroom1	7.60	High	-	7.60	High	-
BB-45	Bedroom2	1.10	Below Minimum	-	1.10	Below Minimum	-
BB-46	LKD	2.60	Minimum	-	2.60	Minimum	-
BB-46	Bedroom1	8.50	High	Compliant	8.50	High	Compliant
BB-46	Bedroom2	2.50	Minimum	-	2.50	Minimum	-
BB-47	LKD	2.80	Minimum	-	4.60	High	Compliant
BB-47	Bedroom1	3.40	Medium	Compliant	3.40	Medium	-
BB-48	LKD	2.50	Minimum	Compliant	2.50	Minimum	Compliant
BB-48	Bedroom1	1.90	Minimum	-	1.90	Minimum	-
BB-48	Bedroom2	1.60	Minimum	-	1.90	Minimum	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.6 SE Results: Block B/First Floor

Table No. C.3.6 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BB-49	LKD	6.60	High	Compliant	6.60	High	Compliant
BB-49	Bedroom1	5.60	High	-	5.60	High	-
BB-49	Bedroom2	4.10	High	-	4.10	High	-
BB-50	LKD	6.70	High	Compliant	6.80	High	Compliant
BB-50	Bedroom1	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-50	Bedroom2	2.20	Minimum	-	2.70	Minimum	-
BB-51	LKD	0.30	Below Minimum	-	0.80	Below Minimum	-
BB-51	Bedroom1	1.20	Below Minimum	Non-Compliant	1.30	Below Minimum	Non-Compliant
BB-52	LKD	1.00	Below Minimum	-	1.00	Below Minimum	-
BB-52	Bedroom1	6.00	High	Compliant	6.10	High	Compliant
BB-53	LKD	3.20	Medium	Compliant	3.20	Medium	Compliant
BB-53	Bedroom1	3.10	Medium	-	3.10	Medium	-
BB-54	LKD	2.00	Minimum	-	2.00	Minimum	-
BB-54	Bedroom1	3.20	Medium	Compliant	3.20	Medium	Compliant
BB-54	Bedroom2	3.20	Medium	-	3.20	Medium	-
BB-55	LKD	3.10	Medium	Compliant	3.10	Medium	Compliant
BB-55	Bedroom1	1.80	Minimum	-	1.80	Minimum	-
BB-56	LKD	4.10	High	-	4.10	High	-
BB-56	Bedroom1	6.20	High	Compliant	6.20	High	Compliant
BB-56	Bedroom2	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-57	LKD	4.70	High	-	4.70	High	-
BB-57	Bedroom1	9.40	High	Compliant	9.40	High	Compliant
BB-57	Bedroom2	4.70	High	-	4.70	High	-
BB-58	LKD	4.70	High	Compliant	4.70	High	Compliant
BB-58	Bedroom1	4.70	High	-	4.70	High	-
BB-59	LKD	4.10	High	-	4.10	High	-
BB-59	Bedroom1	4.20	High	-	4.20	High	-
BB-59	Bedroom2	4.70	High	Compliant	4.70	High	Compliant

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.7 SE Results: Block B/Second Floor

Table No. C.3.7 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BB-60	LKD	5.90	High	-	5.90	High	-
BB-60	Bedroom1	6.40	High	Compliant	6.40	High	Compliant
BB-60	Bedroom2	5.60	High	-	5.60	High	-
BB-61	LKD	6.40	High	Compliant	6.40	High	Compliant
BB-61	Bedroom1	0.70	Below Minimum	-	0.90	Below Minimum	-
BB-61	Bedroom2	0.10	Below Minimum	-	1.30	Below Minimum	-
BB-62	LKD	0.40	Below Minimum	-	0.40	Below Minimum	-
BB-62	Bedroom1	2.30	Minimum	Compliant	2.30	Minimum	Compliant
BB-63	LKD	1.00	Below Minimum	-	1.00	Below Minimum	-
BB-63	Bedroom1	3.80	Medium	Compliant	3.80	Medium	Compliant
BB-64	LKD	3.10	Medium	Compliant	3.10	Medium	Compliant
BB-64	Bedroom1	0.70	Below Minimum	-	0.70	Below Minimum	-
BB-65	LKD	3.10	Medium	Compliant	3.10	Medium	Compliant
BB-65	Bedroom1	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-65	Bedroom2	1.80	Minimum	-	1.80	Minimum	-
BB-66	LKD	3.20	Medium	Compliant	3.20	Medium	Compliant
BB-66	Bedroom1	2.00	Minimum	-	2.00	Minimum	-
BB-67	LKD	8.40	High	Compliant	8.40	High	Compliant
BB-67	Bedroom1	8.40	High	-	8.40	High	-
BB-67	Bedroom2	3.20	Medium	-	3.20	Medium	-
BB-68	LKD	4.40	High	-	4.40	High	-
BB-68	Bedroom1	9.40	High	Compliant	9.40	High	Compliant
BB-68	Bedroom2	4.10	High	-	4.10	High	-
BB-69	LKD	4.10	High	-	4.10	High	-
BB-69	Bedroom1	4.40	High	Compliant	4.40	High	Compliant
BB-70	LKD	3.10	Medium	-	3.10	Medium	-
BB-70	Bedroom1	2.50	Minimum	-	2.50	Minimum	-
BB-70	Bedroom2	4.40	High	Compliant	4.40	High	Compliant

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.8 SE Results: Block B/Third Floor

Table No. C.3.8 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
BB-71	LKD	3.90	Medium	-	3.90	Medium	-
BB-71	Bedroom1	6.00	High	Compliant	6.00	High	Compliant
BB-71	Bedroom2	3.20	Medium	-	3.30	Medium	-
BB-72	LKD	6.60	High	Compliant	6.60	High	Compliant
BB-72	Bedroom1	0.00	Below Minimum	-	0.00	Below Minimum	-
BB-72	Bedroom2	0.40	Below Minimum	-	0.40	Below Minimum	-
BB-73	LKD	1.00	Below Minimum	Non-Compliant	1.00	Below Minimum	Non-Compliant
BB-73	Bedroom1	0.60	Below Minimum	-	0.60	Below Minimum	-
BB-74	LKD	0.80	Below Minimum	-	0.80	Below Minimum	-
BB-74	Bedroom1	6.10	High	Compliant	6.10	High	Compliant
BB-75	LKD	3.30	Medium	Compliant	3.30	Medium	Compliant
BB-75	Bedroom1	1.40	Below Minimum	-	1.40	Below Minimum	-
BB-76	LKD	1.00	Below Minimum	-	1.00	Below Minimum	-
BB-76	Bedroom1	2.40	Minimum	Compliant	2.40	Minimum	Compliant
BB-76	Bedroom2	0.10	Below Minimum	-	0.10	Below Minimum	-
BB-77	LKD	3.00	Medium	Compliant	3.00	Medium	Compliant
BB-77	Bedroom1	2.50	Minimum	-	2.50	Minimum	-
BB-78	LKD	4.50	High	-	4.50	High	-
BB-78	Bedroom1	8.10	High	Compliant	8.10	High	Compliant
BB-78	Bedroom2	3.20	Medium	-	3.20	Medium	-
BB-79	LKD	4.70	High	Compliant	4.70	High	-
BB-79	Bedroom1	4.40	High	-	7.20	High	Compliant
BB-79	Bedroom2	1.10	Below Minimum	-	1.10	Below Minimum	-
BB-80	LKD	0.90	Below Minimum	-	2.10	Minimum	-
BB-80	Bedroom1	3.60	Medium	Compliant	4.10	High	Compliant
BB-81	LKD	4.00	High	-	4.10	High	-
BB-81	Bedroom1	4.70	High	Compliant	4.70	High	Compliant
BB-81	Bedroom2	3.80	Medium	-	3.80	Medium	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.9 SE Results: Duplex Block C/Ground Floor

Table No. C.3.9 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex C-104	LKD	2.20	Minimum	-	4.40	High	Compliant
Duplex C-104	Bedroom 1	2.80	Minimum	Compliant	2.80	Minimum	-
Duplex C-104	Bedroom 2	0.00	Below Minimum	-	0.40	Below Minimum	-
Duplex C-105	LKD	4.10	High	-	4.10	High	-
Duplex C-105	Bedroom 1	3.30	Medium	-	3.30	Medium	-
Duplex C-105	Bedroom 2	4.40	High	Compliant	4.40	High	Compliant
Duplex C-105	Bedroom 3	3.40	Medium	-	3.40	Medium	-
Duplex C-106	LKD	4.40	High	Compliant	4.40	High	Compliant
Duplex C-106	Bedroom 1	3.50	Medium	-	3.50	Medium	-
Duplex C-106	Bedroom 2	2.80	Minimum	-	2.80	Minimum	-
Duplex C-107	LKD	4.10	High	-	4.10	High	-
Duplex C-107	Bedroom 1	3.30	Medium	-	3.30	Medium	-

C.3.10 SE Results: Duplex Block C/First Floor

Table No. C.3.10 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex C-107	Bedroom 2	4.40	High	Compliant	4.40	High	Compliant
Duplex C-107	Bedroom 3	3.50	Medium	-	3.50	Medium	-
Duplex C-108	LKD	4.40	High	Compliant	4.40	High	Compliant
Duplex C-108	Bedroom 1	2.00	Minimum	-	2.80	Minimum	-
Duplex C-108	Bedroom 2	0.00	Below Minimum	-	0.40	Below Minimum	-
Duplex C-109	LKD	4.10	High	-	4.10	High	-
Duplex C-109	Bedroom 1	3.30	Medium	-	3.30	Medium	-
Duplex C-109	Bedroom 2	4.40	High	Compliant	4.40	High	Compliant

C.3.11 SE Results: Duplex Block C/Second Floor

Table No. C.3.11 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex C-109	Bedroom 3	3.50	Medium	-	3.50	Medium	-
Duplex C-110	LKD	5.00	High	Compliant	5.50	High	Compliant
Duplex C-110	Bedroom 1	4.80	High	-	5.10	High	-
Duplex C-110	Bedroom 2	2.80	Minimum	-	2.80	Minimum	-
Duplex C-111	LKD	4.10	High	-	4.10	High	-
Duplex C-111	Bedroom 1	3.30	Medium	-	3.30	Medium	-
Duplex C-111	Bedroom 2	4.40	High	Compliant	4.40	High	Compliant
Duplex C-111	Bedroom 3	3.40	Medium	-	3.40	Medium	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.12 SE Results: Duplex Block D/Ground Floor

Table No. C.3.12 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex D-112	LKD	3.20	Medium	Compliant	4.20	High	Compliant
Duplex D-112	Bedroom 1	1.90	Minimum	-	3.00	Medium	-
Duplex D-112	Bedroom 2	0.60	Below Minimum	-	1.10	Below Minimum	-
Duplex D-113	LKD	3.70	Medium	-	3.70	Medium	-
Duplex D-113	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex D-113	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex D-113	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex D-114	LKD	4.20	High	Compliant	4.20	High	Compliant
Duplex D-114	Bedroom 1	4.00	High	-	4.00	High	-
Duplex D-114	Bedroom 2	3.30	Medium	-	3.30	Medium	-
Duplex D-115	LKD	3.70	Medium	-	3.70	Medium	-
Duplex D-115	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex D-115	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex D-115	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex D-116	LKD	4.20	High	Compliant	4.20	High	Compliant
Duplex D-116	Bedroom 1	3.20	Medium	-	3.20	Medium	-
Duplex D-116	Bedroom 2	1.10	Below Minimum	-	1.10	Below Minimum	-
Duplex D-117	LKD	3.70	Medium	-	3.70	Medium	-
Duplex D-117	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex D-117	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex D-117	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex D-118	LKD	2.50	Minimum	-	2.50	Minimum	-
Duplex D-118	Bedroom 1	4.00	High	Compliant	4.00	High	Compliant
Duplex D-118	Bedroom 2	3.30	Medium	-	3.30	Medium	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.13 SE Results: Duplex Block D/First Floor

Table No. C.3.13 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex D-119	LKD	3.50	Medium	-	3.50	Medium	-
Duplex D-119	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex D-119	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex D-119	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex D-120	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-120	Bedroom 1	1.50	Minimum	-	1.50	Minimum	-
Duplex D-120	Bedroom 2	1.10	Below Minimum	-	2.20	Minimum	-
Duplex D-121	LKD	8.10	High	Compliant	8.70	High	Compliant
Duplex D-121	Bedroom 1	4.70	High	-	4.70	High	-
Duplex D-121	Bedroom 2	6.10	High	-	6.30	High	-
Duplex D-122	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-122	Bedroom 1	2.10	Minimum	-	2.10	Minimum	-
Duplex D-123	LKD	6.30	High	Compliant	6.30	High	Compliant
Duplex D-123	Bedroom 1	1.40	Below Minimum	-	1.40	Below Minimum	-
Duplex D-124	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-124	Bedroom 1	2.60	Minimum	-	2.60	Minimum	-

C.3.14 SE Results: Duplex Block D/Second Floor

Table No. C.3.14 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex D-125	LKD	6.40	High	Compliant	6.40	High	Compliant
Duplex D-125	Bedroom 1	2.20	Minimum	-	2.20	Minimum	-
Duplex D-126	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-126	Bedroom 1	6.10	High	Compliant	8.50	High	Compliant
Duplex D-126	Bedroom 2	4.50	High	-	5.60	High	-
Duplex D-127	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-127	Bedroom 1	9.00	High	-	9.00	High	-
Duplex D-127	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-127	Bedroom 3	9.40	High	Compliant	9.40	High	Compliant
Duplex D-128	LKD	1.50	Minimum	-	3.50	Medium	-
Duplex D-128	Bedroom 1	7.40	High	Compliant	8.60	High	Compliant
Duplex D-128	Bedroom 2	3.70	Medium	-	5.60	High	-
Duplex D-129	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-129	Bedroom 1	9.00	High	-	9.00	High	-
Duplex D-129	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-129	Bedroom 3	9.40	High	Compliant	9.40	High	Compliant

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.15 SE Results: Duplex Block E/Ground Floor

Table No. C.3.15 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex D-119	LKD	3.50	Medium	-	3.50	Medium	-
Duplex D-119	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex D-119	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex D-119	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex D-120	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-120	Bedroom 1	1.50	Minimum	-	1.50	Minimum	-
Duplex D-120	Bedroom 2	1.10	Below Minimum	-	2.20	Minimum	-
Duplex D-121	LKD	8.10	High	Compliant	8.70	High	Compliant
Duplex D-121	Bedroom 1	4.70	High	-	4.70	High	-
Duplex D-121	Bedroom 2	6.10	High	-	6.30	High	-
Duplex D-122	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-122	Bedroom 1	2.10	Minimum	-	2.10	Minimum	-
Duplex D-123	LKD	6.30	High	Compliant	6.30	High	Compliant
Duplex D-123	Bedroom 1	1.40	Below Minimum	-	1.40	Below Minimum	-
Duplex D-124	LKD	6.10	High	Compliant	6.10	High	Compliant
Duplex D-124	Bedroom 1	2.60	Minimum	-	2.60	Minimum	-
Duplex D-125	LKD	6.40	High	Compliant	6.40	High	Compliant
Duplex D-125	Bedroom 1	2.20	Minimum	-	2.20	Minimum	-
Duplex D-126	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-126	Bedroom 1	6.10	High	Compliant	8.50	High	Compliant
Duplex D-126	Bedroom 2	4.50	High	-	5.60	High	-
Duplex D-127	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-127	Bedroom 1	9.00	High	-	9.00	High	-
Duplex D-127	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.16 SE Results: Duplex Block E/First Floor

Table No. C.3.16 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex D-127	Bedroom 3	9.40	High	Compliant	9.40	High	Compliant
Duplex D-128	LKD	1.50	Minimum	-	3.50	Medium	-
Duplex D-128	Bedroom 1	7.40	High	Compliant	8.60	High	Compliant
Duplex D-128	Bedroom 2	3.70	Medium	-	5.60	High	-
Duplex D-129	LKD	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-129	Bedroom 1	9.00	High	-	9.00	High	-
Duplex D-129	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex D-129	Bedroom 3	9.40	High	Compliant	9.40	High	Compliant
Duplex E-184	LKD	8.30	High	Compliant	8.30	High	Compliant
Duplex E-184	Bedroom 1	3.60	Medium	-	3.60	Medium	-
Duplex E-184	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-185	LKD	9.10	High	-	9.10	High	-
Duplex E-185	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-185	Bedroom 2	9.40	High	Compliant	9.40	High	Compliant
Duplex E-185	Bedroom 3	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-186	LKD	7.00	High	Compliant	7.00	High	Compliant

C.3.17 SE Results: Duplex Block E/Second Floor

Table No. C.3.17 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex E-186	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-186	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-187	LKD	8.60	High	-	8.60	High	-
Duplex E-187	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-187	Bedroom 2	8.90	High	Compliant	8.90	High	Compliant
Duplex E-187	Bedroom 3	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-188	LKD	0.40	Below Minimum	Non-Compliant	0.80	Below Minimum	Non-Compliant
Duplex E-188	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-188	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-189	LKD	2.20	Minimum	Compliant	2.20	Minimum	Compliant
Duplex E-189	Bedroom 1	0.90	Below Minimum	-	0.90	Below Minimum	-
Duplex E-189	Bedroom 2	1.60	Minimum	-	1.60	Minimum	-
Duplex E-190	LKD	0.90	Below Minimum	Non-Compliant	0.90	Below Minimum	Non-Compliant
Duplex E-190	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-191	LKD	2.10	Minimum	-	2.10	Minimum	-
Duplex E-191	Bedroom 1	2.50	Minimum	Compliant	2.50	Minimum	Compliant

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.18 SE Results: Duplex Block F/Ground Floor

Table No. C.3.18 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex E-192	LKD	0.90	Below Minimum	Non-Compliant	0.90	Below Minimum	Non-Compliant
Duplex E-192	Bedroom 1	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex E-193	LKD	2.60	Minimum	Compliant	2.60	Minimum	Compliant
Duplex E-193	Bedroom 1	2.50	Minimum	-	2.50	Minimum	-
Duplex E-194	LKD	4.20	High	Compliant	4.20	High	Compliant
Duplex E-194	Bedroom 1	3.20	Medium	-	3.20	Medium	-
Duplex E-194	Bedroom 2	1.10	Below Minimum	-	1.10	Below Minimum	-
Duplex E-195	LKD	3.70	Medium	-	3.70	Medium	-
Duplex E-195	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex E-195	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex E-195	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex E-196	LKD	4.20	High	Compliant	4.20	High	Compliant
Duplex E-196	Bedroom 1	4.00	High	-	4.00	High	-
Duplex E-196	Bedroom 2	3.30	Medium	-	3.30	Medium	-
Duplex E-197	LKD	3.70	Medium	-	3.70	Medium	-
Duplex E-197	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex E-197	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex E-197	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex E-198	LKD	4.20	High	Compliant	4.20	High	Compliant
Duplex E-198	Bedroom 1	3.20	Medium	-	3.20	Medium	-
Duplex E-198	Bedroom 2	1.10	Below Minimum	-	1.10	Below Minimum	-
Duplex E-199	LKD	3.70	Medium	-	3.70	Medium	-
Duplex E-199	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex E-199	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex E-199	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex E-200	LKD	5.30	High	Compliant	5.40	High	Compliant
Duplex E-200	Bedroom 1	4.90	High	-	4.90	High	-
Duplex E-200	Bedroom 2	3.30	Medium	-	3.30	Medium	-
Duplex E-201	LKD	3.70	Medium	-	3.70	Medium	-
Duplex E-201	Bedroom 1	3.70	Medium	-	3.70	Medium	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.19 SE Results: Duplex Block F/First Floor

Table No. C.3.19 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex E-201	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex E-201	Bedroom 3	3.90	Medium	-	3.90	Medium	-
Duplex F-202	LKD	2.00	Minimum	-	2.00	Minimum	-
Duplex F-202	Bedroom 1	4.00	High	Compliant	4.00	High	Compliant
Duplex F-202	Bedroom 2	2.20	Minimum	-	2.20	Minimum	-
Duplex F-203	LKD	3.10	Medium	-	3.10	Medium	-
Duplex F-203	Bedroom 1	2.40	Minimum	-	2.40	Minimum	-
Duplex F-203	Bedroom 2	2.70	Minimum	-	2.70	Minimum	-
Duplex F-203	Bedroom 3	3.70	Medium	Compliant	3.70	Medium	Compliant
Duplex F-204	LKD	2.30	Minimum	-	2.30	Minimum	-
Duplex F-204	Bedroom 1	2.70	Minimum	-	2.70	Minimum	-
Duplex F-204	Bedroom 2	3.70	Medium	Compliant	3.70	Medium	Compliant
Duplex F-205	LKD	2.20	Minimum	Compliant	2.20	Minimum	Compliant
Duplex F-205	Bedroom 1	0.80	Below Minimum	-	0.80	Below Minimum	-
Duplex F-205	Bedroom 2	0.70	Below Minimum	-	0.70	Below Minimum	-
Duplex F-205	Bedroom 3	1.70	Minimum	-	1.70	Minimum	-
Duplex F-206	LKD	2.20	Minimum	-	2.20	Minimum	-
Duplex F-206	Bedroom 1	3.80	Medium	-	3.80	Medium	-
Duplex F-206	Bedroom 2	3.90	Medium	Compliant	3.90	Medium	Compliant
Duplex F-207	LKD	3.00	Medium	-	3.00	Medium	-

C.3.20 SE Results: Duplex Block F/Second Floor

Table No. C.3.20 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex F-207	Bedroom 1	3.80	Medium	Compliant	4.20	High	Compliant
Duplex F-207	Bedroom 2	1.20	Below Minimum	-	1.20	Below Minimum	-
Duplex F-207	Bedroom 3	3.60	Medium	-	3.60	Medium	-
Duplex F-208	LKD	3.10	Medium	-	3.10	Medium	-
Duplex F-208	Bedroom 1	3.70	Medium	-	3.70	Medium	-
Duplex F-208	Bedroom 2	4.10	High	Compliant	4.10	High	Compliant
Duplex F-209	LKD	2.70	Minimum	-	2.70	Minimum	-
Duplex F-209	Bedroom 1	1.30	Below Minimum	-	1.30	Below Minimum	-
Duplex F-209	Bedroom 2	3.10	Medium	Compliant	3.10	Medium	Compliant
Duplex F-209	Bedroom 3	2.30	Minimum	-	2.30	Minimum	-
Duplex F-210	LKD	3.80	Medium	-	3.80	Medium	-
Duplex F-210	Bedroom 1	4.10	High	Compliant	4.10	High	Compliant
Duplex F-210	Bedroom 2	4.10	High	-	4.10	High	-
Duplex F-211	LKD	1.50	Minimum	-	1.50	Minimum	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.
 ** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.
 *** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.
 For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. C.3.20 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex F-211	Bedroom 1	3.70	Medium	Compliant	3.70	Medium	Compliant
Duplex F-211	Bedroom 2	2.10	Minimum	-	2.10	Minimum	-
Duplex F-211	Bedroom 3	3.50	Medium	-	3.50	Medium	-
Duplex F-212	LKD	3.80	Medium	-	3.80	Medium	-
Duplex F-212	Bedroom 1	4.10	High	Compliant	4.10	High	Compliant
Duplex F-212	Bedroom 2	4.10	High	-	4.10	High	-

C.3.21 SE Results: Duplex Block G/Ground Floor

Table No. C.3.21 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex F-213	LKD	3.10	Medium	-	3.10	Medium	-
Duplex F-213	Bedroom 1	2.40	Minimum	-	2.40	Minimum	-
Duplex F-213	Bedroom 2	2.40	Minimum	-	2.40	Minimum	-
Duplex F-213	Bedroom 3	3.90	Medium	Compliant	3.90	Medium	Compliant
Duplex F-214	LKD	3.80	Medium	-	3.80	Medium	-
Duplex F-214	Bedroom 1	2.70	Minimum	-	2.70	Minimum	-
Duplex F-214	Bedroom 2	4.00	High	Compliant	4.00	High	Compliant
Duplex F-215	LKD	3.60	Medium	Compliant	3.60	Medium	Compliant
Duplex F-215	Bedroom 1	3.60	Medium	-	3.60	Medium	-
Duplex F-215	Bedroom 2	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex F-215	Bedroom 3	2.30	Minimum	-	2.30	Minimum	-
Duplex F-216	LKD	2.40	Minimum	-	2.40	Minimum	-
Duplex F-216	Bedroom 1	1.10	Below Minimum	-	1.10	Below Minimum	-
Duplex F-216	Bedroom 2	2.70	Minimum	Compliant	2.70	Minimum	Compliant
Duplex F-217	LKD	3.10	Medium	Compliant	3.10	Medium	Compliant
Duplex F-217	Bedroom 1	2.30	Minimum	-	2.30	Minimum	-
Duplex F-217	Bedroom 2	2.10	Minimum	-	2.10	Minimum	-
Duplex F-217	Bedroom 3	2.30	Minimum	-	2.30	Minimum	-
Duplex F-218	LKD	0.60	Below Minimum	-	0.60	Below Minimum	-
Duplex F-218	Bedroom 1	1.60	Minimum	-	1.60	Minimum	-
Duplex F-218	Bedroom 2	2.70	Minimum	Compliant	2.70	Minimum	Compliant
Duplex F-219	LKD	2.10	Minimum	Compliant	2.10	Minimum	Compliant
Duplex F-219	Bedroom 1	0.80	Below Minimum	-	0.80	Below Minimum	-
Duplex F-219	Bedroom 2	2.10	Minimum	-	2.10	Minimum	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.

** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.

*** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.3.22 SE Results: Duplex Block G/First Floor

Table No. C.3.22 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex F-219	Bedroom 3	0.00	Below Minimum	-	0.00	Below Minimum	-
Duplex F-220	LKD	9.30	High	-	9.30	High	-
Duplex F-220	Bedroom 1	9.40	High	Compliant	9.40	High	Compliant
Duplex F-220	Bedroom 2	3.70	Medium	-	3.70	Medium	-
Duplex F-221	LKD	3.60	Medium	-	3.60	Medium	-
Duplex F-221	Bedroom 1	4.20	High	Compliant	4.20	High	Compliant
Duplex F-221	Bedroom 2	1.40	Below Minimum	-	1.40	Below Minimum	-
Duplex F-221	Bedroom 3	2.40	Minimum	-	2.40	Minimum	-
Duplex G-222	LKD	3.40	Medium	-	3.40	Medium	-
Duplex G-222	Bedroom 1	3.60	Medium	Compliant	3.60	Medium	Compliant
Duplex G-222	Bedroom 2	1.80	Minimum	-	1.80	Minimum	-
Duplex G-223	LKD	3.20	Medium	-	3.20	Medium	-
Duplex G-223	Bedroom 1	4.20	High	-	4.20	High	-
Duplex G-223	Bedroom 2	3.40	Medium	-	3.40	Medium	-
Duplex G-223	Bedroom 3	4.50	High	Compliant	4.50	High	Compliant
Duplex G-224	LKD	3.70	Medium	-	3.70	Medium	-

C.3.23 SE Results: Duplex Block G/Second Floor

Table No. C.3.23 - Sunlight Exposure Results:							
Unit Number	Room Description	Deciduous Trees as Opaque Objects*			Without Deciduous Trees*		
		SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**	SE Hours on March 21st	Level of SE on March 21st***	Unit compliance based on highest performing room**
Duplex G-224	Bedroom 1	4.50	High	Compliant	4.50	High	Compliant
Duplex G-224	Bedroom 2	3.90	Medium	-	3.90	Medium	-
Duplex G-225	LKD	3.20	Medium	-	3.20	Medium	-
Duplex G-225	Bedroom 1	4.20	High	-	4.20	High	-
Duplex G-225	Bedroom 2	3.40	Medium	-	3.40	Medium	-
Duplex G-225	Bedroom 3	4.50	High	Compliant	4.50	High	Compliant
Duplex G-226	LKD	3.40	Medium	-	3.40	Medium	-
Duplex G-226	Bedroom 1	3.50	Medium	Compliant	3.50	Medium	Compliant
Duplex G-226	Bedroom 2	1.80	Minimum	-	1.80	Minimum	-
Duplex G-227	LKD	3.20	Medium	-	3.20	Medium	-
Duplex G-227	Bedroom 1	4.20	High	-	4.20	High	-
Duplex G-227	Bedroom 2	3.40	Medium	-	3.40	Medium	-
Duplex G-227	Bedroom 3	4.50	High	Compliant	4.50	High	Compliant
Duplex G-228	LKD	1.10	Below Minimum	-	1.10	Below Minimum	-
Duplex G-228	Bedroom 1	4.50	High	Compliant	4.50	High	Compliant
Duplex G-228	Bedroom 2	3.90	Medium	-	3.90	Medium	-

* Rooms are tested with deciduous trees as opaque objects and without deciduous trees to account for the range of possible sunlight hours.

** Section 3.1.15 of the BRE Guidelines recommends that for a unit to be compliant any room within the unit should receive a minimum of 1.5 hours of direct sunlight on March 21st, preferably a main living room. The SE circa compliance rates can be found in section 3.2.2 on page 21.

*** For the interpretation of levels of Sunlight Exposure please refer to "E.3 Definition of Levels of Sunlight Exposure" on page 129.

For floor plans of the assessed units please refer to section C.1 on page 45.

C.4 Sun On Ground (SOG) in Proposed Outdoor Amenity Areas

Below is an example of the table used to describe SOG in proposed gardens and amenity spaces.

Table Example. C.4 - Scheme Performance SOG					
Assigned Area Number	Assessed Area	Area Capable of Receiving 2 Hours of Sunlight on March 21st	Recommended Minimum	Level of Compliance with BRE Guidelines	Meets BR 209 Criteria
A	B	C	D	E	F

- A: Assigned Area Number**
 This column indicates the number that 3DDDB have assigned to the assessed areas, which is included for the sole purpose of aiding in the identification of the corresponding space shown in the corresponding figure.
- B: Assessed Area**
 This column identifies the assessed garden/amenity area.
- C: Area Capable of Receiving 2 Hours of Sunlight on March 21st**
 The percentage of the proposed area that can receive more than 2 hours of sunlight on March 21st.
- D: Recommended Minimum**
 Section 3.3.17 of the BRE Guidelines state that the percentage of a garden/amenity area that can receive more than 2 hours of sunlight on March 21st should be 50%. The target value for all spaces is set to 50%.
- E: Level of Compliance with BRE Guidelines**
 This column states the compliance of the assessed space with the *BRE Target Value*. If the assessed garden or amenity area complies with the BRE Guidelines this cell will state “*BRE Compliant*”. If the garden or amenity area does not meet the criteria as set out in the BRE Guidelines, a percentage of compliance with the *recommended minimum* will be stated.
- F: Meets BR 209 Criteria**
 This column states if the assessed area achieves the recommended level of sunlight on March 21st as per BR 209.
- It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

C.4.1 Sun On Ground in Proposed Outdoor Amenity Areas

Table No. C.4.1 - SOG in Proposed Outdoor Amenity Areas Results:					
Assigned Area Number	Assessed Area	Area Capable of Receiving 2 Hours of Sunlight on March 21st	Recommended minimum	Level of Compliance with BRE Guidelines*	Meets BR 209 Criteria*
1	Creche Outdoor PlayArea	99.93%	50.00%	BRE Compliant	Yes
2	BlockA_Communal_OpenSpace	98.99%	50.00%	BRE Compliant	Yes
3	BlockB_Communal_OpenSpace	99.58%	50.00%	BRE Compliant	Yes
4	DuplexC_Communal_OpenSpace	61.79%	50.00%	BRE Compliant	Yes
5	DuplexD_Communal_OpenSpace	98.80%	50.00%	BRE Compliant	Yes
6	DuplexE_Communal_OpenSpace	97.55%	50.00%	BRE Compliant	Yes
7	DuplexF_Communal_OpenSpace	98.55%	50.00%	BRE Compliant	Yes
8	DuplexG_Communal_OpenSpace	98.07%	50.00%	BRE Compliant	Yes
9	Public OpenSpace1	93.04%	50.00%	BRE Compliant	Yes
10	Public OpenSpace2	97.34%	50.00%	BRE Compliant	Yes
11	Public OpenSpace3	92.39%	50.00%	BRE Compliant	Yes
12	Public OpenSpace4	96.40%	50.00%	BRE Compliant	Yes

* Section 2.2.23 of the BRE Guidelines recommends that for a garden or amenity to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on March 21st.

** Average values have been calculated by considering all the relevant areas as a singular area and calculating what portion of the spaces as a whole can receive at least two hours of sunlight on March 21st.



Figure C.31: Indication of the amenity areas that have been analysed

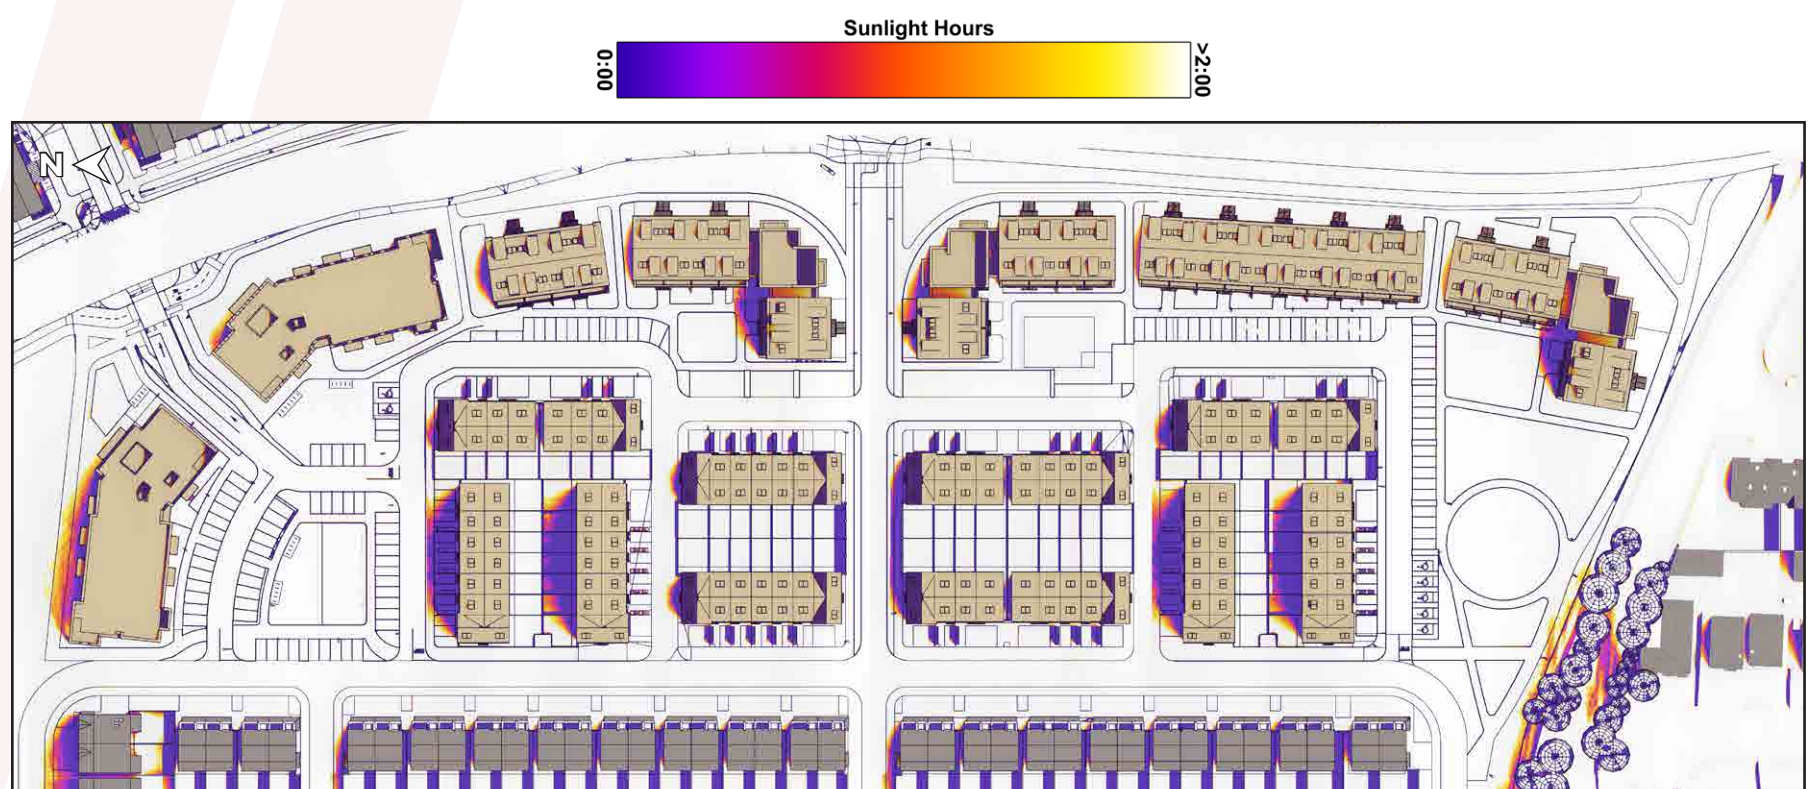


Figure C.32: Area capable of receiving 2 hours of sunlight on March 21st shown in white

D.0 Supplementary Study Results

D.1 SDA study, under the I.S. EN 17037 criteria

Below is an example of the table used to describe the supplementary study results for proposed units in the assessment of SDA under the I.S. EN 17037 criteria.

Table Example. D.1 - Supplementary Scheme Performance SDA (I.S. EN 17037 criteria)						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria
		Area above 300 Lux	Area above 100 Lux	Area above 300 Lux	Area above 100 Lux	
A	B	C	D	E	F	G

A: Unit Number

This column identifies the assessed unit. All unit numbers are determined by the architect's drawings, unless otherwise stated.

B: Room Description

Room Description details which room in the unit has been assessed, e.g. bedroom, LKD, etc.

C: % of area above 300 Lux (No Trees)

I.S. EN 17037 recommends at least 50% of the working plane receives above 300 lux for at least half the daylight hours.

This column states percentage of the working plane of the assessed room that is capable of receiving more than 300 lux for at least half the daylight hours when the assessment is carried out without trees in the analytical model.

D: % of area above 100 Lux (No Trees)

I.S. EN 17037 recommends at least 95% of the working plane receives above 100 lux for at least half the daylight hours.

This column states percentage of the working plane of the assessed room that is capable of receiving more than 100 lux for at least half the daylight hours when the assessment is carried out without trees in the analytical model.

E: % of area above 300 Lux (Winter Trees)

I.S. EN 17037 recommends at least 50% of the working plane receives above 300 lux for at least half the daylight hours.

This column states percentage of the working plane of the assessed room that is capable of receiving more than 300 lux for at least half the daylight hours with the foliage of deciduous trees varied to account for summer and winter conditions, i.e. full leaf and bare branch.

F: % of area above 100 Lux (Winter Trees)

I.S. EN 17037 recommends at least 95% of the working plane receives above 100 lux for at least half the daylight hours.

This column states percentage of the working plane of the assessed room that is capable of receiving more than 100 lux for at least half the daylight hours with the foliage of deciduous trees varied to account for summer and winter conditions.

G: Compliance with I.S. EN 17037 Criteria

This column states if the assessed room achieves the recommended level of daylight as per I.S. EN 17037 with consideration to the various tree states.

If the recommended lux levels are achieved on the working plane, for half the daylight hours, both with and without trees, this column will state: *'Compliant'*.

If the recommended lux levels are not achieved on the working plane, for half the daylight hours, both with and without trees, this column will state: *'Non-compliant'*.

If the recommended lux levels are achieved on the working plane, for half the daylight hours, without trees but are not achieved with trees, this column will state: *'Trees affecting compliance'*.

Compliance rates will be stated for SDA compliance with trees in all of the above states.

It should be noted that the figures displayed in the table of results have been rounded off. A manual calculation of these figures may yield a negligible difference and should not be considered an error.

D.1.1 Supplementary SDA Results (I.S. EN 17037 criteria): Block A/Ground Floor

Table No. D.1.2 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BA-01	LKD	69%	100%	69%	100%	Compliant
BA-01	Bedroom 1	100%	100%	100%	100%	Compliant
BA-01	Bedroom 2	100%	100%	100%	100%	Compliant
BA-02	LKD	64%	100%	62%	100%	Compliant
BA-02	Bedroom 1	100%	100%	100%	100%	Compliant
BA-03	LKD	69%	100%	69%	100%	Compliant
BA-03	Bedroom 1	100%	100%	100%	100%	Compliant
BA-03	Bedroom 2	100%	100%	100%	100%	Compliant
BA-04	LKD	41%	87%	36%	79%	Non-compliant
BA-04	Bedroom 1	81%	100%	68%	100%	Compliant
BA-04	Bedroom 2	67%	100%	54%	100%	Compliant
BA-05	LKD	38%	93%	36%	85%	Non-compliant
BA-05	Bedroom 1	100%	100%	87%	100%	Compliant
Creche	Classroom 1	53%	100%	45%	100%	Trees affecting compliance
Creche	Classroom 2	46%	100%	33%	100%	Non-compliant
Creche	Classroom 3	52%	100%	46%	100%	Trees affecting compliance
Creche	Classroom 4	100%	100%	100%	100%	Compliant

D.1.2 Supplementary SDA Results (I.S. EN 17037 criteria): Block A/First Floor

Table No. D.1.2 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BA-06	LKD	70%	100%	70%	100%	Compliant
BA-06	Bedroom 1	100%	100%	100%	100%	Compliant
BA-06	Bedroom 2	100%	100%	100%	100%	Compliant
BA-07	LKD	63%	100%	63%	100%	Compliant
BA-07	Bedroom 1	100%	100%	100%	100%	Compliant
BA-08	LKD	70%	100%	70%	100%	Compliant
BA-08	Bedroom 1	100%	100%	100%	100%	Compliant
BA-08	Bedroom 2	100%	100%	100%	100%	Compliant
BA-09	LKD	48%	88%	44%	84%	Non-compliant
BA-09	Bedroom 1	99%	100%	92%	100%	Compliant
BA-09	Bedroom 2	97%	100%	81%	100%	Compliant
BA-10	LKD	41%	94%	39%	89%	Non-compliant
BA-10	Bedroom 1	100%	100%	100%	100%	Compliant
BA-11	LKD	41%	90%	39%	87%	Non-compliant
BA-11	Bedroom 1	100%	100%	93%	100%	Compliant
BA-11	Bedroom 2	96%	100%	83%	100%	Compliant
BA-12	LKD	44%	100%	41%	100%	Non-compliant
BA-12	Bedroom 1	96%	100%	96%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.2 - Supplementary SDA Results (I.S. EN 17037 criteria):

Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BA-13	LKD	43%	94%	41%	88%	Non-compliant
BA-13	Bedroom 1	100%	100%	100%	100%	Compliant
BA-14	LKD	38%	94%	35%	88%	Non-compliant
BA-14	Bedroom 1	100%	100%	100%	100%	Compliant
BA-15	LKD	86%	99%	85%	99%	Compliant
BA-15	Bedroom 1	100%	100%	100%	100%	Compliant
BA-15	Bedroom 2	100%	100%	100%	100%	Compliant
BA-16	LKD	68%	100%	67%	100%	Compliant
BA-16	Bedroom 1	100%	100%	100%	100%	Compliant
BA-16	Bedroom 2	100%	100%	100%	100%	Compliant

D.1.3 Supplementary SDA Results (I.S. EN 17037 criteria): Block A/Second Floor

Table No. D.1.3 - Supplementary SDA Results (I.S. EN 17037 criteria):

Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BA-17	LKD	74%	100%	74%	100%	Compliant
BA-17	Bedroom 1	100%	100%	100%	100%	Compliant
BA-17	Bedroom 2	100%	100%	100%	100%	Compliant
BA-18	LKD	66%	100%	66%	100%	Compliant
BA-18	Bedroom 1	100%	100%	100%	100%	Compliant
BA-19	LKD	72%	100%	72%	100%	Compliant
BA-19	Bedroom 1	100%	100%	100%	100%	Compliant
BA-19	Bedroom 2	100%	100%	100%	100%	Compliant
BA-20	LKD	48%	91%	48%	90%	Non-compliant
BA-20	Bedroom 1	100%	100%	100%	100%	Compliant
BA-20	Bedroom 2	100%	100%	100%	100%	Compliant
BA-21	LKD	41%	95%	41%	94%	Non-compliant
BA-21	Bedroom 1	100%	100%	100%	100%	Compliant
BA-22	LKD	44%	93%	43%	91%	Non-compliant
BA-22	Bedroom 1	100%	100%	100%	100%	Compliant
BA-22	Bedroom 2	100%	100%	100%	100%	Compliant
BA-23	LKD	47%	100%	46%	100%	Non-compliant
BA-23	Bedroom 1	98%	100%	98%	100%	Compliant
BA-24	LKD	46%	98%	44%	97%	Non-compliant
BA-24	Bedroom 1	100%	100%	100%	100%	Compliant
BA-25	LKD	39%	95%	39%	95%	Non-compliant
BA-25	Bedroom 1	100%	100%	100%	100%	Compliant
BA-26	LKD	92%	99%	92%	99%	Compliant
BA-26	Bedroom 1	100%	100%	100%	100%	Compliant
BA-26	Bedroom 2	100%	100%	100%	100%	Compliant
BA-27	LKD	70%	100%	69%	100%	Compliant
BA-27	Bedroom 1	100%	100%	100%	100%	Compliant
BA-27	Bedroom 2	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14. For floor plans of the assessed units please refer to section C.1 on page 45.

D.1.4 Supplementary SDA Results (I.S. EN 17037 criteria): Block A/Third Floor

Table No. D.1.4 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BA-28	LKD	74%	100%	74%	100%	Compliant
BA-28	Bedroom 1	100%	100%	100%	100%	Compliant
BA-28	Bedroom 2	100%	100%	100%	100%	Compliant
BA-29	LKD	68%	100%	68%	100%	Compliant
BA-29	Bedroom 1	100%	100%	100%	100%	Compliant
BA-30	LKD	77%	100%	77%	100%	Compliant
BA-30	Bedroom 1	100%	100%	100%	100%	Compliant
BA-31	LKD	53%	95%	53%	94%	Trees affecting compliance
BA-31	Bedroom 1	100%	100%	100%	100%	Compliant
BA-31	Bedroom 2	100%	100%	100%	100%	Compliant
BA-32	LKD	43%	96%	43%	95%	Non-compliant
BA-32	Bedroom 1	100%	100%	100%	100%	Compliant
BA-32	Bedroom 2	100%	100%	100%	100%	Compliant
BA-33	LKD	45%	95%	45%	95%	Non-compliant
BA-33	Bedroom 1	100%	100%	100%	100%	Compliant
BA-33	Bedroom 2	100%	100%	100%	100%	Compliant
BA-34	LKD	49%	100%	47%	100%	Non-compliant
BA-34	Bedroom 1	100%	100%	100%	100%	Compliant
BA-35	LKD	47%	99%	46%	99%	Non-compliant
BA-35	Bedroom 1	100%	100%	100%	100%	Compliant
BA-36	LKD	41%	96%	40%	95%	Non-compliant
BA-36	Bedroom 1	100%	100%	100%	100%	Compliant
BA-37	LKD	99%	99%	99%	99%	Compliant
BA-37	Bedroom 1	100%	100%	100%	100%	Compliant
BA-37	Bedroom 2	100%	100%	100%	100%	Compliant
BA-38	LKD	72%	100%	72%	100%	Compliant
BA-38	Bedroom 1	100%	100%	100%	100%	Compliant
BA-38	Bedroom 2	100%	100%	100%	100%	Compliant

D.1.5 Supplementary SDA Results (I.S. EN 17037 criteria): Block B/Ground Floor

Table No. D.1.5 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-39	LKD	71%	98%	67%	98%	Compliant
BB-39	Bedroom1	88%	100%	79%	100%	Compliant
BB-39	Bedroom2	100%	100%	100%	100%	Compliant
BB-40	LKD	36%	88%	34%	84%	Non-compliant
BB-40	Bedroom1	100%	100%	100%	100%	Compliant
BB-41	LKD	31%	70%	29%	67%	Non-compliant
BB-41	Bedroom1	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.5 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-42	LKD	42%	100%	27%	98%	Non-compliant
BB-42	Bedroom1	95%	100%	90%	100%	Compliant
BB-43	LKD	43%	85%	12%	65%	Non-compliant
BB-43	Bedroom1	78%	100%	42%	100%	Trees affecting compliance
BB-43	Bedroom2	74%	100%	33%	100%	Trees affecting compliance
BB-44	LKD	42%	91%	29%	76%	Non-compliant
BB-44	Bedroom1	100%	100%	98%	100%	Compliant
BB-45	LKD	44%	86%	39%	83%	Non-compliant
BB-45	Bedroom1	100%	100%	65%	100%	Compliant
BB-45	Bedroom2	69%	100%	60%	100%	Compliant
BB-46	LKD	51%	95%	46%	87%	Trees affecting compliance
BB-46	Bedroom1	100%	100%	100%	100%	Compliant
BB-46	Bedroom2	61%	100%	58%	100%	Compliant
BB-47	LKD	43%	91%	40%	86%	Non-compliant
BB-47	Bedroom1	100%	100%	100%	100%	Compliant
BB-48	LKD	46%	89%	41%	83%	Non-compliant
BB-48	Bedroom1	92%	100%	69%	100%	Compliant
BB-48	Bedroom2	78%	100%	69%	100%	Compliant

D.1.6 Supplementary SDA Results (I.S. EN 17037 criteria): Block B/First Floor

Table No. D.1.6 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-49	LKD	64%	99%	63%	99%	Compliant
BB-49	Bedroom1	100%	100%	100%	100%	Compliant
BB-49	Bedroom2	100%	100%	100%	100%	Compliant
BB-50	LKD	76%	98%	75%	98%	Compliant
BB-50	Bedroom1	100%	100%	100%	100%	Compliant
BB-50	Bedroom2	100%	100%	100%	100%	Compliant
BB-51	LKD	42%	96%	42%	96%	Non-compliant
BB-51	Bedroom1	100%	100%	100%	100%	Compliant
BB-52	LKD	43%	92%	42%	90%	Non-compliant
BB-52	Bedroom1	100%	100%	100%	100%	Compliant
BB-53	LKD	54%	100%	47%	100%	Trees affecting compliance
BB-53	Bedroom1	100%	100%	100%	100%	Compliant
BB-54	LKD	52%	94%	35%	77%	Non-compliant
BB-54	Bedroom1	100%	100%	89%	100%	Compliant
BB-54	Bedroom2	100%	100%	72%	100%	Compliant
BB-55	LKD	49%	97%	41%	92%	Non-compliant
BB-55	Bedroom1	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.6 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-56	LKD	59%	98%	54%	94%	Trees affecting compliance
BB-56	Bedroom1	100%	100%	100%	100%	Compliant
BB-56	Bedroom2	100%	100%	100%	100%	Compliant
BB-57	LKD	63%	100%	59%	100%	Compliant
BB-57	Bedroom1	100%	100%	100%	100%	Compliant
BB-57	Bedroom2	99%	100%	97%	100%	Compliant
BB-58	LKD	49%	99%	49%	98%	Non-compliant
BB-58	Bedroom1	100%	100%	100%	100%	Compliant
BB-59	LKD	54%	97%	53%	93%	Trees affecting compliance
BB-59	Bedroom1	100%	100%	100%	100%	Compliant
BB-59	Bedroom2	100%	100%	100%	100%	Compliant

D.1.7 Supplementary SDA Results (I.S. EN 17037 criteria): Block B/Second Floor

Table No. D.1.7 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-60	LKD	70%	100%	70%	100%	Compliant
BB-60	Bedroom1	100%	100%	100%	100%	Compliant
BB-60	Bedroom2	100%	100%	100%	100%	Compliant
BB-61	LKD	79%	98%	79%	98%	Compliant
BB-61	Bedroom1	100%	100%	100%	100%	Compliant
BB-61	Bedroom2	100%	100%	100%	100%	Compliant
BB-62	LKD	47%	98%	47%	98%	Non-compliant
BB-62	Bedroom1	100%	100%	100%	100%	Compliant
BB-63	LKD	47%	94%	46%	93%	Non-compliant
BB-63	Bedroom1	100%	100%	100%	100%	Compliant
BB-64	LKD	60%	100%	58%	100%	Compliant
BB-64	Bedroom1	100%	100%	100%	100%	Compliant
BB-65	LKD	56%	99%	53%	98%	Compliant
BB-65	Bedroom1	100%	100%	100%	100%	Compliant
BB-65	Bedroom2	100%	100%	100%	100%	Compliant
BB-66	LKD	53%	99%	50%	99%	Compliant
BB-66	Bedroom1	100%	100%	100%	100%	Compliant
BB-67	LKD	62%	99%	61%	99%	Compliant
BB-67	Bedroom1	100%	100%	100%	100%	Compliant
BB-67	Bedroom2	100%	100%	100%	100%	Compliant
BB-68	LKD	69%	100%	68%	100%	Compliant
BB-68	Bedroom1	100%	100%	100%	100%	Compliant
BB-68	Bedroom2	100%	100%	100%	100%	Compliant
BB-69	LKD	53%	100%	53%	100%	Compliant
BB-69	Bedroom1	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.7 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-70	LKD	61%	100%	59%	100%	Compliant
BB-70	Bedroom1	100%	100%	100%	100%	Compliant
BB-70	Bedroom2	100%	100%	100%	100%	Compliant

D.1.8 Supplementary SDA Results (I.S. EN 17037 criteria): Block B/Third Floor

Table No. D.1.8 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
BB-71	LKD	73%	100%	73%	100%	Compliant
BB-71	Bedroom1	100%	100%	100%	100%	Compliant
BB-71	Bedroom2	100%	100%	100%	100%	Compliant
BB-72	LKD	93%	98%	92%	98%	Compliant
BB-72	Bedroom1	100%	100%	100%	100%	Compliant
BB-72	Bedroom2	100%	100%	100%	100%	Compliant
BB-73	LKD	49%	98%	48%	98%	Non-compliant
BB-73	Bedroom1	100%	100%	100%	100%	Compliant
BB-74	LKD	48%	96%	48%	96%	Non-compliant
BB-74	Bedroom1	100%	100%	100%	100%	Compliant
BB-75	LKD	66%	100%	64%	100%	Compliant
BB-75	Bedroom1	100%	100%	100%	100%	Compliant
BB-76	LKD	60%	100%	59%	100%	Compliant
BB-76	Bedroom1	100%	100%	100%	100%	Compliant
BB-76	Bedroom2	100%	100%	100%	100%	Compliant
BB-77	LKD	55%	100%	55%	100%	Compliant
BB-77	Bedroom1	100%	100%	100%	100%	Compliant
BB-78	LKD	65%	100%	64%	100%	Compliant
BB-78	Bedroom1	100%	100%	100%	100%	Compliant
BB-78	Bedroom2	100%	100%	100%	100%	Compliant
BB-79	LKD	73%	100%	73%	100%	Compliant
BB-79	Bedroom1	100%	100%	100%	100%	Compliant
BB-79	Bedroom2	100%	100%	100%	100%	Compliant
BB-80	LKD	58%	100%	56%	100%	Compliant
BB-80	Bedroom1	100%	100%	100%	100%	Compliant
BB-81	LKD	64%	100%	64%	100%	Compliant
BB-81	Bedroom1	100%	100%	100%	100%	Compliant
BB-81	Bedroom2	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

D.1.9 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block C/Ground Floor

Table No. D.1.11 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex C-104	LKD	69%	100%	45%	100%	Trees affecting compliance
Duplex C-104	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex C-104	Bedroom 2	19%	51%	16%	47%	Non-compliant
Duplex C-106	LKD	41%	100%	38%	100%	Non-compliant
Duplex C-106	Bedroom 1	82%	100%	67%	100%	Compliant
Duplex C-106	Bedroom 2	13%	54%	13%	41%	Non-compliant
Duplex C-108	LKD	40%	99%	36%	99%	Non-compliant
Duplex C-108	Bedroom 1	81%	100%	67%	100%	Compliant
Duplex C-108	Bedroom 2	19%	51%	19%	49%	Non-compliant
Duplex C-110	LKD	75%	100%	66%	100%	Compliant
Duplex C-110	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex C-110	Bedroom 2	15%	54%	13%	44%	Non-compliant

D.1.10 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block C/First Floor

Table No. D.1.11 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex C-105	LKD	71%	100%	64%	100%	Compliant
Duplex C-105	Bedroom 1	35%	100%	28%	100%	Non-compliant
Duplex C-107	LKD	73%	100%	70%	100%	Compliant
Duplex C-107	Bedroom 1	36%	100%	33%	100%	Non-compliant
Duplex C-109	LKD	75%	100%	71%	100%	Compliant
Duplex C-109	Bedroom 1	40%	100%	32%	100%	Non-compliant
Duplex C-111	LKD	72%	100%	69%	100%	Compliant
Duplex C-111	Bedroom 1	34%	99%	30%	99%	Non-compliant

D.1.11 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block C/Second Floor

Table No. D.1.11 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex C-105	Bedroom 2	22%	98%	22%	97%	Non-compliant
Duplex C-105	Bedroom 3	43%	93%	40%	92%	Non-compliant
Duplex C-107	Bedroom 2	24%	99%	24%	99%	Non-compliant
Duplex C-107	Bedroom 3	29%	81%	29%	81%	Non-compliant
Duplex C-109	Bedroom 2	18%	100%	18%	100%	Non-compliant
Duplex C-109	Bedroom 3	29%	81%	29%	79%	Non-compliant
Duplex C-111	Bedroom 2	22%	98%	22%	98%	Non-compliant
Duplex C-111	Bedroom 3	43%	92%	39%	90%	Non-compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

D.1.12 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block D/Ground Floor

Table No. D.1.13 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex D-112	LKD	67%	100%	65%	100%	Compliant
Duplex D-112	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex D-112	Bedroom 2	19%	51%	14%	40%	Non-compliant
Duplex D-114	LKD	38%	99%	34%	99%	Non-compliant
Duplex D-114	Bedroom 1	93%	100%	73%	100%	Compliant
Duplex D-114	Bedroom 2	13%	56%	13%	44%	Non-compliant
Duplex D-116	LKD	34%	98%	32%	97%	Non-compliant
Duplex D-116	Bedroom 1	86%	100%	74%	100%	Compliant
Duplex D-116	Bedroom 2	19%	51%	19%	47%	Non-compliant
Duplex D-118	LKD	29%	90%	28%	90%	Non-compliant
Duplex D-118	Bedroom 1	98%	100%	81%	100%	Compliant
Duplex D-118	Bedroom 2	15%	62%	13%	49%	Non-compliant
Duplex D-120	LKD	77%	100%	69%	100%	Compliant
Duplex D-120	Bedroom 1	61%	100%	53%	100%	Compliant
Duplex D-120	Bedroom 2	100%	100%	93%	100%	Compliant
Duplex D-121	LKD	88%	100%	67%	100%	Compliant
Duplex D-121	Bedroom 1	60%	100%	49%	100%	Trees affecting compliance
Duplex D-121	Bedroom 2	100%	100%	100%	100%	Compliant
Duplex D-126	LKD	21%	80%	20%	79%	Non-compliant
Duplex D-126	Bedroom 1	82%	100%	64%	100%	Compliant
Duplex D-126	Bedroom 2	23%	47%	19%	42%	Non-compliant
Duplex D-128	LKD	68%	100%	59%	100%	Compliant
Duplex D-128	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex D-128	Bedroom 2	15%	46%	13%	36%	Non-compliant

D.1.13 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block D/First Floor

Table No. D.1.13 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex D-113	LKD	66%	100%	63%	100%	Compliant
Duplex D-113	Bedroom 1	46%	100%	37%	100%	Non-compliant
Duplex D-115	LKD	64%	100%	62%	100%	Compliant
Duplex D-115	Bedroom 1	36%	100%	31%	100%	Non-compliant
Duplex D-117	LKD	58%	100%	56%	100%	Compliant
Duplex D-117	Bedroom 1	40%	100%	40%	100%	Non-compliant
Duplex D-119	LKD	49%	100%	49%	100%	Non-compliant
Duplex D-119	Bedroom 1	38%	100%	34%	100%	Non-compliant
Duplex D-122	LKD	92%	100%	85%	100%	Compliant
Duplex D-122	Bedroom 1	70%	100%	53%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.15 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex D-123	LKD	100%	100%	97%	100%	Compliant
Duplex D-123	Bedroom 1	95%	100%	86%	100%	Compliant
Duplex D-127	LKD	35%	100%	35%	100%	Non-compliant
Duplex D-127	Bedroom 1	58%	100%	46%	100%	Trees affecting compliance
Duplex D-129	LKD	39%	100%	38%	100%	Non-compliant
Duplex D-129	Bedroom 1	66%	100%	54%	100%	Compliant

D.1.14 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block D/Second Floor

Table No. D.1.15 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex D-113	Bedroom 2	22%	93%	22%	88%	Non-compliant
Duplex D-113	Bedroom 3	32%	89%	32%	89%	Non-compliant
Duplex D-115	Bedroom 2	24%	97%	24%	97%	Non-compliant
Duplex D-115	Bedroom 3	31%	81%	29%	81%	Non-compliant
Duplex D-117	Bedroom 2	18%	94%	18%	90%	Non-compliant
Duplex D-117	Bedroom 3	29%	81%	29%	81%	Non-compliant
Duplex D-119	Bedroom 2	22%	93%	22%	86%	Non-compliant
Duplex D-119	Bedroom 3	31%	81%	29%	81%	Non-compliant
Duplex D-124	LKD	97%	100%	93%	100%	Compliant
Duplex D-124	Bedroom 1	88%	100%	80%	100%	Compliant
Duplex D-125	LKD	100%	100%	100%	100%	Compliant
Duplex D-125	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex D-127	Bedroom 2	13%	41%	13%	41%	Non-compliant
Duplex D-127	Bedroom 3	33%	83%	33%	83%	Non-compliant
Duplex D-129	Bedroom 2	16%	44%	16%	44%	Non-compliant
Duplex D-129	Bedroom 3	36%	89%	36%	89%	Non-compliant

D.1.15 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block E/Ground Floor

Table No. D.1.15 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex E-184	LKD	91%	100%	87%	100%	Compliant
Duplex E-184	Bedroom 1	100%	100%	98%	100%	Compliant
Duplex E-184	Bedroom 2	14%	40%	9%	33%	Non-compliant
Duplex E-186	LKD	47%	100%	46%	100%	Non-compliant
Duplex E-186	Bedroom 1	46%	100%	35%	100%	Non-compliant
Duplex E-186	Bedroom 2	10%	31%	8%	26%	Non-compliant
Duplex E-188	LKD	61%	100%	51%	91%	Trees affecting compliance
Duplex E-188	Bedroom 1	23%	100%	14%	97%	Non-compliant
Duplex E-188	Bedroom 2	24%	100%	10%	100%	Non-compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.16 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex E-189	LKD	71%	100%	53%	100%	Compliant
Duplex E-189	Bedroom 1	53%	100%	49%	100%	Trees affecting compliance
Duplex E-189	Bedroom 2	100%	100%	100%	100%	Compliant
Duplex E-194	LKD	38%	98%	37%	98%	Non-compliant
Duplex E-194	Bedroom 1	94%	100%	82%	100%	Compliant
Duplex E-194	Bedroom 2	19%	58%	19%	51%	Non-compliant
Duplex E-196	LKD	41%	100%	38%	99%	Non-compliant
Duplex E-196	Bedroom 1	100%	100%	96%	100%	Compliant
Duplex E-196	Bedroom 2	15%	67%	15%	64%	Non-compliant
Duplex E-198	LKD	38%	99%	37%	99%	Non-compliant
Duplex E-198	Bedroom 1	95%	100%	90%	100%	Compliant
Duplex E-198	Bedroom 2	19%	56%	19%	53%	Non-compliant
Duplex E-200	LKD	70%	100%	62%	100%	Compliant
Duplex E-200	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex E-200	Bedroom 2	15%	72%	15%	72%	Non-compliant

D.1.16 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block E/First Floor

Table No. D.1.16 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex E-185	LKD	99%	100%	98%	100%	Compliant
Duplex E-185	Bedroom 1	19%	100%	18%	100%	Non-compliant
Duplex E-187	LKD	94%	100%	93%	100%	Compliant
Duplex E-187	Bedroom 1	16%	100%	14%	100%	Non-compliant
Duplex E-190	LKD	73%	100%	70%	100%	Compliant
Duplex E-190	Bedroom 1	23%	100%	17%	100%	Non-compliant
Duplex E-191	LKD	96%	100%	78%	100%	Compliant
Duplex E-191	Bedroom 1	89%	100%	65%	100%	Compliant
Duplex E-195	LKD	67%	100%	65%	100%	Compliant
Duplex E-195	Bedroom 1	48%	100%	41%	100%	Non-compliant
Duplex E-197	LKD	65%	100%	64%	100%	Compliant
Duplex E-197	Bedroom 1	45%	100%	40%	100%	Non-compliant
Duplex E-199	LKD	65%	100%	63%	100%	Compliant
Duplex E-199	Bedroom 1	50%	100%	48%	100%	Trees affecting compliance
Duplex E-201	LKD	65%	100%	63%	100%	Compliant
Duplex E-201	Bedroom 1	62%	100%	57%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

D.1.17 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block E/Second Floor

Table No. D.1.17 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex E-185	Bedroom 2	25%	100%	25%	100%	Non-compliant
Duplex E-185	Bedroom 3	27%	82%	27%	82%	Non-compliant
Duplex E-187	Bedroom 2	27%	100%	27%	100%	Non-compliant
Duplex E-187	Bedroom 3	23%	73%	23%	71%	Non-compliant
Duplex E-192	LKD	78%	100%	76%	100%	Compliant
Duplex E-192	Bedroom 1	41%	100%	39%	100%	Non-compliant
Duplex E-193	LKD	98%	100%	93%	100%	Compliant
Duplex E-193	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex E-195	Bedroom 2	18%	99%	18%	98%	Non-compliant
Duplex E-195	Bedroom 3	33%	83%	31%	83%	Non-compliant
Duplex E-197	Bedroom 2	24%	97%	24%	95%	Non-compliant
Duplex E-197	Bedroom 3	33%	83%	33%	81%	Non-compliant
Duplex E-199	Bedroom 2	18%	96%	18%	95%	Non-compliant
Duplex E-199	Bedroom 3	33%	83%	33%	83%	Non-compliant
Duplex E-201	Bedroom 2	22%	93%	22%	85%	Non-compliant
Duplex E-201	Bedroom 3	36%	89%	36%	89%	Non-compliant

D.1.18 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block F/Ground Floor

Table No. D.1.18 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex F-202	LKD	68%	100%	65%	100%	Compliant
Duplex F-202	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-202	Bedroom 2	21%	65%	21%	63%	Non-compliant
Duplex F-204	LKD	38%	99%	36%	99%	Non-compliant
Duplex F-204	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-204	Bedroom 2	15%	72%	15%	72%	Non-compliant
Duplex F-206	LKD	36%	99%	33%	98%	Non-compliant
Duplex F-206	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-206	Bedroom 2	21%	65%	19%	58%	Non-compliant
Duplex F-208	LKD	37%	99%	32%	99%	Non-compliant
Duplex F-208	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-208	Bedroom 2	15%	72%	15%	64%	Non-compliant
Duplex F-210	LKD	36%	98%	32%	97%	Non-compliant
Duplex F-210	Bedroom 1	100%	100%	99%	100%	Compliant
Duplex F-210	Bedroom 2	21%	65%	21%	53%	Non-compliant
Duplex F-212	LKD	37%	99%	31%	97%	Non-compliant
Duplex F-212	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-212	Bedroom 2	15%	74%	15%	72%	Non-compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.19 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex F-214	LKD	37%	99%	31%	96%	Non-compliant
Duplex F-214	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-214	Bedroom 2	21%	63%	21%	63%	Non-compliant
Duplex F-216	LKD	38%	100%	33%	98%	Non-compliant
Duplex F-216	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-216	Bedroom 2	15%	72%	15%	72%	Non-compliant
Duplex F-218	LKD	38%	99%	30%	97%	Non-compliant
Duplex F-218	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-218	Bedroom 2	21%	65%	21%	65%	Non-compliant
Duplex F-220	LKD	75%	100%	69%	100%	Compliant
Duplex F-220	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex F-220	Bedroom 2	15%	74%	15%	74%	Non-compliant

D.1.19 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block F/First Floor

Table No. D.1.19 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex F-203	LKD	63%	100%	61%	100%	Compliant
Duplex F-203	Bedroom 1	51%	100%	50%	100%	Compliant
Duplex F-205	LKD	65%	100%	64%	100%	Compliant
Duplex F-205	Bedroom 1	61%	100%	60%	100%	Compliant
Duplex F-207	LKD	63%	100%	61%	100%	Compliant
Duplex F-207	Bedroom 1	56%	100%	56%	100%	Compliant
Duplex F-209	LKD	64%	100%	62%	100%	Compliant
Duplex F-209	Bedroom 1	62%	100%	60%	100%	Compliant
Duplex F-211	LKD	63%	100%	60%	100%	Compliant
Duplex F-211	Bedroom 1	56%	100%	52%	100%	Compliant
Duplex F-213	LKD	64%	100%	60%	100%	Compliant
Duplex F-213	Bedroom 1	58%	100%	58%	100%	Compliant
Duplex F-215	LKD	64%	100%	60%	100%	Compliant
Duplex F-215	Bedroom 1	61%	100%	57%	100%	Compliant
Duplex F-217	LKD	66%	100%	62%	100%	Compliant
Duplex F-217	Bedroom 1	63%	100%	62%	100%	Compliant
Duplex F-219	LKD	67%	100%	59%	100%	Compliant
Duplex F-219	Bedroom 1	61%	100%	61%	100%	Compliant
Duplex F-221	LKD	65%	100%	60%	100%	Compliant
Duplex F-221	Bedroom 1	56%	100%	54%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14. For floor plans of the assessed units please refer to section C.1 on page 45.

D.1.20 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block F/Second Floor

Table No. D.1.20 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex F-203	Bedroom 2	22%	89%	22%	86%	Non-compliant
Duplex F-203	Bedroom 3	47%	96%	46%	96%	Non-compliant
Duplex F-205	Bedroom 2	24%	97%	24%	95%	Non-compliant
Duplex F-205	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-207	Bedroom 2	18%	98%	18%	96%	Non-compliant
Duplex F-207	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-209	Bedroom 2	24%	98%	24%	95%	Non-compliant
Duplex F-209	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-211	Bedroom 2	18%	99%	18%	98%	Non-compliant
Duplex F-211	Bedroom 3	33%	83%	33%	83%	Non-compliant
Duplex F-213	Bedroom 2	24%	98%	24%	97%	Non-compliant
Duplex F-213	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-215	Bedroom 2	18%	96%	18%	95%	Non-compliant
Duplex F-215	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-217	Bedroom 2	24%	98%	24%	95%	Non-compliant
Duplex F-217	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-219	Bedroom 2	18%	98%	18%	96%	Non-compliant
Duplex F-219	Bedroom 3	33%	85%	33%	85%	Non-compliant
Duplex F-221	Bedroom 2	22%	91%	22%	78%	Non-compliant
Duplex F-221	Bedroom 3	46%	99%	46%	99%	Non-compliant

D.1.21 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block G/Ground Floor

Table No. D.1.21 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex G-222	LKD	71%	100%	67%	100%	Compliant
Duplex G-222	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-222	Bedroom 2	21%	65%	19%	65%	Non-compliant
Duplex G-224	LKD	38%	100%	35%	99%	Non-compliant
Duplex G-224	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-224	Bedroom 2	15%	72%	15%	69%	Non-compliant
Duplex G-226	LKD	36%	99%	33%	98%	Non-compliant
Duplex G-226	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-226	Bedroom 2	19%	58%	19%	58%	Non-compliant
Duplex G-228	LKD	28%	92%	27%	89%	Non-compliant
Duplex G-228	Bedroom 1	100%	100%	99%	100%	Compliant
Duplex G-228	Bedroom 2	15%	74%	15%	69%	Non-compliant
Duplex G-230	LKD	80%	100%	72%	100%	Compliant
Duplex G-230	Bedroom 1	69%	100%	56%	100%	Compliant
Duplex G-230	Bedroom 2	100%	100%	100%	100%	Compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.22 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex G-231	LKD	100%	100%	99%	100%	Compliant
Duplex G-231	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-231	Bedroom 2	100%	100%	100%	100%	Compliant
Duplex G-236	LKD	22%	79%	21%	79%	Non-compliant
Duplex G-236	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-236	Bedroom 2	28%	86%	28%	86%	Non-compliant
Duplex G-238	LKD	74%	100%	69%	100%	Compliant
Duplex G-238	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-238	Bedroom 2	23%	85%	21%	85%	Non-compliant

D.1.22 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block G/First Floor

Table No. D.1.22 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex G-223	LKD	61%	100%	58%	100%	Compliant
Duplex G-223	Bedroom 1	86%	100%	84%	100%	Compliant
Duplex G-225	LKD	60%	100%	57%	100%	Compliant
Duplex G-225	Bedroom 1	70%	100%	68%	100%	Compliant
Duplex G-227	LKD	54%	100%	54%	100%	Compliant
Duplex G-227	Bedroom 1	71%	100%	68%	100%	Compliant
Duplex G-229	LKD	48%	100%	47%	100%	Non-compliant
Duplex G-229	Bedroom 1	65%	100%	55%	100%	Compliant
Duplex G-232	LKD	98%	100%	88%	100%	Compliant
Duplex G-232	Bedroom 1	82%	100%	59%	100%	Compliant
Duplex G-233	LKD	100%	100%	100%	100%	Compliant
Duplex G-233	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-237	LKD	36%	100%	36%	100%	Non-compliant
Duplex G-237	Bedroom 1	100%	100%	99%	100%	Compliant
Duplex G-239	LKD	39%	100%	39%	100%	Non-compliant
Duplex G-239	Bedroom 1	100%	100%	99%	100%	Compliant

D.1.23 Supplementary SDA Results (I.S. EN 17037 criteria): Duplex Block G/Second Floor

Table No. D.1.23 - Supplementary SDA Results (I.S. EN 17037 criteria):						
Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex G-223	Bedroom 2	22%	75%	21%	72%	Non-compliant
Duplex G-223	Bedroom 3	36%	95%	36%	95%	Non-compliant
Duplex G-225	Bedroom 2	23%	84%	20%	80%	Non-compliant
Duplex G-225	Bedroom 3	33%	88%	33%	88%	Non-compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.1.23 - Supplementary SDA Results (I.S. EN 17037 criteria):

Unit Number	Room Description	No Trees		With Trees		Compliance with I.S. EN 17037 Criteria*
		Area above 300 Lux*	Area above 100 Lux*	Area above 300 Lux*	Area above 100 Lux*	
Duplex G-227	Bedroom 2	15%	78%	15%	66%	Non-compliant
Duplex G-227	Bedroom 3	33%	88%	33%	88%	Non-compliant
Duplex G-229	Bedroom 2	20%	72%	20%	66%	Non-compliant
Duplex G-229	Bedroom 3	33%	90%	33%	88%	Non-compliant
Duplex G-234	LKD	99%	100%	97%	100%	Compliant
Duplex G-234	Bedroom 1	98%	100%	97%	100%	Compliant
Duplex G-235	LKD	100%	100%	100%	100%	Compliant
Duplex G-235	Bedroom 1	100%	100%	100%	100%	Compliant
Duplex G-237	Bedroom 2	13%	44%	13%	44%	Non-compliant
Duplex G-237	Bedroom 3	40%	96%	40%	94%	Non-compliant
Duplex G-239	Bedroom 2	16%	46%	16%	45%	Non-compliant
Duplex G-239	Bedroom 3	45%	100%	43%	95%	Non-compliant

* For information regarding the criteria under the various guidelines including target Lux please refer to section 2.5.1 on page 14.
For floor plans of the assessed units please refer to section C.1 on page 45.

D.2 Supplementary No Sky Line (NSL) assessment in proposed units.

Below is an example of the table used to describe the supplementary assessment results for 'No Sky Line' in proposed units.

Table Example. D.2 - Supplementary Scheme Performance NSL			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%
A	B	C	D

A: Unit Number

This column identifies the assessed unit. All unit numbers are determined by the architect's drawings, unless otherwise stated.

B: Room Description

Room Description details which room in the unit has been assessed, e.g. bedroom, LKD, etc.

C: % of room where the sky is visible from the working plane

This column states the percentage of the room from which there is a direct line of sight to the sky when assessed at the working plane height, which is 850mm above the finished floor level in residential rooms or 700mm above the finished floor level in offices or classrooms.

D: Above 80%

Whilst the BRE Guidelines only provide recommendations for NSL in the context of an impact analysis, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."

If this column states: 'Yes', it signifies that the sky will be visible from more than 80% of the working plane.

If this column states: 'No', it signifies that the sky will be visible from less than 80% of the working plane and supplementary electric lighting may be required.

D.2.1 Supplementary NSL Results: Block A/Ground Floor

Table No. D.2.1 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-01	LKD	99%	Yes
BA-01	Bedroom 1	99%	Yes
BA-01	Bedroom 2	99%	Yes
BA-02	LKD	97%	Yes
BA-02	Bedroom 1	97%	Yes
BA-03	LKD	99%	Yes
BA-03	Bedroom 1	100%	Yes
BA-03	Bedroom 2	99%	Yes
BA-04	LKD	99%	Yes
BA-04	Bedroom 1	99%	Yes
BA-04	Bedroom 2	99%	Yes
BA-05	LKD	97%	Yes
BA-05	Bedroom 1	98%	Yes
Creche	Classroom 1	100%	Yes
Creche	Classroom 2	97%	Yes
Creche	Classroom 3	100%	Yes
Creche	Classroom 4	100%	Yes

D.2.2 Supplementary NSL Results: Block A/First Floor

Table No. D.2.2 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-06	LKD	99%	Yes
BA-06	Bedroom 1	99%	Yes
BA-06	Bedroom 2	99%	Yes
BA-07	LKD	97%	Yes
BA-07	Bedroom 1	97%	Yes
BA-08	LKD	99%	Yes
BA-08	Bedroom 1	100%	Yes
BA-08	Bedroom 2	99%	Yes
BA-09	LKD	98%	Yes
BA-09	Bedroom 1	100%	Yes
BA-09	Bedroom 2	99%	Yes
BA-10	LKD	97%	Yes
BA-10	Bedroom 1	97%	Yes
BA-11	LKD	98%	Yes
BA-11	Bedroom 1	99%	Yes
BA-11	Bedroom 2	99%	Yes
BA-12	LKD	99%	Yes
BA-12	Bedroom 1	93%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.2 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-13	LKD	97%	Yes
BA-13	Bedroom 1	100%	Yes
BA-14	LKD	97%	Yes
BA-14	Bedroom 1	100%	Yes
BA-15	LKD	100%	Yes
BA-15	Bedroom 1	98%	Yes
BA-15	Bedroom 2	100%	Yes
BA-16	LKD	98%	Yes
BA-16	Bedroom 1	99%	Yes
BA-16	Bedroom 2	100%	Yes

D.2.3 Supplementary NSL Results: Block A/Second Floor

Table No. D.2.3 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-17	LKD	99%	Yes
BA-17	Bedroom 1	99%	Yes
BA-17	Bedroom 2	99%	Yes
BA-18	LKD	97%	Yes
BA-18	Bedroom 1	97%	Yes
BA-19	LKD	99%	Yes
BA-19	Bedroom 1	100%	Yes
BA-19	Bedroom 2	99%	Yes
BA-20	LKD	98%	Yes
BA-20	Bedroom 1	100%	Yes
BA-20	Bedroom 2	99%	Yes
BA-21	LKD	97%	Yes
BA-21	Bedroom 1	97%	Yes
BA-22	LKD	98%	Yes
BA-22	Bedroom 1	99%	Yes
BA-22	Bedroom 2	99%	Yes
BA-23	LKD	99%	Yes
BA-23	Bedroom 1	93%	Yes
BA-24	LKD	97%	Yes
BA-24	Bedroom 1	100%	Yes
BA-25	LKD	98%	Yes
BA-25	Bedroom 1	100%	Yes
BA-26	LKD	100%	Yes
BA-26	Bedroom 1	98%	Yes
BA-26	Bedroom 2	100%	Yes
BA-27	LKD	98%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."

For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.3 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-27	Bedroom 1	99%	Yes
BA-27	Bedroom 2	100%	Yes
BA-28	LKD	99%	Yes
BA-28	Bedroom 1	99%	Yes
BA-28	Bedroom 2	99%	Yes
BA-29	LKD	97%	Yes

D.2.4 Supplementary NSL Results: Block A/Third Floor

Table No. D.2.4 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BA-29	Bedroom 1	97%	Yes
BA-30	LKD	99%	Yes
BA-30	Bedroom 1	100%	Yes
BA-31	LKD	98%	Yes
BA-31	Bedroom 1	100%	Yes
BA-31	Bedroom 2	99%	Yes
BA-32	LKD	97%	Yes
BA-32	Bedroom 1	98%	Yes
BA-32	Bedroom 2	99%	Yes
BA-33	LKD	99%	Yes
BA-33	Bedroom 1	99%	Yes
BA-33	Bedroom 2	99%	Yes
BA-34	LKD	99%	Yes
BA-34	Bedroom 1	93%	Yes
BA-35	LKD	97%	Yes
BA-35	Bedroom 1	100%	Yes
BA-36	LKD	97%	Yes
BA-36	Bedroom 1	100%	Yes
BA-37	LKD	100%	Yes
BA-37	Bedroom 1	98%	Yes
BA-37	Bedroom 2	100%	Yes
BA-38	LKD	98%	Yes
BA-38	Bedroom 1	100%	Yes
BA-38	Bedroom 2	100%	Yes
BB-39	LKD	100%	Yes
BB-39	Bedroom1	98%	Yes
BB-39	Bedroom2	100%	Yes
BB-40	LKD	98%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

D.2.5 Supplementary NSL Results: Block B/Ground Floor

Table No. D.2.5 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-40	Bedroom1	99%	Yes
BB-41	LKD	97%	Yes
BB-41	Bedroom1	100%	Yes
BB-42	LKD	99%	Yes
BB-42	Bedroom1	94%	Yes
BB-43	LKD	99%	Yes
BB-43	Bedroom1	99%	Yes
BB-43	Bedroom2	99%	Yes
BB-44	LKD	97%	Yes
BB-44	Bedroom1	98%	Yes
BB-45	LKD	97%	Yes
BB-45	Bedroom1	99%	Yes
BB-45	Bedroom2	99%	Yes
BB-46	LKD	94%	Yes
BB-46	Bedroom1	100%	Yes
BB-46	Bedroom2	99%	Yes
BB-47	LKD	97%	Yes
BB-47	Bedroom1	97%	Yes
BB-48	LKD	98%	Yes
BB-48	Bedroom1	99%	Yes
BB-48	Bedroom2	99%	Yes
BB-49	LKD	98%	Yes
BB-49	Bedroom1	99%	Yes
BB-49	Bedroom2	99%	Yes
BB-50	LKD	100%	Yes

D.2.6 Supplementary NSL Results: Block B/First Floor

Table No. D.2.6 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-50	Bedroom1	98%	Yes
BB-50	Bedroom2	100%	Yes
BB-51	LKD	98%	Yes
BB-51	Bedroom1	100%	Yes
BB-52	LKD	97%	Yes
BB-52	Bedroom1	100%	Yes
BB-53	LKD	99%	Yes
BB-53	Bedroom1	94%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.7 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-54	LKD	99%	Yes
BB-54	Bedroom1	99%	Yes
BB-54	Bedroom2	99%	Yes
BB-55	LKD	97%	Yes
BB-55	Bedroom1	98%	Yes
BB-56	LKD	98%	Yes
BB-56	Bedroom1	99%	Yes
BB-56	Bedroom2	99%	Yes
BB-57	LKD	99%	Yes
BB-57	Bedroom1	100%	Yes
BB-57	Bedroom2	99%	Yes
BB-58	LKD	97%	Yes
BB-58	Bedroom1	97%	Yes
BB-59	LKD	98%	Yes
BB-59	Bedroom1	99%	Yes
BB-59	Bedroom2	99%	Yes
BB-60	LKD	98%	Yes
BB-60	Bedroom1	99%	Yes
BB-60	Bedroom2	99%	Yes
BB-61	LKD	100%	Yes

D.2.7 Supplementary NSL Results: Block B/Second Floor

Table No. D.2.7 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-61	Bedroom1	98%	Yes
BB-61	Bedroom2	100%	Yes
BB-62	LKD	98%	Yes
BB-62	Bedroom1	100%	Yes
BB-63	LKD	97%	Yes
BB-63	Bedroom1	100%	Yes
BB-64	LKD	99%	Yes
BB-64	Bedroom1	94%	Yes
BB-65	LKD	99%	Yes
BB-65	Bedroom1	99%	Yes
BB-65	Bedroom2	99%	Yes
BB-66	LKD	97%	Yes
BB-66	Bedroom1	98%	Yes
BB-67	LKD	98%	Yes
BB-67	Bedroom1	100%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.8 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-67	Bedroom2	99%	Yes
BB-68	LKD	99%	Yes
BB-68	Bedroom1	100%	Yes
BB-68	Bedroom2	99%	Yes
BB-69	LKD	97%	Yes
BB-69	Bedroom1	97%	Yes
BB-70	LKD	99%	Yes
BB-70	Bedroom1	99%	Yes
BB-70	Bedroom2	99%	Yes
BB-71	LKD	98%	Yes
BB-71	Bedroom1	100%	Yes
BB-71	Bedroom2	100%	Yes
BB-72	LKD	100%	Yes

D.2.8 Supplementary NSL Results: Block B/Third Floor

Table No. D.2.8 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
BB-72	Bedroom1	98%	Yes
BB-72	Bedroom2	100%	Yes
BB-73	LKD	98%	Yes
BB-73	Bedroom1	100%	Yes
BB-74	LKD	97%	Yes
BB-74	Bedroom1	100%	Yes
BB-75	LKD	99%	Yes
BB-75	Bedroom1	94%	Yes
BB-76	LKD	99%	Yes
BB-76	Bedroom1	99%	Yes
BB-76	Bedroom2	100%	Yes
BB-77	LKD	97%	Yes
BB-77	Bedroom1	98%	Yes
BB-78	LKD	98%	Yes
BB-78	Bedroom1	100%	Yes
BB-78	Bedroom2	99%	Yes
BB-79	LKD	99%	Yes
BB-79	Bedroom1	100%	Yes
BB-79	Bedroom2	100%	Yes
BB-80	LKD	97%	Yes
BB-80	Bedroom1	98%	Yes
BB-81	LKD	99%	Yes
BB-81	Bedroom1	99%	Yes
BB-81	Bedroom2	100%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."

For floor plans of the assessed units please refer to section C.1 on page 45.

D.2.9 Supplementary NSL Results: Duplex Block C/Ground Floor

Table No. D.2.9 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex C-104	LKD	93%	Yes
Duplex C-104	Bedroom 1	99%	Yes
Duplex C-104	Bedroom 2	82%	Yes
Duplex C-106	LKD	96%	Yes
Duplex C-106	Bedroom 1	100%	Yes
Duplex C-106	Bedroom 2	82%	Yes
Duplex C-108	LKD	95%	Yes
Duplex C-108	Bedroom 1	100%	Yes
Duplex C-108	Bedroom 2	81%	Yes
Duplex C-110	LKD	96%	Yes
Duplex C-110	Bedroom 1	100%	Yes
Duplex C-110	Bedroom 2	82%	Yes

D.2.10 Supplementary NSL Results: Duplex Block C/First Floor

Table No. D.2.10 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex C-105	LKD	99%	Yes
Duplex C-105	Bedroom 1	91%	Yes
Duplex C-107	LKD	100%	Yes
Duplex C-107	Bedroom 1	90%	Yes
Duplex C-109	LKD	100%	Yes
Duplex C-109	Bedroom 1	90%	Yes
Duplex C-111	LKD	100%	Yes
Duplex C-111	Bedroom 1	91%	Yes

D.2.11 Supplementary NSL Results: Duplex Block C/Second Floor

Table No. D.2.11 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex C-105	Bedroom 2	91%	Yes
Duplex C-105	Bedroom 3	87%	Yes
Duplex C-107	Bedroom 2	92%	Yes
Duplex C-107	Bedroom 3	80%	Yes
Duplex C-109	Bedroom 2	92%	Yes
Duplex C-109	Bedroom 3	81%	Yes
Duplex C-111	Bedroom 2	91%	Yes
Duplex C-111	Bedroom 3	87%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

D.2.12 Supplementary NSL Results: Duplex Block D/Ground Floor

Table No. D.2.13 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex D-112	LKD	96%	Yes
Duplex D-112	Bedroom 1	100%	Yes
Duplex D-112	Bedroom 2	82%	Yes
Duplex D-114	LKD	96%	Yes
Duplex D-114	Bedroom 1	100%	Yes
Duplex D-114	Bedroom 2	82%	Yes
Duplex D-116	LKD	96%	Yes
Duplex D-116	Bedroom 1	100%	Yes
Duplex D-116	Bedroom 2	82%	Yes
Duplex D-118	LKD	91%	Yes
Duplex D-118	Bedroom 1	100%	Yes
Duplex D-118	Bedroom 2	82%	Yes
Duplex D-120	LKD	100%	Yes
Duplex D-120	Bedroom 1	98%	Yes
Duplex D-120	Bedroom 2	99%	Yes
Duplex D-121	LKD	94%	Yes
Duplex D-121	Bedroom 1	96%	Yes
Duplex D-121	Bedroom 2	98%	Yes
Duplex D-126	LKD	86%	Yes
Duplex D-126	Bedroom 1	97%	Yes
Duplex D-126	Bedroom 2	65%	No
Duplex D-128	LKD	98%	Yes
Duplex D-128	Bedroom 1	98%	Yes
Duplex D-128	Bedroom 2	77%	No

D.2.13 Supplementary NSL Results: Duplex Block D/First Floor

Table No. D.2.13 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex D-113	LKD	100%	Yes
Duplex D-113	Bedroom 1	96%	Yes
Duplex D-115	LKD	100%	Yes
Duplex D-115	Bedroom 1	95%	Yes
Duplex D-117	LKD	100%	Yes
Duplex D-117	Bedroom 1	96%	Yes
Duplex D-119	LKD	100%	Yes
Duplex D-119	Bedroom 1	95%	Yes
Duplex D-122	LKD	99%	Yes
Duplex D-122	Bedroom 1	99%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.14 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex D-123	LKD	99%	Yes
Duplex D-123	Bedroom 1	98%	Yes
Duplex D-127	LKD	99%	Yes
Duplex D-127	Bedroom 1	95%	Yes
Duplex D-129	LKD	100%	Yes
Duplex D-129	Bedroom 1	96%	Yes

D.2.14 Supplementary NSL Results: Duplex Block D/Second Floor

Table No. D.2.14 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex D-113	Bedroom 2	91%	Yes
Duplex D-113	Bedroom 3	83%	Yes
Duplex D-115	Bedroom 2	92%	Yes
Duplex D-115	Bedroom 3	80%	Yes
Duplex D-117	Bedroom 2	92%	Yes
Duplex D-117	Bedroom 3	81%	Yes
Duplex D-119	Bedroom 2	92%	Yes
Duplex D-119	Bedroom 3	80%	Yes
Duplex D-124	LKD	99%	Yes
Duplex D-124	Bedroom 1	99%	Yes
Duplex D-125	LKD	99%	Yes
Duplex D-125	Bedroom 1	98%	Yes
Duplex D-127	Bedroom 2	92%	Yes
Duplex D-127	Bedroom 3	81%	Yes
Duplex D-129	Bedroom 2	91%	Yes
Duplex D-129	Bedroom 3	82%	Yes

D.2.15 Supplementary NSL Results: Duplex Block E/Ground Floor

Table No. D.2.15 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex E-184	LKD	97%	Yes
Duplex E-184	Bedroom 1	97%	Yes
Duplex E-184	Bedroom 2	71%	No
Duplex E-186	LKD	86%	Yes
Duplex E-186	Bedroom 1	94%	Yes
Duplex E-186	Bedroom 2	59%	No

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.16 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex E-188	LKD	95%	Yes
Duplex E-188	Bedroom 1	93%	Yes
Duplex E-188	Bedroom 2	99%	Yes
Duplex E-189	LKD	100%	Yes
Duplex E-189	Bedroom 1	97%	Yes
Duplex E-189	Bedroom 2	97%	Yes
Duplex E-194	LKD	91%	Yes
Duplex E-194	Bedroom 1	99%	Yes
Duplex E-194	Bedroom 2	82%	Yes
Duplex E-196	LKD	96%	Yes
Duplex E-196	Bedroom 1	99%	Yes
Duplex E-196	Bedroom 2	81%	Yes
Duplex E-198	LKD	96%	Yes
Duplex E-198	Bedroom 1	99%	Yes
Duplex E-198	Bedroom 2	82%	Yes
Duplex E-200	LKD	96%	Yes
Duplex E-200	Bedroom 1	99%	Yes
Duplex E-200	Bedroom 2	81%	Yes

D.2.16 Supplementary NSL Results: Duplex Block E/First Floor

Table No. D.2.16 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex E-185	LKD	100%	Yes
Duplex E-185	Bedroom 1	95%	Yes
Duplex E-187	LKD	99%	Yes
Duplex E-187	Bedroom 1	95%	Yes
Duplex E-190	LKD	99%	Yes
Duplex E-190	Bedroom 1	99%	Yes
Duplex E-191	LKD	100%	Yes
Duplex E-191	Bedroom 1	98%	Yes
Duplex E-195	LKD	99%	Yes
Duplex E-195	Bedroom 1	95%	Yes
Duplex E-197	LKD	100%	Yes
Duplex E-197	Bedroom 1	95%	Yes
Duplex E-199	LKD	100%	Yes
Duplex E-199	Bedroom 1	95%	Yes
Duplex E-201	LKD	100%	Yes
Duplex E-201	Bedroom 1	96%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.17 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex E-185	Bedroom 2	91%	Yes
Duplex E-185	Bedroom 3	83%	Yes
Duplex E-187	Bedroom 2	92%	Yes
Duplex E-187	Bedroom 3	80%	Yes
Duplex E-192	LKD	99%	Yes
Duplex E-192	Bedroom 1	99%	Yes
Duplex E-193	LKD	99%	Yes
Duplex E-193	Bedroom 1	98%	Yes
Duplex E-195	Bedroom 2	92%	Yes
Duplex E-195	Bedroom 3	80%	Yes
Duplex E-197	Bedroom 2	92%	Yes
Duplex E-197	Bedroom 3	80%	Yes
Duplex E-199	Bedroom 2	92%	Yes
Duplex E-199	Bedroom 3	80%	Yes
Duplex E-201	Bedroom 2	91%	Yes
Duplex E-201	Bedroom 3	83%	Yes

D.2.17 Supplementary NSL Results: Duplex Block F/Ground Floor

Table No. D.2.17 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex F-202	LKD	96%	Yes
Duplex F-202	Bedroom 1	99%	Yes
Duplex F-202	Bedroom 2	82%	Yes
Duplex F-204	LKD	96%	Yes
Duplex F-204	Bedroom 1	99%	Yes
Duplex F-204	Bedroom 2	81%	Yes
Duplex F-206	LKD	96%	Yes
Duplex F-206	Bedroom 1	99%	Yes
Duplex F-206	Bedroom 2	82%	Yes
Duplex F-208	LKD	95%	Yes
Duplex F-208	Bedroom 1	99%	Yes
Duplex F-208	Bedroom 2	81%	Yes
Duplex F-210	LKD	96%	Yes
Duplex F-210	Bedroom 1	99%	Yes
Duplex F-210	Bedroom 2	82%	Yes
Duplex F-212	LKD	95%	Yes
Duplex F-212	Bedroom 1	99%	Yes
Duplex F-212	Bedroom 2	81%	Yes
Duplex F-214	LKD	96%	Yes
Duplex F-214	Bedroom 1	99%	Yes
Duplex F-214	Bedroom 2	82%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."

For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.18 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex F-216	LKD	96%	Yes
Duplex F-216	Bedroom 1	99%	Yes
Duplex F-216	Bedroom 2	81%	Yes
Duplex F-218	LKD	96%	Yes
Duplex F-218	Bedroom 1	99%	Yes
Duplex F-218	Bedroom 2	82%	Yes
Duplex F-220	LKD	96%	Yes
Duplex F-220	Bedroom 1	99%	Yes
Duplex F-220	Bedroom 2	81%	Yes

D.2.18 Supplementary NSL Results: Duplex Block F/First Floor

Table No. D.2.18 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex F-203	LKD	100%	Yes
Duplex F-203	Bedroom 1	93%	Yes
Duplex F-205	LKD	100%	Yes
Duplex F-205	Bedroom 1	93%	Yes
Duplex F-207	LKD	100%	Yes
Duplex F-207	Bedroom 1	93%	Yes
Duplex F-209	LKD	100%	Yes
Duplex F-209	Bedroom 1	93%	Yes
Duplex F-211	LKD	100%	Yes
Duplex F-211	Bedroom 1	92%	Yes
Duplex F-213	LKD	100%	Yes
Duplex F-213	Bedroom 1	92%	Yes
Duplex F-215	LKD	100%	Yes
Duplex F-215	Bedroom 1	93%	Yes
Duplex F-217	LKD	100%	Yes
Duplex F-217	Bedroom 1	93%	Yes
Duplex F-219	LKD	100%	Yes
Duplex F-219	Bedroom 1	93%	Yes
Duplex F-221	LKD	100%	Yes
Duplex F-221	Bedroom 1	93%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."

For floor plans of the assessed units please refer to section C.1 on page 45.

D.2.19 Supplementary NSL Results: Duplex Block F/Second Floor

Table No. D.2.19 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex F-203	Bedroom 2	91%	Yes
Duplex F-203	Bedroom 3	87%	Yes
Duplex F-205	Bedroom 2	92%	Yes
Duplex F-205	Bedroom 3	81%	Yes
Duplex F-207	Bedroom 2	92%	Yes
Duplex F-207	Bedroom 3	80%	Yes
Duplex F-209	Bedroom 2	92%	Yes
Duplex F-209	Bedroom 3	81%	Yes
Duplex F-211	Bedroom 2	92%	Yes
Duplex F-211	Bedroom 3	80%	Yes
Duplex F-213	Bedroom 2	92%	Yes
Duplex F-213	Bedroom 3	81%	Yes
Duplex F-215	Bedroom 2	92%	Yes
Duplex F-215	Bedroom 3	80%	Yes
Duplex F-217	Bedroom 2	92%	Yes
Duplex F-217	Bedroom 3	81%	Yes
Duplex F-219	Bedroom 2	92%	Yes
Duplex F-219	Bedroom 3	80%	Yes
Duplex F-221	Bedroom 2	91%	Yes
Duplex F-221	Bedroom 3	87%	Yes

D.2.20 Supplementary NSL Results: Duplex Block G/Ground Floor

Table No. D.2.20 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex G-222	LKD	96%	Yes
Duplex G-222	Bedroom 1	99%	Yes
Duplex G-222	Bedroom 2	82%	Yes
Duplex G-224	LKD	96%	Yes
Duplex G-224	Bedroom 1	99%	Yes
Duplex G-224	Bedroom 2	82%	Yes
Duplex G-226	LKD	96%	Yes
Duplex G-226	Bedroom 1	99%	Yes
Duplex G-226	Bedroom 2	81%	Yes
Duplex G-228	LKD	91%	Yes
Duplex G-228	Bedroom 1	99%	Yes
Duplex G-228	Bedroom 2	81%	Yes
Duplex G-230	LKD	99%	Yes
Duplex G-230	Bedroom 1	97%	Yes
Duplex G-230	Bedroom 2	98%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.21 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex G-231	LKD	99%	Yes
Duplex G-231	Bedroom 1	97%	Yes
Duplex G-231	Bedroom 2	97%	Yes
Duplex G-236	LKD	86%	Yes
Duplex G-236	Bedroom 1	100%	Yes
Duplex G-236	Bedroom 2	82%	Yes
Duplex G-238	LKD	99%	Yes
Duplex G-238	Bedroom 1	100%	Yes
Duplex G-238	Bedroom 2	81%	Yes

D.2.21 Supplementary NSL Results: Duplex Block G/First Floor

Table No. D.2.21 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex G-223	LKD	100%	Yes
Duplex G-223	Bedroom 1	96%	Yes
Duplex G-225	LKD	100%	Yes
Duplex G-225	Bedroom 1	95%	Yes
Duplex G-227	LKD	100%	Yes
Duplex G-227	Bedroom 1	95%	Yes
Duplex G-229	LKD	100%	Yes
Duplex G-229	Bedroom 1	95%	Yes
Duplex G-232	LKD	99%	Yes
Duplex G-232	Bedroom 1	99%	Yes
Duplex G-233	LKD	99%	Yes
Duplex G-233	Bedroom 1	98%	Yes
Duplex G-237	LKD	99%	Yes
Duplex G-237	Bedroom 1	95%	Yes
Duplex G-239	LKD	100%	Yes
Duplex G-239	Bedroom 1	96%	Yes

D.2.22 Supplementary NSL Results: Duplex Block G/Second Floor

Table No. D.2.22 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex G-223	Bedroom 2	91%	Yes
Duplex G-223	Bedroom 3	83%	Yes
Duplex G-225	Bedroom 2	92%	Yes
Duplex G-225	Bedroom 3	80%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

Table No. D.2.22 - Supplementary NSL Results:			
Unit Number	Room Description	No Sky Line (NSL)	
		% of room where the sky is visible from the working plane	Above 80%*
Duplex G-227	Bedroom 2	92%	Yes
Duplex G-227	Bedroom 3	81%	Yes
Duplex G-229	Bedroom 2	92%	Yes
Duplex G-229	Bedroom 3	80%	Yes
Duplex G-234	LKD	99%	Yes
Duplex G-234	Bedroom 1	99%	Yes
Duplex G-235	LKD	99%	Yes
Duplex G-235	Bedroom 1	98%	Yes
Duplex G-237	Bedroom 2	92%	Yes
Duplex G-237	Bedroom 3	80%	Yes
Duplex G-239	Bedroom 2	91%	Yes
Duplex G-239	Bedroom 3	83%	Yes

* Whilst the BRE Guidelines do not provide target values for NSL in a proposed development, section 2.2.10 states that "Supplementary electric lighting will be needed if a significant part of the working plane (20% of the room or more) lies beyond the no sky line."
For floor plans of the assessed units please refer to section C.1 on page 45.

E.0 Glossary

E.1 Terms and Definitions

Below is a list of daylight and sunlight terminology that may be used in this report depending on the assessments carried out.

Skylight

Non directional ambient light cast from the sky and environment.

Sunlight

Direct parallel rays of light emitted from the sun.

Daylight

Combined skylight and sunlight.

Overcast sky model

A completely overcast sky model, used for daylight calculation.

Cloudless sky model

A completely cloudless sky model, used for sunlight exposure calculation.

Model State

The model state is a term used to describe the configuration of the digital model used to run analysis. Model states will typically reflect a baseline state and a proposed or cumulative state. For a definition of the model states used in the analysis carried out in this report, please refer to "Preparing the analytical model" on page 10.

Vertical Sky Component (VSC)

Ratio of that part of illuminance, at a point on a given vertical plane, that is received directly from an overcast sky model, to illuminance on a horizontal plane due to an unobstructed hemisphere of this sky. Usually the 'given vertical plane' is the outside of a window wall. The VSC does not include reflected light, either from the ground or from other buildings.

Annual Probable Sunlight Hours (APSH) / Winter Probable Sunlight Hours (WPSH)

Annual Probable Sunlight Hours (APSH) and Winter Probable Sunlight Hours (WPSH) are a measure of sunlight that a given window may expect over a year period (1 Jan - 31 Dec), or the winter period (21 Sep - 21 Mar) respectively.

North facing windows may receive sunlight on only a handful of occasions in a year, and windows facing eastwards or westwards will receive sunlight only at certain times of the day. Taking this into account, section 3.2.9 of the BRE Guidelines suggest that windows with an orientation within 90 degrees of due north need not be assessed.

Sun On Ground (SOG)

Assessment of what portion of a garden or amenity space is capable of receiving 2 hours or more of direct sunlight on March 21st.

Sunlight Exposure (SE)

The number of hours of direct sunlight a room can expect to receive on a given date between February 1st and March 21st at a determined point on the windows.

Spatial Daylight Autonomy (SDA)

Spatial Daylight Autonomy assesses whether a space receives sufficient daylight on a working plane during standard operating hours on an annual basis. For compliance, the target value is achieved across 50% of the working plane for half of the occupied period.

No Sky Line (NSL)

The no sky line divides points on the working plane which can and cannot see the sky.

Working plane

Horizontal, vertical or inclined plane in which a visual task lies. Normally the working plane may be taken to be horizontal, 850 mm above the floor in houses and factories, 700 mm above the floor in offices. The plane is offset 300mm from the room boundaries under BR 209 criteria, and 500mm from the room boundaries under I.S. EN 17037 criteria.

LKD

Living / Kitchen / Dining room.

BRE Target Value

When assessing the effect a proposed development would have on a neighbouring property, a target value will be applied. This applied target value is generated as per the criteria set out for each study in the BRE Guidelines.

Alternative Target Value

It could be appropriate to use alternative target values when conducting assessment of effect on existing properties. If such instances occur the rationale will be clearly explained and the instances where the alternative target values have been applied will be clearly identified.

Level of BRE Compliance

Each table in the study that has a column identified as "Level of BRE Compliance", identifies how an assessed instance performs in relation to the appropriate target value. If the instance is in compliance with the recommendations as made in the BRE Guidelines the value will be expressed as "BRE Compliant". If the instance does not meet the criteria as set out in the BRE Guidelines a percentage will be expressed to determine the level of compliance with the recommendation. This value determines the definition of effect.

LUX

Lux is a standardised unit of measurement of light level intensity. A measurement of 1 lux is equal to the illumination of a one metre square surface that is one metre away from a single candle.

No Balcony Assessment

A 'No Balcony Assessment' is a hypothetical impact assessment carried out on a neighbouring window/room that is located underneath a balcony or overhanging element, such as a canopy. This assessment is conducted to understand what constraints the overhanging element is having on the potentially affected window.

E.2 Definition of Effects

Section H3 and H4 of the BRE Guidelines states that:

“Adverse impacts occur when there is a significant decrease in the amount of skylight and sunlight reaching an existing building where it is required, or in the amount of sunlight reaching an open space. The assessment of impact will depend on a combination of factors, and there is no simple rule of thumb that can be applied.”

As such, planning authorities should consider a range of localised factors when making decisions. The terminology suggested in section H6 of the BRE Guidelines is listed below, whilst the assessment of impact should depend on a combination of factors. The BRE Guidelines (section H2) also state:

“Where a new development affects a number of existing buildings or open spaces, the clearest approach is usually to assess the impact on each one separately. It is also clearer to assess skylight and sunlight impacts separately.”

Taking this advice, 3DDB have categorised the level of effect on each window/room/open space on an individual basis. In quantifying the levels of effect, 3DDB have assigned numerical values to the levels of compliance with the BRE recommendations. By applying a numerical logic to the terminology used in defining the levels of effect there is no ambiguity regarding how the levels of effect have been categorised within this report.

The list of definitions given below is taken from ‘Appendix H: Environmental impact assessment’ of the BR 209 with a clear indication of how they have been applied in the context of this report.

Negligible

For the purposes of this Sunlight and Daylight Assessment Report a ‘*Negligible*’ level of effect will be stated if the level of effect is within the criteria as recommended in the BRE Guidelines and the applied target value has been achieved.

Minor Adverse

For the purposes of this Sunlight and Daylight Assessment Report, a ‘*Minor Adverse*’ level of effect will be stated if the level of effect is marginally outside of the criteria as stated in the BRE Guidelines. Typically a ‘*Minor Adverse*’ level of effect will be applied if the level of daylight or sunlight is reduced to equal or greater than 80% and less than 100% of the applied target value.

Moderate Adverse

For the purposes of this Sunlight and Daylight Assessment Report, a ‘*Moderate Adverse*’ level of effect will be stated if the level of daylight or sunlight is reduced to equal or greater than 50% and less than 80% of the applied target value. ‘*Moderate Adverse*’ levels of effect are quite typical in instances where a proposed development is planned on an under-developed plot of land.

Major Adverse

An effect which, by its character, magnitude, duration or intensity alters a sensitive aspect of the environment. For the purposes of this Sunlight and Daylight Assessment Report a ‘*Major Adverse*’ level of effect will be stated if the proposed development reduces the availability of daylight or sunlight of a neighbouring property to significantly below a baseline level. A ‘*Major Adverse*’ level of effect will be stated if the level of daylight or sunlight is reduced to less than 50% of the applied target value.

Beneficial Impact

In relation to sunlight or daylight access, it is conceivable that a proposed development could yield positive effects on the neighbouring properties. In such circumstances the development would typically involve a reduction to the size or scale of built form (e.g. such as the demolition of a building or the removal of a large belt of evergreen trees, which might result in an increase in light access). Where such improvements occur, a ‘*Beneficial Impact*’ will only be stated if the ratio of change is greater than 1.20 (an improvement of 20%). Should less perceptible improvements occur a ‘*Negligible*’ level of effect will be stated.

Not Applicable (n.a.)

In instances where a baseline value is particularly low, levels of effects can appear exaggerated. To mitigate such occurrences, if the baseline value in the VSC, APSH/WPSH or SOG studies is below 1%, 3DDB have categorised the level of effect as n.a. (not applicable).

Averaged Windows (-)

If it can be determined or reasonably assumed that multiple windows are servicing the same room, each window will be assessed and a weighted average will be calculated. In such instances the level of effect for the room will be stated, but the level of effect for the individual windows contributing towards the average will be left blank in the table. This will be indicated in the tables with the dash symbol. (-)

E.3 Definition of Levels of Sunlight Exposure

For interiors, access to sunlight can be quantified. BR 209 recommends that a space should receive a minimum of 1.5 hours of direct sunlight on a selected date between 1 February and 21 March with cloudless conditions. It is suggested that 21 March (equinox) be used. The medium level of recommendation is three hours and the high level of recommendation four hours. For dwellings, at least one habitable room, preferably a main living room, should meet at least the minimum criterion.

Level of Sunlight Exposure:

The level of sunlight exposure will be stated for each assessed room in the tables under section “C.3 Sunlight Exposure (SE) in Proposed Units” on page 76. Below is a list of the terms used to categorise the levels of sunlight exposure:

Below Minimum

Sunlight exposure will be categorised as ‘below minimum’ if the potential sunlight for the assessed room is less than 1.5 hours on March 21st. Note: the recommendation is that a room within a proposed unit is capable of receiving 1.5 hours of direct sunlight on March 21st. If an individual room of a proposed unit does not achieve this recommendation, it does not mean that the unit is non compliant.

Minimum

A ‘minimum’ level of sunlight exposure will be stated if the potential sunlight for the assessed room is between 1.5 hours and 3 hours on March 21st.

Medium

A ‘medium’ level of sunlight exposure will be stated if the potential sunlight for the assessed room is between 3 hours and 4 hours on March 21st.

High

A ‘high’ level of sunlight exposure will be stated if the potential sunlight for the assessed room is greater than 4 hours on March 21st.

Unit Compliance:

In addition to the level of sunlight exposure expressed for each room, compliance will be stated on a unit-by-unit basis. A proposed unit is considered to be compliant if any habitable room within the unit is capable of receiving at least 1.5 hours of sunlight on the assessment date.

Non-Compliant

If no habitable rooms within a proposed unit can receive 1.5 hours of sunlight on the assessment date, the unit will be categorised as ‘Non-Compliant’.

Compliant

If at least one habitable room within a proposed unit can receive 1.5 hours or more of sunlight on the assessment date, the unit will be categorised as ‘Compliant’.

Typically unit compliance will be stated for the best performing room per unit only, with lesser performing rooms indicated with a dash (-). However, if more than one room in a given unit is considered to be the best performing room (i.e. they have the same number of SE hours on March 21st), then the unit compliance column will be populated in the first instance only.

F.0 Guidelines / Standards

Overview

Neither the British Standard, European Standard, British Annex to the European Standard nor the BRE Guidelines (BR 209) set out rigid standards or limits. They are all considered advisory documents. The BRE Guide is preceded by the following very clear statement as to how the design advice contained therein should be used:

"The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design."

That the recommendations of the BRE Guidelines are not suitable for rigid application to all developments in all contexts, is of particular importance in the context of national and local policies for the consolidation and densification of urban areas or when assessing applications for highly constrained sites (e.g. lands in close proximity or immediately to the south of residential lands). A compromise may have to be made concerning daylight and sunlight compliance to achieve national or local planning objectives.

It is the expert opinion of 3D Design Bureau, that the BRE Guidelines (BR 209) are the most appropriate guiding document for daylight and sunlight assessment. For daylight within proposed developments, a supplementary study has also been carried out under the criteria of *I.S. EN 17037*. The rationale for this opinion is outlined below.

BR 209 - Site Layout Planning for Daylight and Sunlight: a Guide to Good Practice (2022)

This document will be referred to as the *BRE Guidelines*, the *BRE Guide* or *BR 209* in this report.

At the time of writing this report, the BRE Guidelines are in the third edition (BR 209). The BRE Guidelines set out recommendations for appropriate levels of daylight and sunlight within a proposed development, as well as providing guidance on impacts arising from a proposed development to surrounding properties and amenity areas.

Upon publication of the 3rd Edition of the BR 209 (2022), the 2nd edition (2011) has been withdrawn. Among the updates from the 2nd to the 3rd edition are some changes in the recommended metrics to use for carrying out scheme performance assessments.

Daylight within proposed developments was previously assessed under the 2011 guidelines using an 'Average Daylight Factor' assessment (ADF). This has been replaced with a 'target illuminance assessment', also known as a 'Spatial Daylight Autonomy' assessment (SDA).

Sunlight within proposed developments was previously assessed under the 2011 guidelines using an 'Annual / Winter Probable Sunlight Hours' assessment (APSH/WPSH). This has been replaced with a 'Sunlight Exposure' assessment (SE). However, APSH/WPSH is still recommended for sunlight impact assessments.

As such, no ADF or APSH/WPSH assessment will be included as part of a scheme performance assessment under the updated guidelines.

Details of the criteria for new metrics, and all other relevant metrics, can be found in the methodology section on Page 8 of this report.

It is the expert opinion of 3D Design Bureau that the BRE Guidelines are the most appropriate guiding document for assessing daylight potential within a proposed development. The rationale for this opinion is outlined in the Dublin City Council development plan (2022-2028), which states:

"Prior to 2018, Ireland had no standard for daylight. In 2018, the National Standards Authority of Ireland adopted EN 17037 to directly become IS EN 17037. It is important to note that no amendments were made to this document and unlike BS EN 317037 [sic – likely intended to reference BS EN 17037], it does not contain a national annex. It offers only a single target for new buildings (there are no space by space targets – e.g. a kitchen would have the same target as a warehouse or office). It does not offer guidance on how new developments will impact on surrounding existing environments. These limitations make it unsuitable for use in planning policy or during planning applications. BR 209 must still be used for this purpose."

While the BRE Guidelines draws reference from BS EN 17037, there are some subtle differences between BR 209 and BS EN 17037. For the purposes of this report, the BRE Guidelines (BR 209) is considered the appropriate reference document.

A detailed description of the various recommendations for impact assessment and scheme performance is contained in section "2.3 Quantitative Impact Assessment Overview" on page 12 of this report.

EN 17037:2018: Daylight in Buildings (2018)

EN 17037 is a European Standard that provides recommendations for daylight within spaces. (Emphasis added)

EN 17037:2018 recommends that 300 lux should be received across 50% of a hypothetical reference plane of any room for half of the daylight hours of the year, with no less than 100 lux received across 95% of the reference plane. No distinction is made for the function of the room for target lux levels within this standard.

It is the opinion of 3D Design Bureau that these target values are less appropriate for proposed residential developments than the recommendations made in the BRE Guidelines, which apply room-specific target values for appropriate LUX levels.

Recommendations made in EN 17037 regarding Sunlight Exposure for proposed developments have been incorporated into the BRE Guidelines. As such, Sunlight Exposure is deemed the appropriate assessment for sunlight within habitable rooms of the proposed development.

EN 17037 also makes recommendations related to glare and quality of view out. These aspects are not addressed in this report as these assessments have less relevance in a residential context where occupants have the freedom to move about in order to improve level of glare or alter the view out.

I.S. EN 17037:2018 Daylight in Buildings (2018)

I.S. EN 17037 is a direct adoption of the European Standard *EN 17037:2018* that provides recommendations for daylight within spaces.

The target values given within *I.S. EN 17037* are directly adopted from *EN 17037*. As such, there are no room-specific recommendations for daylight. Because of these limitations, it is the expert opinion of 3D Design Bureau, that the recommendations made in the *BRE Guidelines* are more appropriate to use than those within *I.S. EN 17037*.

Regardless, a supplementary SDA study has been carried out on the proposed development using the criterion of *I.S. EN 17037*, with compliance rates stated. However, this should be considered a supplementary study.

BS EN 17037:2018: Daylight in Buildings (2018)

BS EN 17037 is the British Annex to the European Standard (see above). The British Annex acknowledges that a rigid application of the European Standard “may not be achievable”. It states “... *it is the opinion of the UK committee that the recommendations for daylight provision in a space [...] may not be achievable for some buildings, particularly dwellings.*”

In BS EN 17037, daylight recommendations differ depending on the function of a room. Target lux levels are applied across 50% of the reference plane of a room for half of the daylight hours. The target lux levels are:

- 200 Lux for kitchens • 150 Lux for living rooms • 100 Lux for bedrooms

No minimum is stated to be achieved across 95% of the working plane. If a space has dual purposes it is advised that the higher target value should be applied.

Planning Design Standards for Apartments: Guidelines for Planning Authorities (2025)

In July 2025, the Department of Housing, Local Government and Heritage published an updated guidance document for new apartments, ‘*Planning Design Standards for Apartments: Guidelines for Planning Authorities, 2025*’. This document, which may be referred to by the simplified name ‘*Apartment Guidelines*’, supersedes the previous guidance document for apartments ‘*Sustainable Urban Housing: Design Standards for New Apartments, 2023*’.

Unlike the 2023 edition, the current Apartment Guidelines do not directly reference any specific guidance document for daylight and sunlight. Instead, they refer to ‘*Sustainable Residential Development and Compact Settlements Guidelines (2024)*’:

“The provision of acceptable levels of natural light in new apartment developments is an important planning consideration, as it contributes to the liveability and amenity enjoyed by apartment residents. It is also important to safeguard against a detrimental impact on the amenity of other sensitive occupiers of adjacent properties. Section 5.3.7 of the SRDCSGs outlines requirements for the provision of acceptable levels of daylight in new residential developments and adjoining properties.” (emphasis added.)

The relevant section of ‘*Sustainable Residential Development and Compact Settlements Guidelines*’ (SRDCGS), 5.3.7, is referenced in the following section of this report.

Paragraph 6.7 of the superseded 2023 apartment guidelines states:

“Where an applicant cannot fully meet all of the requirements of the daylight provisions above, this must be clearly identified and a rationale for any alternative, compensatory design solutions must be set out, which planning authorities should apply their discretion in accepting taking account of its assessment of specific. This may arise due to a design constraints [sic] associated with the site or location and the balancing of that assessment against the desirability of achieving wider planning objectives. Such objectives might include securing comprehensive urban regeneration and or an effective urban design and streetscape solution.”

Although the above requirement has been removed from the 2025 apartment guidelines, the request remains in some local authority development plans. As such, the design team may still provide a rationale and/or compensatory design solutions for instances where daylight and/or sunlight recommendations have not been achieved.

Note: Section 3.2 of the ‘*Urban Development and Building Height Guidelines 2020*’, provides similar guidance as the ‘*2023 apartment guidelines*’ as referenced above. However, it should be noted that at the time of publication of the *Urban Development and Building Height Guidelines (2020)*, BR 209 was in its second edition, first published in 2011. Since then, a third edition of BR 209 has been published (June 2022) and the 2nd edition has been withdrawn. BR 209 no longer references BS 8206-2:2008, which has also been withdrawn. The standard now referenced in BR 209 edition 3 is BS EN 17037.

Sustainable Residential Development and Compact Settlements Guidelines (2024)

Often referred to as “The Compact Growth Guidelines” this document advises on compact growth principles as a means to promote sustainable development, efficient land use, and infrastructure while minimizing sprawl and environmental degradation, contributing to sustainable urban growth, enhance liveability and support broader planning objectives.

In regard to daylight, section 5.3.7 states:

“The provision of acceptable levels of daylight in new residential developments is an important planning consideration, in the interests of ensuring a high quality living environment for future residents. It is also important to safeguard against a detrimental impact on the amenity of other sensitive occupiers of adjacent properties.

(a) The potential for poor daylight performance in a proposed development or for a material impact on neighbouring

properties will generally arise in cases where the buildings are close together, where higher buildings are involved, or where there are other obstructions to daylight. Planning authorities do not need to undertake a detailed technical assessment in relation to daylight performance in all cases. It should be clear from the assessment of architectural drawings (including sections) in the case of low-rise housing with good separation from existing and proposed buildings that undue impact would not arise, and planning authorities may apply a level of discretion in this regard.

(b) In cases where a technical assessment of daylight performance is considered by the planning authority to be necessary regard should be had to quantitative performance approaches to daylight provision outlined in guides like A New European Standard for Daylighting in Buildings IS EN17037:2018, UK National Annex BS EN17037:2019 and the associated BRE Guide 209 2022 Edition (June 2022), or any relevant future standards or guidance specific to the Irish context.

In drawing conclusions in relation to daylight performance, planning authorities must weigh up the overall quality of the design and layout of the scheme and the measures proposed to maximise daylight provision, against the location of the site and the general presumption in favour of increased scales of urban residential development. Poor performance may arise due to design constraints associated with the site or location and there is a need to balance that assessment against the desirability of achieving wider planning objectives. Such objectives might include securing comprehensive urban regeneration and or an effective urban design and streetscape solution."

The Compact Growth Guidelines should be applied within statutory development plans and during the consideration of individual planning applications. Flexibility in interpretation allows planning authorities to tailor recommendations to specific local contexts and planning objectives.

Kildare Development Plan (2023-2029)

The guidance provided in the Kildare Development Plan (2023-2029) references the 2nd Edition of the BRE guidelines (2011). Chapter 15 Development Management Standards, Section '15.2.3 Overshadowing' of the Kildare Development Plan states:

"High levels of daylight and sunlight provide for good levels of amenity for residents. The internal layout of residential units should be designed to maximize use of natural daylight and sunlight.

All new developments are required to have regard to the recommendations of Site Layout Planning for Daylight and Sunlight: A Guide to Good Practice (B.R.209, 2011) and British Standard (B.S.) 8206 Lighting for Buildings, Part 2, 2008: Code of Practice for Day Lighting or other updated relevant documents. Where an applicant cannot fully meet all of the requirements of the daylight provisions, this must be clearly identified and a rationale for any alternative, compensatory design solutions must be set out, which will be considered by the planning authority on a case-by-case basis."

Prior the publication of the Kildare Development Plan (2023-2029), the Building Research Establishment's 'Site Layout Planning for Daylight and Sunlight' has released the updated 3rd edition superseding the 2nd edition, which has since been withdrawn.

Guidelines / Standards Summary

According to the aforementioned guiding documents, the following assessments are typically conducted for a daylight and sunlight study, depending on the specific requirements of the project.

Impact on the Surrounding Properties

Impact to daylight is assessed through a Vertical Sky Component (VSC) on all relevant surrounding windows: A VSC impact assessment is typically conducted, where appropriate, on the relevant surrounding windows determined by the BRE decision chart as illustrated in Figure 2.2 on page 8.

Impact to daylight can be further assessed through a No Sky Line (NSL) on surrounding properties: Section D3 of the BRE Guidelines recommends a No Sky Line study "where room layouts are known". Consequentially, NSL assessments are typically conducted only on properties where detailed floor plans have been provided.

Impact to sunlight in neighbouring properties is assessed through a Annual Probable Sunlight Hours (APSH) and Winter Probable Sunlight Hours (WPSH) on all relevant surrounding windows: An APSH/WPSH impact assessment is typically conducted, where appropriate, on the relevant surrounding windows/rooms that have an orientation within 90° of due south.

Impact to sunlight in neighbouring gardens and/or amenity areas is assessed through a Sunlight on Ground (SOG) in all surrounding amenity spaces: A SOG impact assessment is typically carried out, where appropriate, on the neighbouring gardens/ amenity spaces located within close proximity and to the north of the subject site.

Performance of the Proposed Development

Target Illuminance in all habitable rooms: A target illuminance assessment, also known as a Spatial Daylight Autonomy (SDA) assessment. The two recommended methodologies for this assessment are detailed in section 2.5.1 on page 14. In a scheme performance assessment, the SDA is typically calculated for the habitable rooms of the proposed development. A supplementary SDA assessment may also be conducted under the criteria of IS EN 17037.

When conducting a scheme performance assessment for sunlight in the habitable rooms of the proposed development, Sunlight Exposure (SE) is the relevant metric.

Sunlight on Ground (SOG) in all amenity spaces: A SOG assessment is typically carried out, for the amenity spaces of the proposed development.

No Sky Line (NSL) in all habitable rooms: An NSL assessment is typically conducted for the habitable rooms of the proposed development as a supplementary study as part of a scheme performance assessment.