



NOTES:

ANY DISCREPANCIES OR OMISSIONS TO BE REPORTED TO ENX IMMEDIATELY.
DO NOT SCALE - WORK FROM FIGURED DIMENSIONS ONLY.
THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL CIVIL ENGINEER'S, STRUCTURAL ENGINEER'S, ARCHITECTS & ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS RELATING TO THE PROJECT.
ALL DIMENSIONS TO BE CONFIRMED ON SITE.
THIS DRAWING IS THE PROPERTY OF ENX AND IT OR ITS CONTENTS CANNOT BE COPIED, REPRODUCED OR OTHERWISE USED WITHOUT THE PERMISSION & CONSENT OF ENX.©

PUBLIC LIGHTING NOTES:

- CONTRACTOR TO PROVIDE 1 NO. 50mm ESB DUCT TO EACH MICRO PILLAR FROM NEAREST MINIPILLAR
- COMPLETE PUBLIC LIGHTING INSTALLATION TO BE IN ACCORDANCE WITH LOCAL COUNTY COUNCIL PUBLIC LIGHTING SPECIFICATION
- DUCTS TO BE INSTALLED 600mm BELOW GROUND LEVEL WITH MARKER TAPE LAID AT MINIMUM 300mm
- 100mm MINIMUM CLEARANCE BETWEEN PL DUCTS AND OTHER SERVICE
- HNG INDICATES A POLE THAT IS NOT WITHIN PROXIMITY TO A ROAD AND IS REQUIRED TO BE HINGED FOR MAINTENANCE PURPOSES

PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE

PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE

PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE

PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE

110mm PUBLIC LIGHTING DUCT

50mm ESB DUCT TO PL MICRO PILLAR

PUBLIC LIGHTING MICRO PILLAR

PUBLIC LIGHTING ACCESS JB2 CHAMBER

MINI-PILLAR TO BE CONFIRMED BY ESB

XA
XB
XC
XD

AC


NO.	DESCRIPTION	DATE
00	ISSUED FOR PLANNING - FURTHER INFORMATION	13-05-2026

ENX


Drawing Title:
Site - Services Layouts - Electrical
Public Lighting Ducting (Sheet 1 of 2)

Client: Glenveagh Homes Ltd	Approved: ML		
Project: Ballymestone Phase 3	Rev: 00		
Project No: 3260	Scale @ A1: 1:500	Drawn: PL	Checked: ML
Drawing Reference: 3260-ENX-XXXX-XX-DR-E01-006002	Date: MAY 2026	Status: S3	

NOTES:
ANY DISCREPANCIES OR OMISSIONS TO BE REPORTED TO ENX IMMEDIATELY.
DO NOT SCALE - WORK FROM FIGURED DIMENSIONS ONLY.
THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL CIVIL ENGINEER'S, STRUCTURAL
ENGINEER'S, ARCHITECTS & ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS
RELATING TO THE PROJECT.
ALL DIMENSIONS TO BE CONFIRMED ON SITE.
THIS DRAWING IS THE PROPERTY OF ENX AND IT OR ITS CONTENTS CANNOT BE COPIED,
REPRODUCED OR OTHERWISE USED WITHOUT THE PERMISSION & CONSENT OF ENX.©

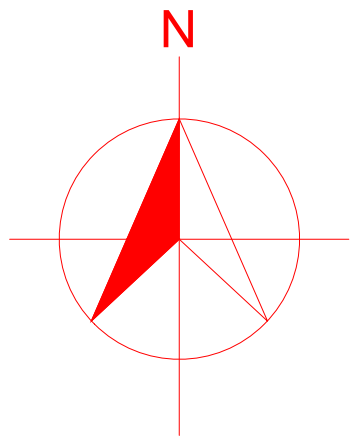

- PUBLIC LIGHTING NOTES:
- CONTRACTOR TO PROVIDE 1 NO. 50mm ESB DUCT TO EACH MICRO PILLAR FROM NEAREST MINIPILLAR
 - COMPLETE PUBLIC LIGHTING INSTALLATION TO BE IN ACCORDANCE WITH LOCAL COUNTY COUNCIL PUBLIC LIGHTING SPECIFICATION
 - DUCTS TO BE INSTALLED 600mm BELOW GROUND LEVEL WITH MARKER TAPE LAID AT MINIMUM 300mm
 - 100mm MINIMUM CLEARANCE BETWEEN PL DUCTS AND OTHER SERVICE
 - HNG INDICATES A POLE THAT IS NOT WITHIN PROXIMITY TO A ROAD AND IS REQUIRED TO BE HINGED FOR MAINTENANCE PURPOSES
- PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE
- PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE
- PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE
- PLEASE SEE PUBLIC LIGHTING REPORT FOR WATTAGES, FITTING ON 6M POLE
- 110mm PUBLIC LIGHTING DUCT
- 50mm ESB DUCT TO PL MICRO PILLAR
- PUBLIC LIGHTING MICRO PILLAR
- PUBLIC LIGHTING ACCESS JB2 CHAMBER
- MINI-PILLAR TO BE CONFIRMED BY ESB
- XA
- XB
- XC
- XD
- AC
- ESB

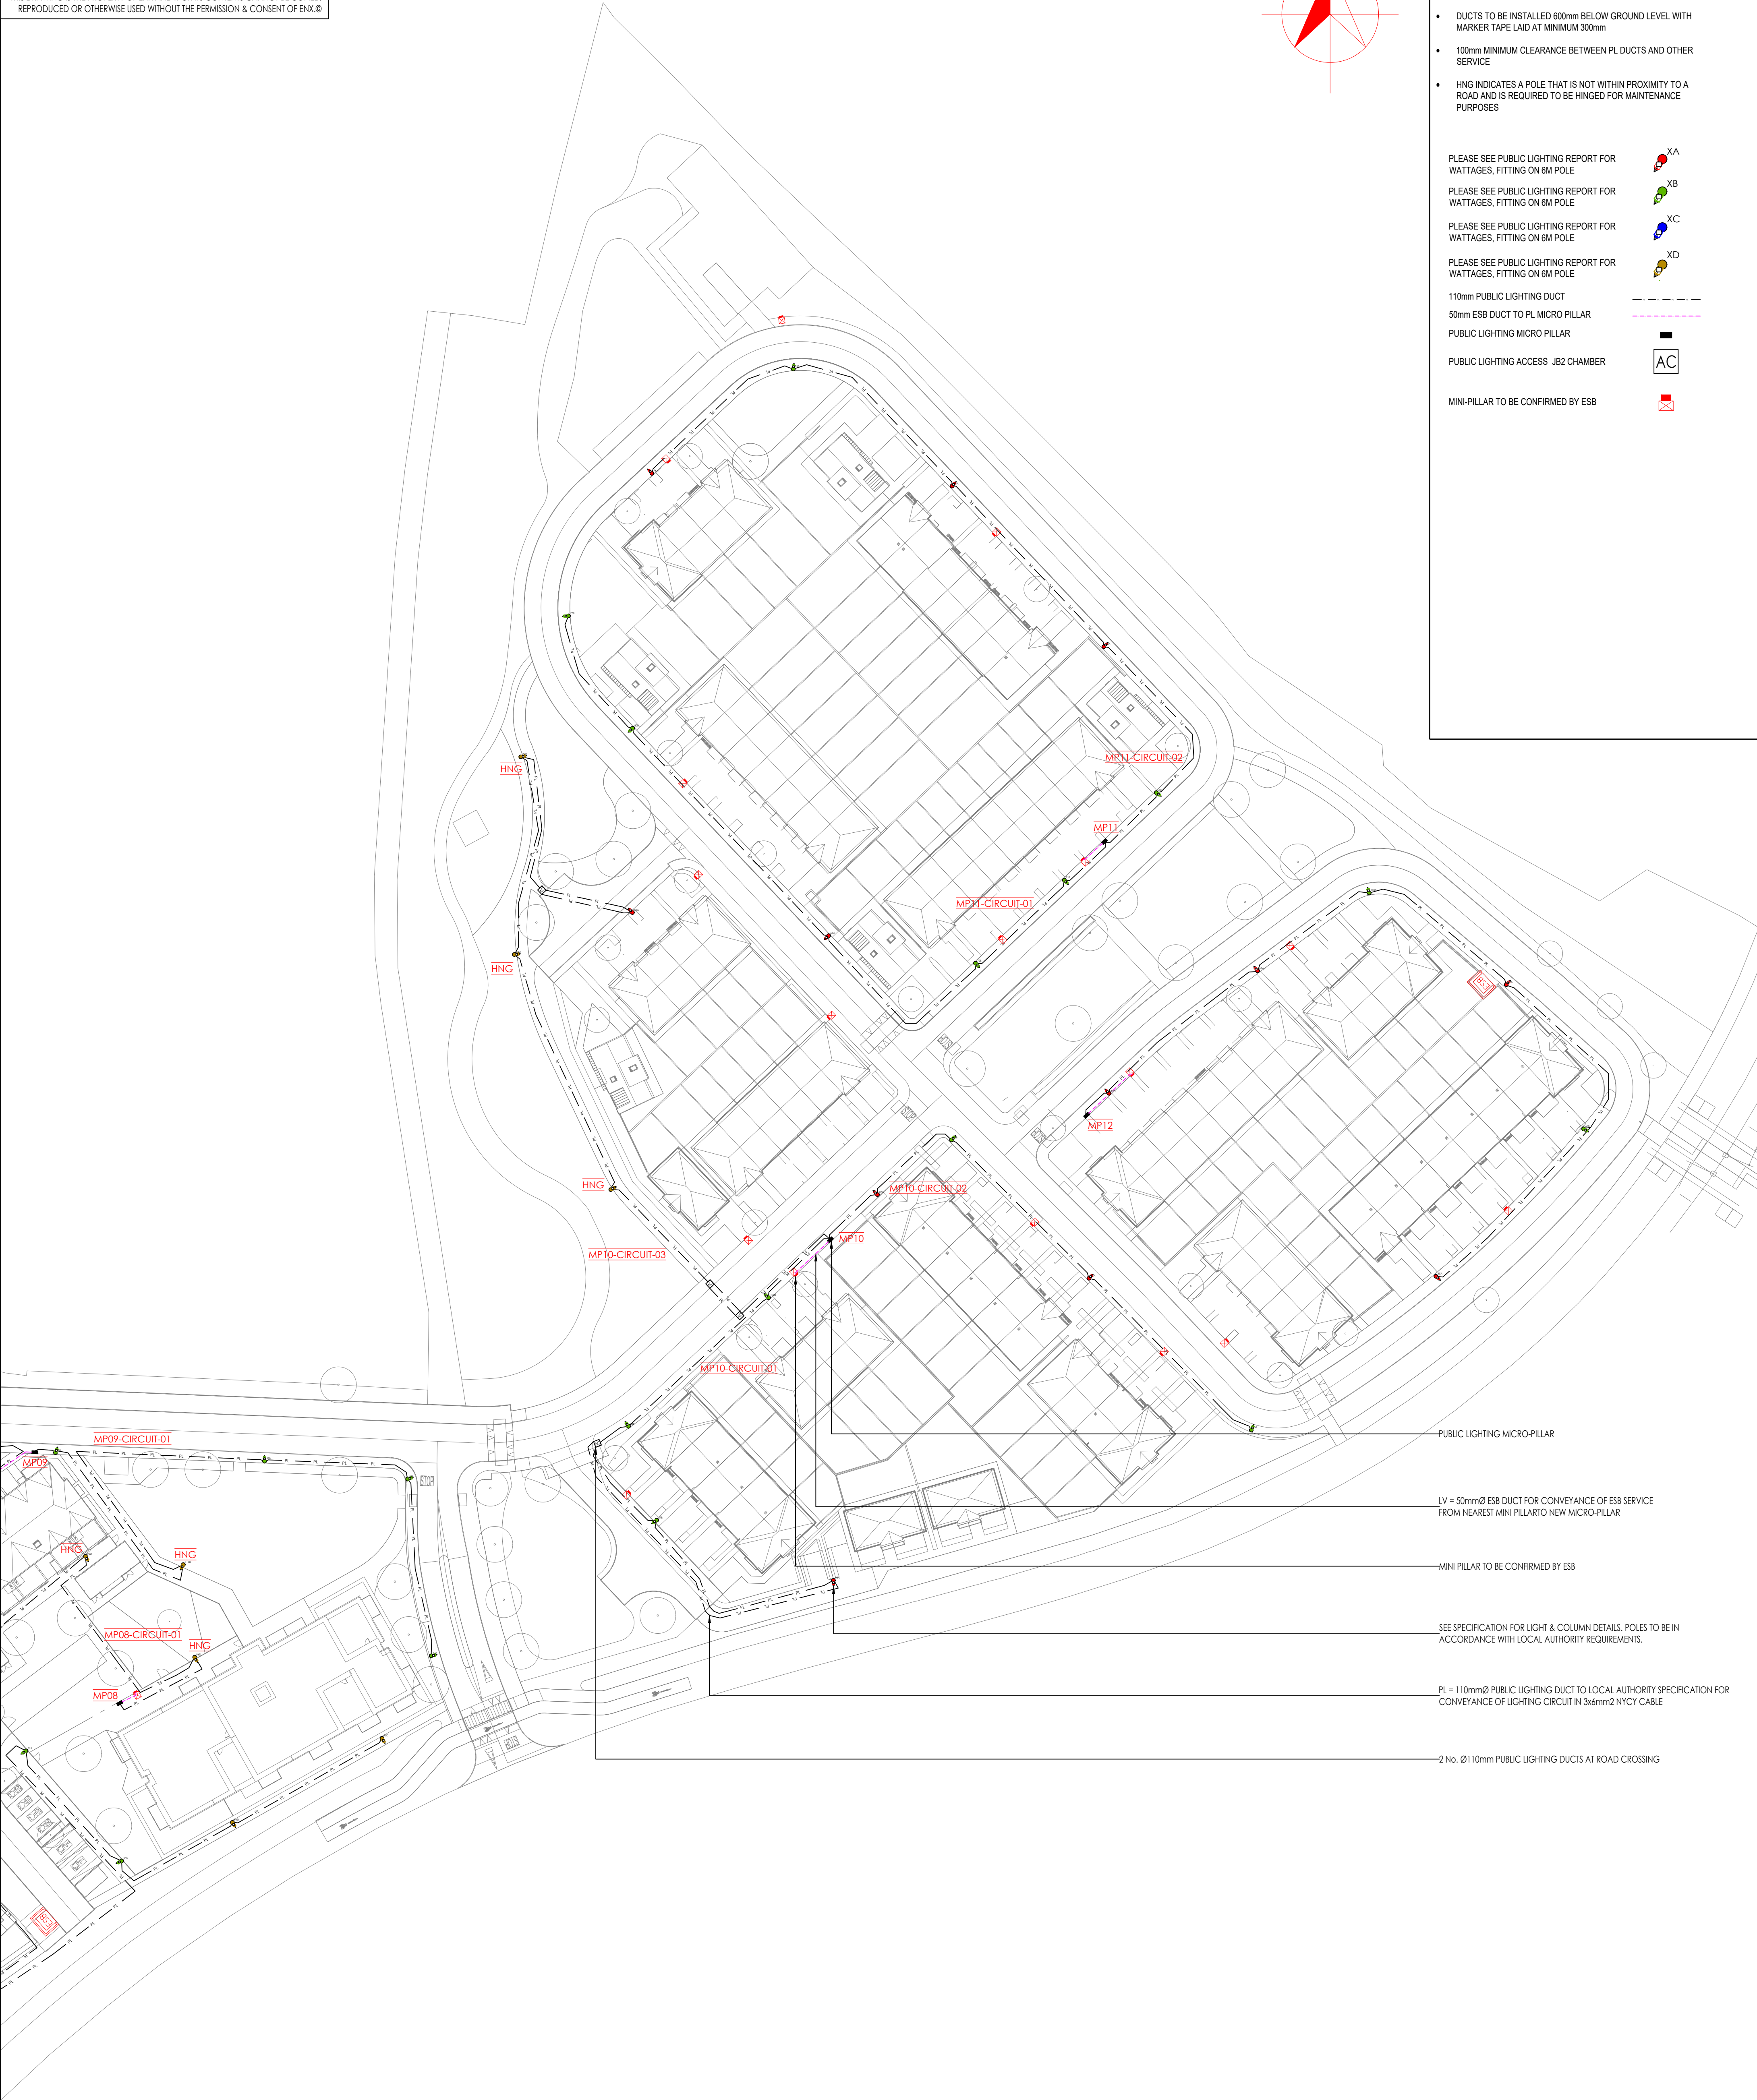

PUBLIC LIGHTING MICRO-PILLAR

LV = 50mmØ ESB DUCT FOR CONVEYANCE OF ESB SERVICE FROM NEAREST MINI PILLAR TO NEW MICRO-PILLAR

MINI PILLAR TO BE CONFIRMED BY ESB

SEE SPECIFICATION FOR LIGHT & COLUMN DETAILS. POLES TO BE IN ACCORDANCE WITH LOCAL AUTHORITY REQUIREMENTS.

PL = 110mmØ PUBLIC LIGHTING DUCT TO LOCAL AUTHORITY SPECIFICATION FOR CONVEYANCE OF LIGHTING CIRCUIT IN 3x6mm2 NYCY CABLE

2 No. Ø110mm PUBLIC LIGHTING DUCTS AT ROAD CROSSING

No.	DESCRIPTION	DATE
00	ISSUED FOR PLANNING - FURTHER INFORMATION	13-05-2028



Drawing Title: Site - Services Layouts - Electrical Public Lighting Ducting (Sheet 2 of 2)			
Client: Glenveagh Homes Ltd			Approved: ML
Project: Ballymastone Phase 3			Rev: 00
Project No: 3260	Scale @ A1: 1:500	Drawn: PL	Checked: ML
Drawing Reference: 3260-ENX-XXXX-XX-DR-E01-006002		Date: MAY 2026	Status: S3