



NOTES:
ANY DISCREPANCIES OR OMISSIONS TO BE REPORTED TO ENX IMMEDIATELY.
DO NOT SCALE - WORK FROM FIGURED DIMENSIONS ONLY.
THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL CIVIL ENGINEERS, STRUCTURAL ENGINEERS, ARCHITECTS & ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS RELATING TO THE PROJECT.
ALL DIMENSIONS TO BE CONFIRMED ON SITE.
THIS DRAWING IS THE PROPERTY OF ENX AND IT OR ITS CONTENTS CANNOT BE COPIED, REPRODUCED OR OTHERWISE USED WITHOUT THE PERMISSION & CONSENT OF ENX.©

PUBLIC LIGHTING NOTES:

- CONTRACTOR TO PROVIDE 1 NO. 50mm ESB DUCT TO EACH MICRO PILLAR FROM NEAREST MINIPILLAR
- COMPLETE PUBLIC LIGHTING INSTALLATION TO BE IN ACCORDANCE WITH LOCAL COUNTY COUNCIL PUBLIC LIGHTING SPECIFICATION
- DUCTS TO BE INSTALLED 600mm BELOW GROUND LEVEL WITH MARKER TAPE LAID AT MINIMUM 300mm
- 100mm MINIMUM CLEARANCE BETWEEN PL DUCTS AND OTHER SERVICE

29W LED PL FITTING ON 6M POLE



29W LED PL FITTING ON 6M POLE



9W LED PL FITTING ON 6M POLE



9W LED PL FITTING ON 6M POLE



110mm PUBLIC LIGHTING DUCT



50mm ESB DUCT TO PL MICRO PILLAR



PUBLIC LIGHTING MICRO PILLAR



PUBLIC LIGHTING ACCESS CHAMBER



MINI-PILLAR TO BE CONFIRMED BY ESB



SUBSTATION TO BE CONFIRMED BY ESB





NO.	DESCRIPTION	DATE
00	ISSUED FOR REVIEW & COMMENT	24-05-2025
01	ISSUED FOR REVIEW & COMMENT	09-07-2025
02	ISSUED FOR REVIEW & COMMENT	03-10-2025
03	ISSUED FOR PLANNING	13-10-2025



Drawing Title: Site - Services Layouts - Electrical - ESB Substation Location			
Client: Glenveagh Homes Ltd		Approved: ML	
Project: Ballymastone Phase 3		Rev: 03	
Project No: 3260	Scale @ A1: 1:500	Drawn: TP	Checked: ML
Drawing Reference: 3260-ENX-XXXX-XX-DR-E01-006005		Date: OCT 2025	Status: S3

NOTES:
ANY DISCREPANCIES OR OMISSIONS TO BE REPORTED TO ENX IMMEDIATELY.
DO NOT SCALE - WORK FROM FIGURED DIMENSIONS ONLY.
THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL CIVIL ENGINEERS, STRUCTURAL ENGINEERS, ARCHITECTS & ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS RELATING TO THE PROJECT.
ALL DIMENSIONS TO BE CONFIRMED ON SITE.
THIS DRAWING IS THE PROPERTY OF ENX AND IT OR ITS CONTENTS CANNOT BE COPIED, REPRODUCED OR OTHERWISE USED WITHOUT THE PERMISSION & CONSENT OF ENX.00

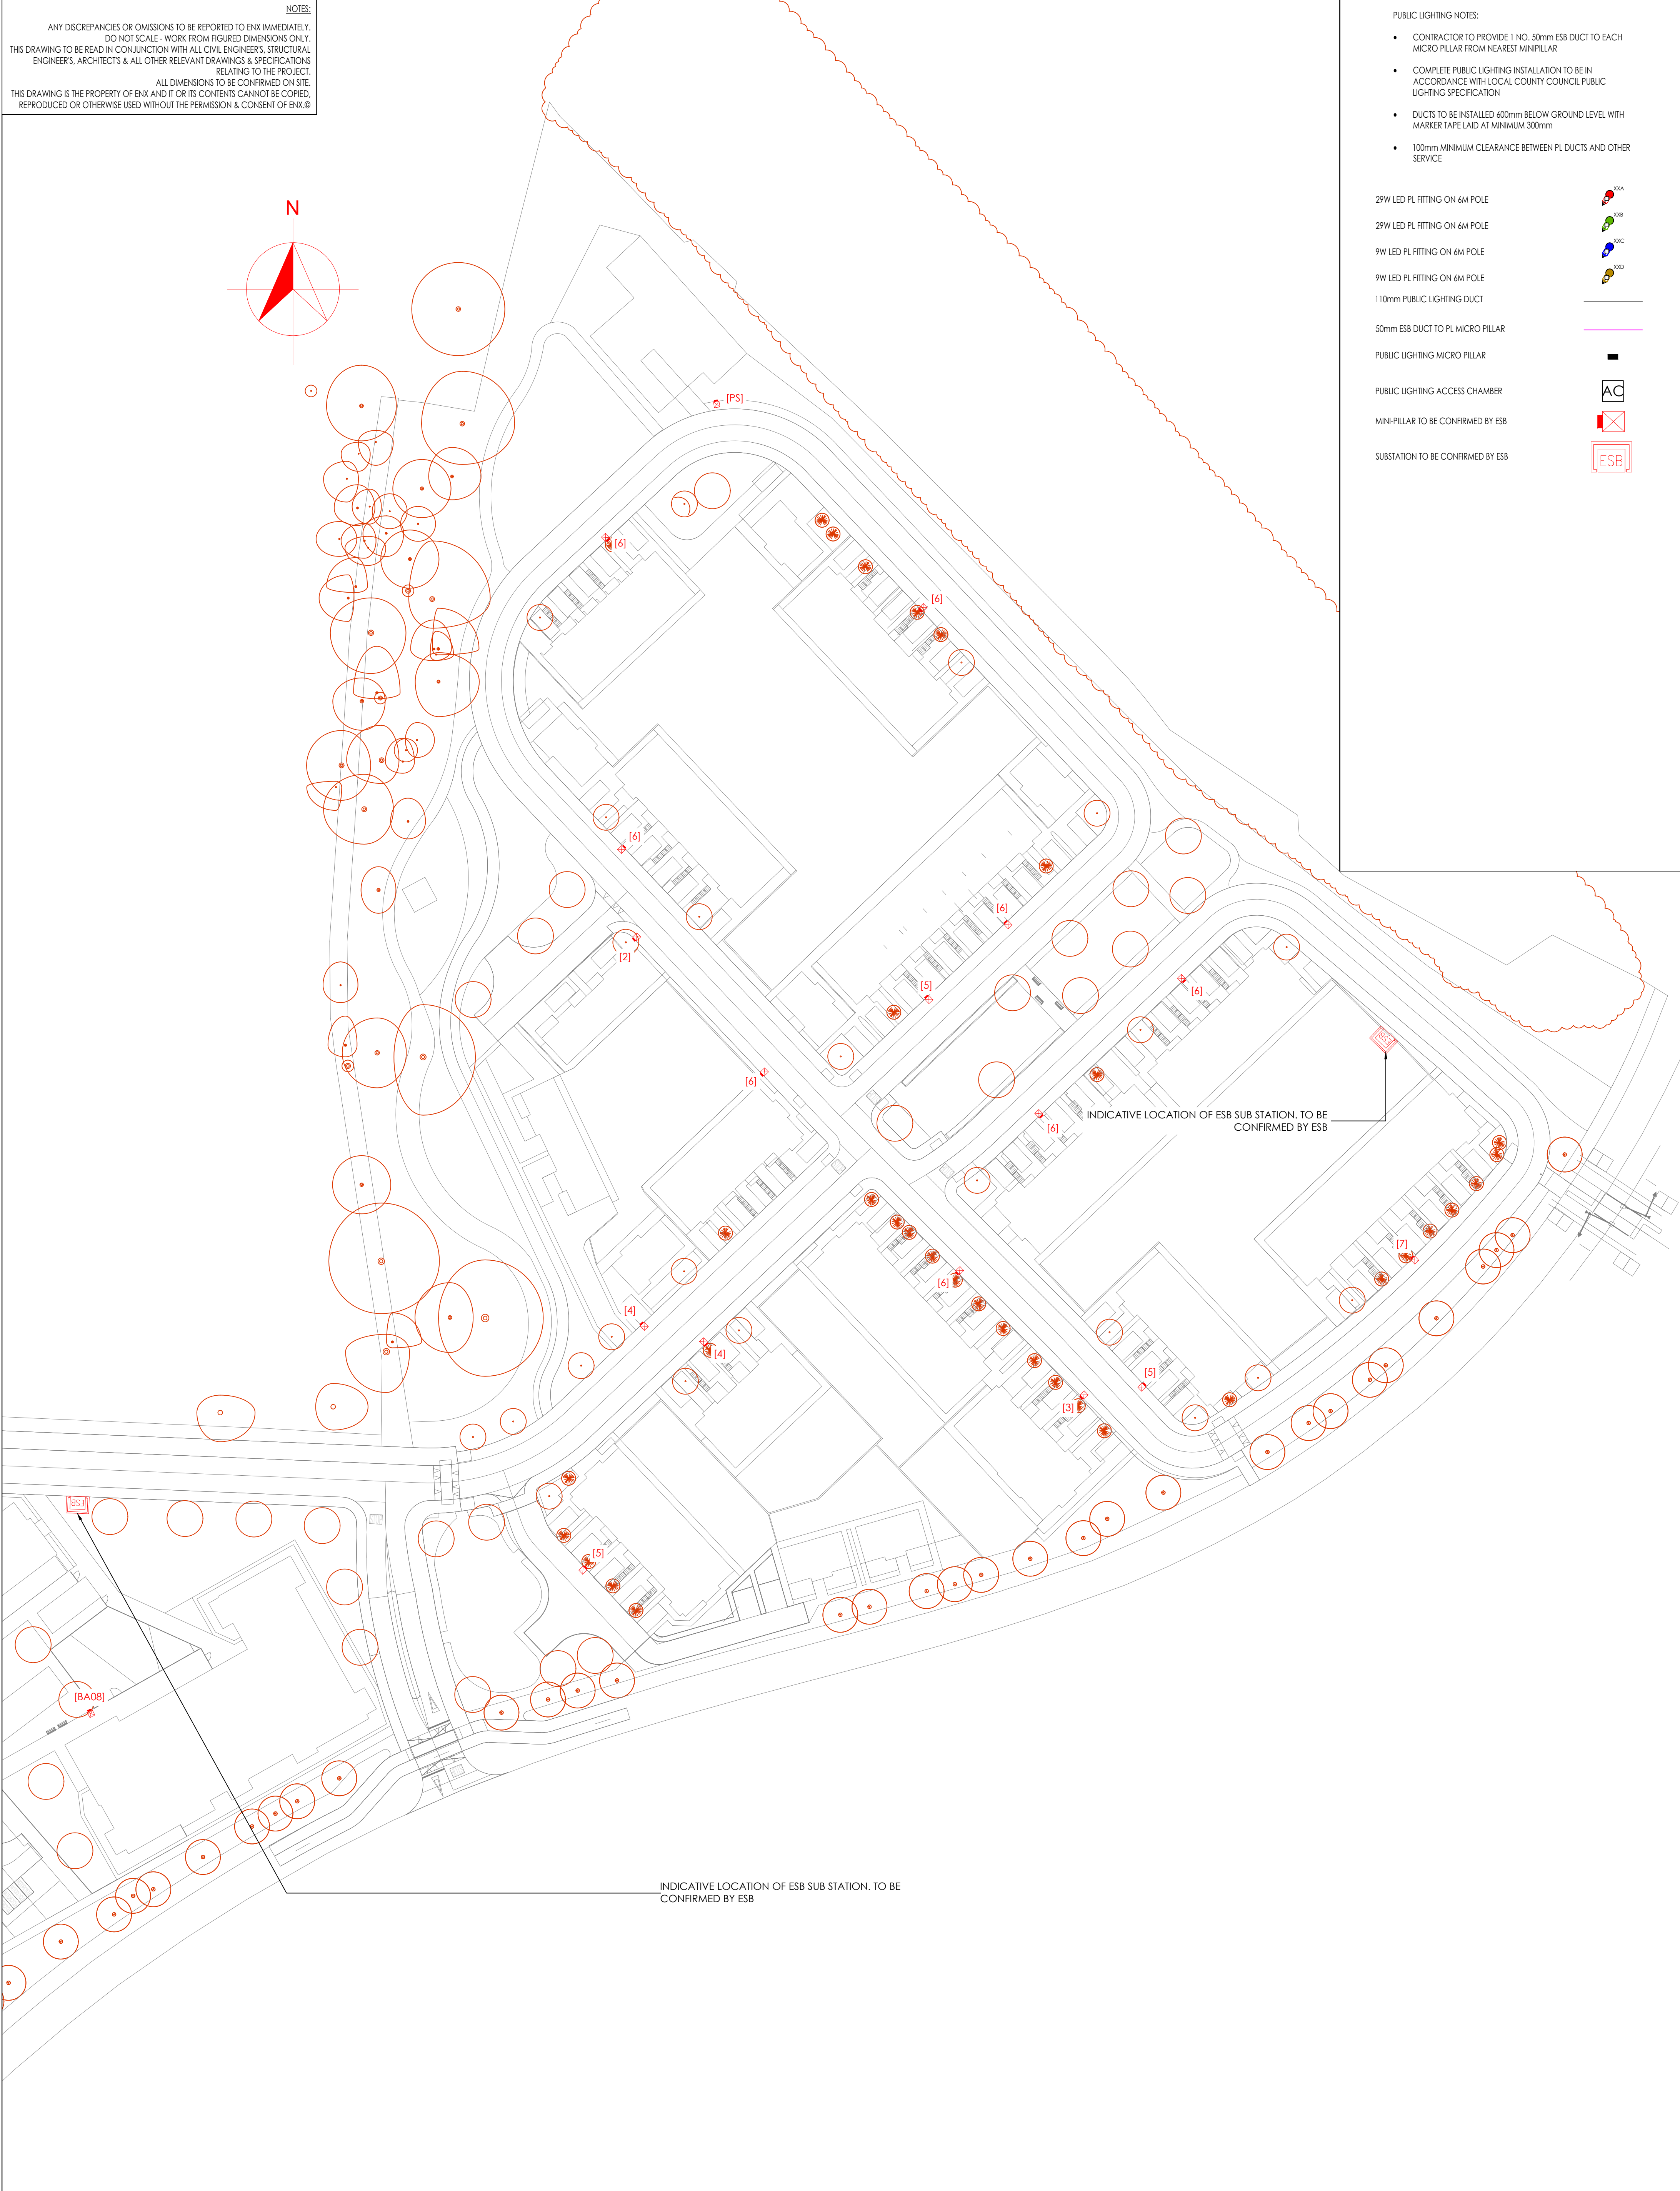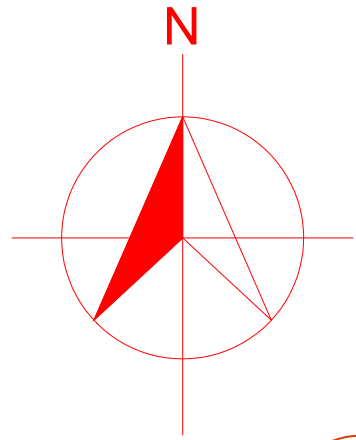

- PUBLIC LIGHTING NOTES:
- CONTRACTOR TO PROVIDE 1 NO. 50mm ESB DUCT TO EACH MICRO PILLAR FROM NEAREST MINIPILLAR
 - COMPLETE PUBLIC LIGHTING INSTALLATION TO BE IN ACCORDANCE WITH LOCAL COUNTY COUNCIL PUBLIC LIGHTING SPECIFICATION
 - DUCTS TO BE INSTALLED 400mm BELOW GROUND LEVEL WITH MARKER TAPE LAID AT MINIMUM 300mm
 - 100mm MINIMUM CLEARANCE BETWEEN PL DUCTS AND OTHER SERVICE

29W LED PL FITTING ON 6M POLE



29W LED PL FITTING ON 6M POLE



9W LED PL FITTING ON 6M POLE



9W LED PL FITTING ON 6M POLE



110mm PUBLIC LIGHTING DUCT



50mm ESB DUCT TO PL MICRO PILLAR



PUBLIC LIGHTING MICRO PILLAR



PUBLIC LIGHTING ACCESS CHAMBER



MINI-PILLAR TO BE CONFIRMED BY ESB




SUBSTATION TO BE CONFIRMED BY ESB



INDICATIVE LOCATION OF ESB SUB STATION. TO BE CONFIRMED BY ESB

INDICATIVE LOCATION OF ESB SUB STATION. TO BE CONFIRMED BY ESB

No.	DESCRIPTION	DATE
00	ISSUED FOR REVIEW & COMMENT	26-05-2025
01	ISSUED FOR REVIEW & COMMENT	09-07-2025
02	ISSUED FOR REVIEW & COMMENT	25-09-2025
03	ISSUED FOR PLANNING	13-10-2025

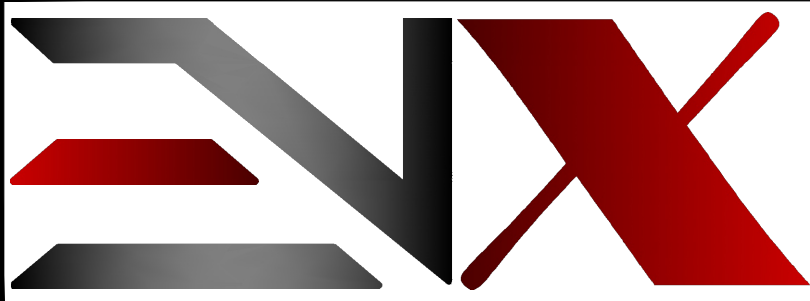

Drawing Title: Site - Services Layouts - Electrical - ESB Substation Location			
Client: Glenveagh Homes Ltd			Approved: ML
Project: Ballymestone Phase 3			Rev: 03
Project No: 3260	Scale @ A1: 1:500	Drawn: TP	Checked: ML
Drawing Reference: 3260-ENX-XXXX-XX-DR-E01-006005		Date: OCT 2025	Status: S3