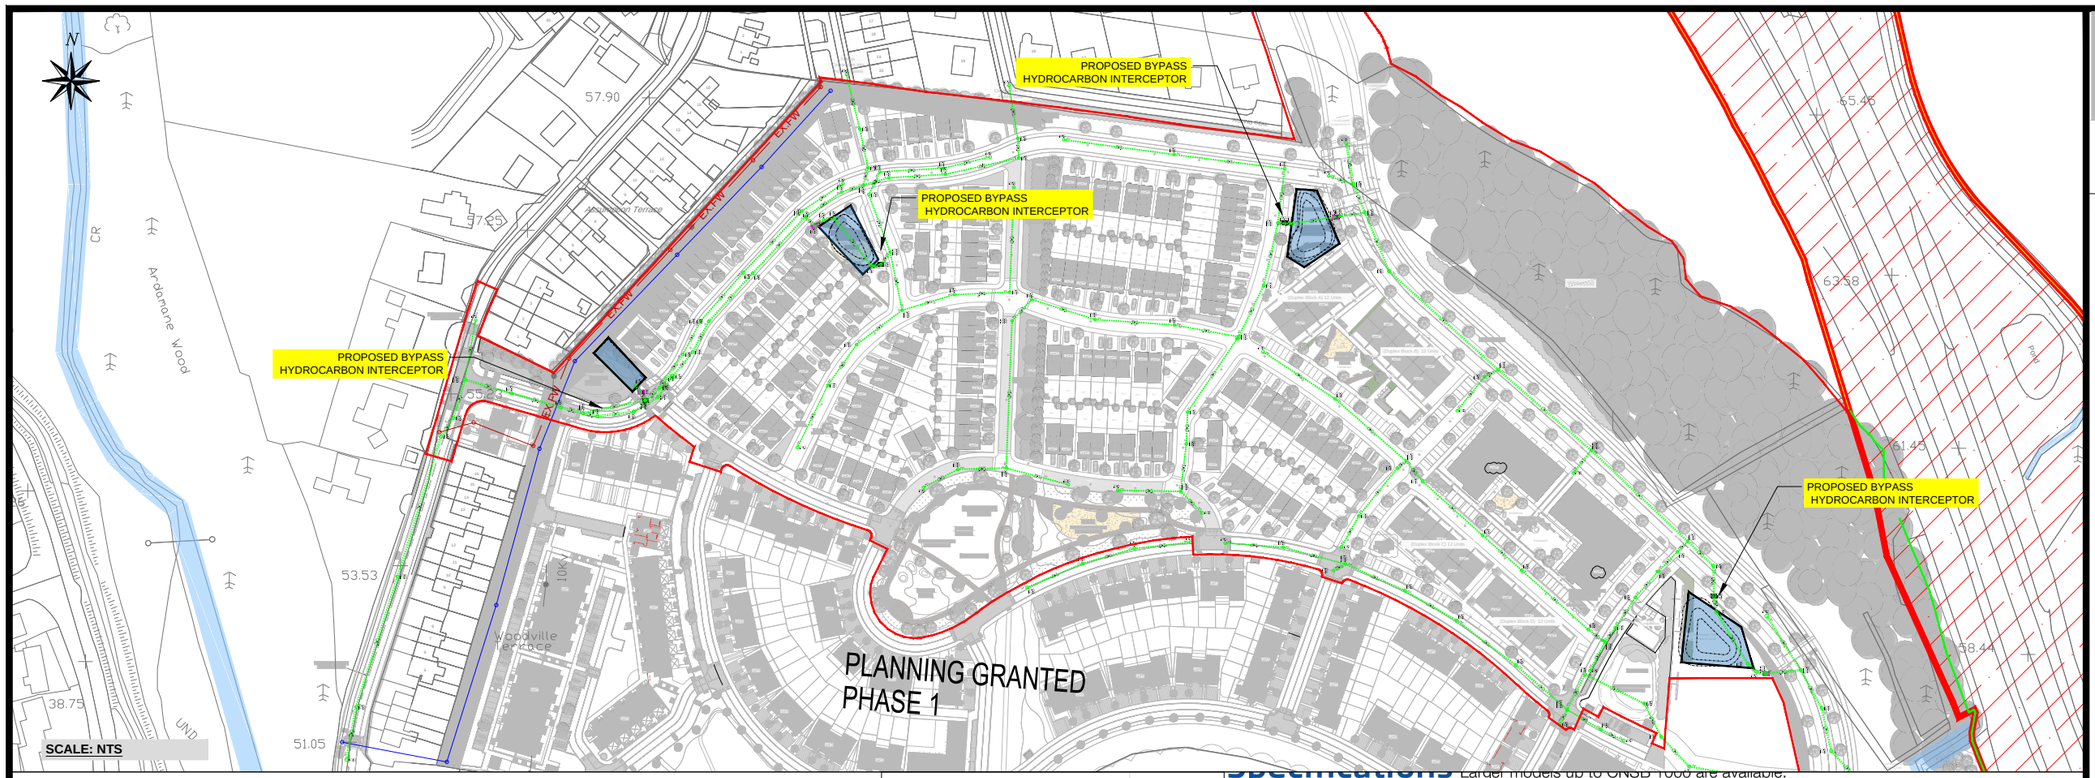


Specifications Larger models up to CNSB 1000 are available.

Area Drained (m^2)	Tank Code including Silt	Length including Silt (mm)	Silt Capacity (L)	Oil Storage Capacity (L)	Diameter (mm)	Height (mm)	Base to Inlet Invert (mm)	Base to Outlet Invert (mm)	Access (mm)
4444	CNSB8s/21	2165	800	120	1026	1875	1270	1220	600
5555	CNSB10s/21	2485	1000	150	1026	1875	1270	1220	600
8333	CNSB15s/21	2670	1500	225	1210	2150	1450	1400	600
11111	CNSB20s/21	3115	2000	300	1210	2150	1450	1400	600
13889	CNSB25s/21	3555	2500	375	1210	2150	1450	1400	600
16667	CNSB30s/21	3470	3000	450	1510	2690	1770	1720	750
22222	CNSB40s/21	4040	4000	600	1510	2690	1770	1720	750
27778	CNSB50s/21	4655	5000	750	1510	2690	1770	1720	750
33333	CNSB60s/21	4415	6000	900	1880	3300	2025	1975	2 x 600
44444	CNSB80s/21	5225	8000	1200	1880	3300	2025	1975	2 x 600
55556	CNSB100s/21	6010	10,000	1500	1880	3300	2025	1975	2 x 600


CATCHMENT 2A


CATCHMENT 2B

CATCHMENT 2C AND 2F


CATCHMENT 2D

Note: It is a requirement of PPG3 that you have a silt capacity either in your tank or in an upstream catch pit.

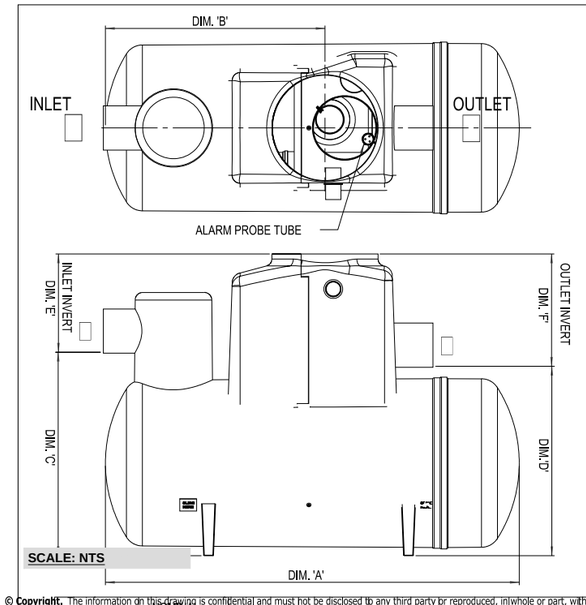



NOTES.
1. UNITS ARE SUPPLIED WITH THE STANDARD (MINIMUM) PIPEWORK SIZE, AND ORIENTATION SHOWN ON THE DRAWING. THE STANDARD EN858-1 STATES MINIMUM CONNECTION SIZES, UNITS ORDERED WITH DIFFERENT SIZE CONNECTIONS MAY NOT BE FULLY COMPLIANT WITH THE STANDARD. PLEASE CONSULT OUR SALES DEPARTMENT FOR DETAILS OF AVAILABLE OPTIONS, BUT PLEASE NOTE WE DO NOT ALTER INTERNAL PIPEWORK.
2. ALL UNITS SUPPLIED ARE CLASS 1 AND INCLUDE A COALESCER.
3. EXTENSION PARTS FOR DEEPER INVERTS CAN BE PROVIDED FOR ON SITE ASSEMBLY.
4. ALL UNITS REQUIRE APPROPRIATE CONCRETE BASE, COVER AND FRAME TO SUIT APPLIED LOADINGS.
5. THIS DRAWING SHOULD BE USED FOR DIMENSIONAL INFORMATION ONLY.
6. A Ø76mm TUBE IS SUPPLIED TO HOUSE AN OIL ALARM PROBE.

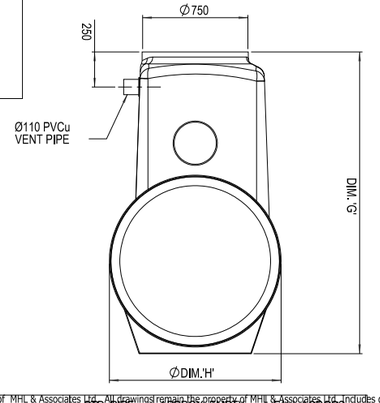

LINE	NOMINAL	DIM. 'A'	DIM. 'B'	DIM. 'C'	DIM. 'D'	DIM. 'E'	DIM. 'F'	DIM. 'G'	DIM. 'H'	STD. PIPE	APPROX. EMPTY	FALL ACROSS

Notes:

Do not scale from drawing.
For Planning Purposes only. Not for Construction.
All dimensions are in metres.
Any discrepancies found consult with design office.
Main sewer tie in invert levels to be verified by SI.

LEGEND:

- Storm Manhole
- Stormwater Sewer
- Attenuation Tank
- Hydrocarbon Interceptor
- Flow control manhole

Rev	By	Date	Description
_E	DM	07.26	Revised Site Layout

Drawing Status: PLANNING
NOT CERTIFIED FOR CONSTRUCTION

Project Title:
PROPOSED RESIDENTIAL DEVELOPMENT (PHASE 2)
AT RINGWOOD, BLARNEY, CO. CORK

Drawing Title:
PROPOSED STORMWATER SEWER
SHEET 15

Client:
CLOCKSTRIKE LTD.

M.H.L & Associates Ltd.
Consulting Engineers
Unit 1B, The Atrium, Blackpool, Cork
Tel: 021-4840214
Fax: 021-4840215
E-Mail:info@mhl.ie

Job No: 21079DEV	Designed: DM	Drawn: DM	Checked: BM
Scale: AS SHOWN @ A3	Date: JUL. 2026		
Drawing No: BLR-2-02-SW-ZZZ-DR-MHL-CE-00564	Rev.: _E		

© Copyright. The information on this drawing is confidential and must not be disclosed to any third party or reproduced, in whole or part, without the express written consent of MHL & Associates Ltd. All drawings remain the property of MHL & Associates Ltd. Includes data reproduced under Licence number: CYAL50352843. Unauthorised reproduction infringes Tailte Éireann copyright. National Mapping Division of Tailte Éireann. All rights reserved.