

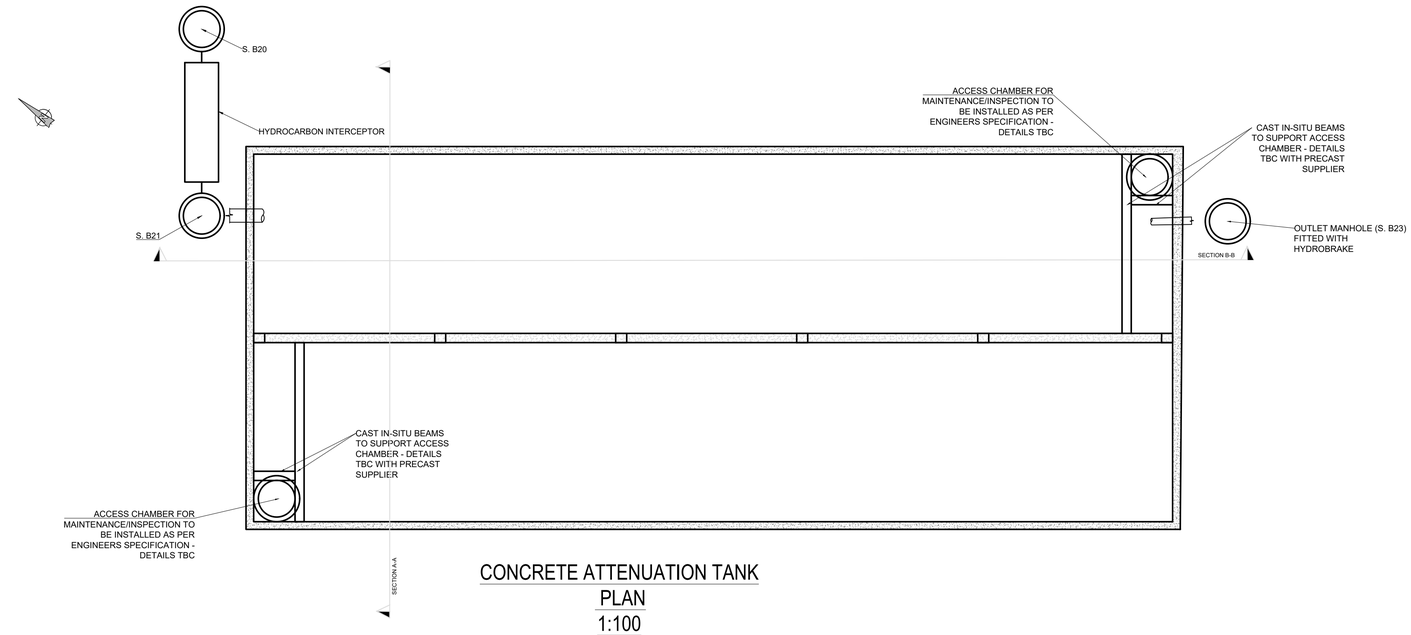


CONCRETE ATTENUATION TANK
PLAN
1:100

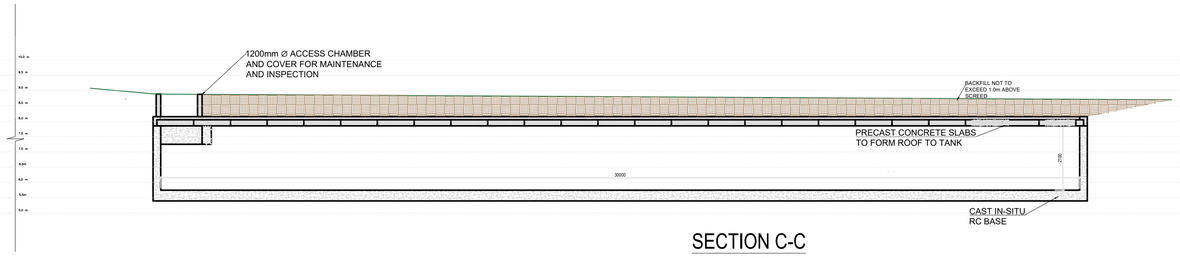

SECTION C-C
1:100

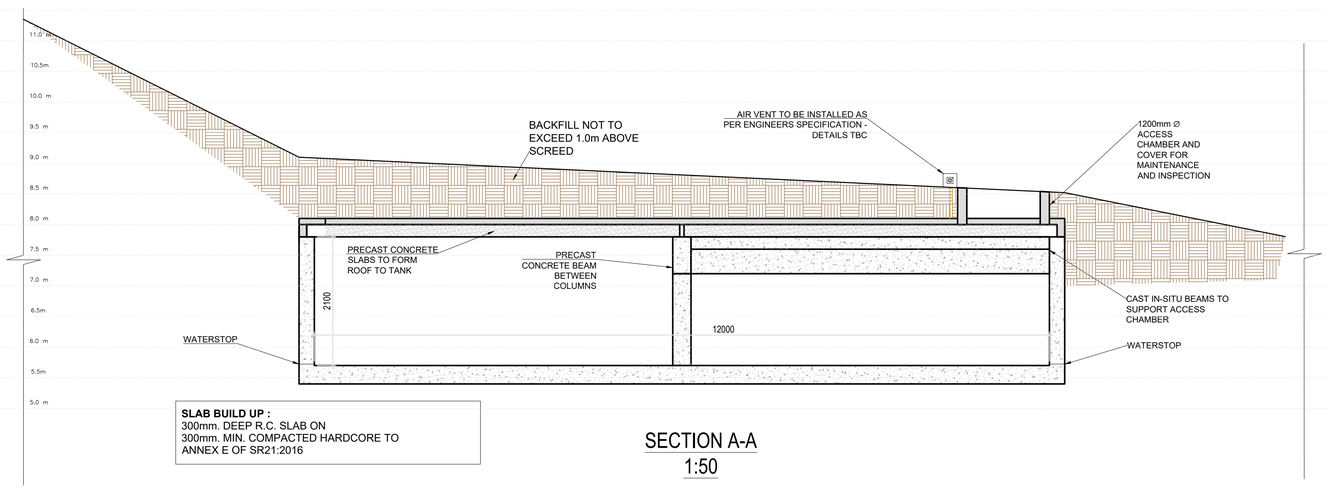

SLAB BUILD UP :
300mm. DEEP R.C. SLAB ON
300mm. MIN. COMPACTED HARDCORE TO
ANNEX E OF SR21:2016

SECTION A-A
1:50

© Copyright

This drawing and any design here on is the copyright of the Consultants and must not be reproduced without their written consent.

All drawings remain the property of the Consultants.

NOTES

1. ALL LEVELS SHOWN ARE RELATIVE TO MALIN HEAD DATUM.
2. ALL LEVELS TO BE INSPECTED ON SITE AND MAXIMUM SOIL DEPTH ABOVE TANK NOT TO EXCEED 1.0m.
3. PRECAST ROOF SLABS TO BE INSTALLED AS PER SUPPLIER CONCRETE SPECIFICATIONS. ALL SLAB DIMENSIONS TO BE CHECKED ON SITE PRIOR TO INSTALLATION.
4. TANK BASE AND WALLS TO BE CONCRETE GRADE C35/45. CONCRETE EXPOSURE CLASS XA1.
5. THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY WORKS REQUIRED IN ORDER TO CONSTRUCT THE STRUCTURE WHILST MAINTAINING OVERALL STABILITY.
6. ACCESS COVERS MUST BE HEAVY DUTY, FLUSH AND INCLUDE AN INTERNAL FALL ARREST.

Rev.	Suit.	Description	Drawn	Ch'kd	Date
P01	A3	ISSUED FOR PLANNING	POKL	DK	14.11.25

Client

Estuary View Enterprises 2020 Ltd.

egis
info.ireland@egis-group.com
Formerly JB Barry & Partners who became part of Egis in 2023

Project

BESSBOROUGH LRD DEVELOPMENT

Drawing Title

ATTENUATION TANK DETAILS

Drawn by :	POKL	Date :	NOV 2025
Checked by :	TF	Date :	NOV 2025
Approved by :	TF	Date :	NOV 2025
Internal Project REF :	EEI : 25629		
Scales :	AS SHOWN @ A1.		
Stage :	PLANNING		
Drawing No. :	25629-EEI-UD-XX-DR-CE-04010	Revision	P01
		Suitability Code	A3