

Caheranardrish LRD - Limerick

Proposed Residential Development

Daylight and Sunlight Analysis Report

Caheranardrish,
Mungret,
Co. Limerick

DKP document no
5100

Document issue / status
1 / P

Issue date
2026-03-31

Project file no
Q02-DKP-5100-WD-XX-XX | 1P



Document control

DKP project no: Q02

DKP document no: 5100

Project file no: Q02-DKP-5100-WD-XX-XX

Circular	Issue >	1#	1P
Client	Homeland Projects Ltd.	☒	☒
Architect	Deady Gahan Architects	☒	☒
Planning consultant	Coakley O'Neill Town Planning Ltd.	☒	☒

Issue 1# 2026-03-26 Draft Planning issue
Issue 1P 2026-03-31 Planning issue

Document issue status ID

Sketch/draft
P Planning
C Concept
D Design
G General information
T Tender
W Works/construction
Z As-build/constructed

Issue	Prepared	Checked	Approved
1#	212	201	201
1P	212	201	201

ING Gerard (Craig) van Deventer CEng., BE(mech)., HDip CIOB, MCIBSE
Jasmin van Deventer BSc (hons)

M : [00] 353 (0)87 260 8080
E : gerard@dkpartnership.com

DKPartnership
70 Main Street, Applewood , Swords, Co. Dublin, Ireland
Reen Kenmare Co. Kerry

post@dkpartnership.com
www.dkpartnership.com

T : [00] 353 (0) 1813 1930
T : [00] 353 (0)64664 1686



Contents

Section		Page
1	Introduction.....	4
2	Executive summary.....	6
3	Standards and guidelines	8
4	Approach and methodology.....	9
5	Performance of proposed development – Calculation results and conclusion.....	16
6	Impact of proposed development – Calculation results and conclusion.....	30
	Appendix A - Sunlight analysis illustrations	35
	Appendix B - Sunlight calculation results - proposed amenity areas	42
	Appendix C - Daylight calculation results - VSC impact.....	43
	Appendix D - Sunlight calculation results - existing amenity spaces	44



1 Introduction

1.1 Report purpose

This report gives information on daylight and sunlight studies within the proposed new development and assesses the impact on daylight and sunlight to surrounding areas / existing environment. The daylight and sunlight studies are assessed under two categories, these are.

Performance of proposed development:

- Daylight reception analysis of the proposed development
- Sunlight reception analysis of the proposed development

Impact of proposed development on the existing surrounding environment:

- Impact on daylight reception analysis on existing environment
- Impact on sunlight reception analysis on existing environment

1.2 Instruction

DKPartnership (DKP) have been commissioned by Homeland Projects Ltd. to carry out the analysis and report for the proposed development at Caheranardrish, Mungret, Co. Limerick.

1.3 Standards and guidelines overview

For this report we applied the recommendations and guidelines of the following documents.

- The Building Research Establishment report, BR 209 (2022) Site Layout Planning for Daylight and Sunlight, A Guide to Good Practice. (referred to as the BRE Report).
- British European Standard BS EN 17037:2018 +A1:2021 also referred to as the UK Annex
- Irish European Standard IS EN 17037:2018

1.4 Brief development description

The development will consist of a Largescale Residential Development (LRD), comprising of 182no. residential dwellings as follows: 141no. houses consisting of 104no. detached/semi-detached dwellings (24no. 4-beds, 78no. 3-beds and 2no. 2-beds), 37no. townhouses (18no. 3-beds and 19no. 2-beds) and 41no. apartment units across 1no. triplex unit (2no. 2-beds and 1no. 1-bed) and a five-storey apartment building (13no. 2-beds and 25no. 1-beds) with a crèche with capacity to accommodate 70no. children at ground floor level.

The proposed development will include the provision for car parking, including EV charging points and bicycle parking. The proposed development will also include the provision of private, communal, and public open spaces; internal roads and pathways; pedestrian and cyclist routes; hard and soft landscaping and boundary treatments; waste storage; plant; signage; a new vehicular and pedestrian access onto the Mungret Park Road; public lighting; substations; all associated site development works; and all drainage and foul sewer infrastructure and network works including a pumping station and connections to the existing networks and nature-based suds measures.



1.5 Geographical overview

Image 1.1 the (google maps) site is an overview of the site area with the proposed development approximately outlined in red.



Image 1.1: Proposed development site boundary. Imagery © Google 2026.

2 Executive summary

2.1 Analysis conducted

This report details the achieved calculated daylight and sunlight reception within the new development and the impact on neighbouring receptors. The results are compared for compliance with the recommendations of the relevant guidelines and standards. Daylight and sunlight studies are assessed under two categories, these are:

Performance of proposed development:

- Daylight reception analysis of the proposed development,
- Sunlight reception analysis of the proposed development.

Impact of proposed development on the existing surrounding environment:

- Impact on daylight reception analysis on existing environment,
- Impact on sunlight reception analysis on existing environment,

2.2 Performance of proposed development - Summary of results

Daylight reception analysis of the proposed development

For the daylight assessment, results have been analysed within these standards:

- Assessed in accordance with IS EN17037 / BS EN17307, carried out in accordance with Method 1 and Method 2 described in the methodology section.
- Assessed in accordance with BS EN 17037:2018 National Annex.

The results from table 5.1 are reviewed under each standard. The daylight reception assessment has been targeted to habitable rooms within the proposed development. Receptors / rooms within the proposed development are indicated in image 5.1 to 5.12.

- Apartments: Block J, all habitable rooms within the proposed block on the ground floor and first floor have been assessed. Once a (lowest level) room is compliant, rooms at higher levels with similar configuration / parameters are deemed compliant on the basis that the room daylight factor would have improved due to the better vertical sky view angle of higher located rooms.
- Triplex unit: all habitable rooms on the ground floor and first floor have been assessed.
- All other house types: The daylight reception assessment has been targeted to habitable rooms within the proposed development on the ground floor which are observed to be in the most daylight challenging positions or rooms positioned with close by obstacles.

IS EN17037 / BS EN17307: To achieve recommendations outlined in IS EN 17037:2018 / BS EN 17307:2018, a given room must achieve: a target daylight factor of 2.0% or in terms of illuminance 300 lux on over 50% of the floor area for over 50% of the available daylight hours. And a minimum target daylight factor of 0.7% or in terms of illuminance 100 lux on over 95% of the floor area for over 50% of the available daylight hours. From the calculation result table 5.1 we note the vast majority of the proposed rooms calculated daylight results achieved the minimum guidelines or achieved well in excess of the guidelines.

- Apartments: Overall, examined residential rooms for Apartment block J, achieved on average a daylight factor (DF) of 2.9% and an illuminance of 443 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 1.0% and an illuminance of 146 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. The proposed apartment block achieves well in excess of recommendations.
- Triplex unit: Overall, examined residential rooms achieved on average a daylight factor (DF) of 1.88% and an illuminance of 286 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 0.66% and an illuminance of 94 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. 2 no. of bedrooms within the triplex fall below the target values; however, these shortfalls are limited in extent, arise from unavoidable site constraints, and do not materially affect the overall quality of accommodation. In line with planning practice, the BRE Guidelines are applied flexibly, recognising that full compliance is not always achievable in higher-density contexts. These 2 small shortfalls are justified by the overall design quality and the significant wider planning benefits delivered.
- Houses: Overall, examined residential rooms achieved on average a daylight factor (DF) of 2.3% and an illuminance of 361 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 0.8% and an illuminance of 119 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. The mix of proposed house types achieves recommendations.

In an urban environment it can more often be the case that complete fulfilment with the guidelines is not attainable. Within the BS EN 17037 it acknowledges that a rigid application of the European Standard could prove to be a difficult task as it offers only a single target for new buildings and IS EN17037 currently has no specific National Annex. The



British Annex of BS EN 17037, daylight recommendations differ depending on the function of a room and offers minimum daylight provision targets for kitchens, living rooms and bedrooms. Therefore, Given the similarity of weather, light and design patterns between Ireland and the UK and the lack of specific localisation Annex details in the Irish version, the alternate minimum daylight provision targets set out in the national annex of BS EN 17037 are reviewed next.

BS EN 17037:2018 National Annex: To achieve the alternate minimum daylight recommendations for Dublin, the room in question must achieve: Kitchen 1.3% target daylight factor or in terms of illuminance 200 lux. Living room 1.0% target daylight factor or in terms of illuminance 150 lux, and bedrooms 0.7% target daylight factor or in terms of illuminance 100 lux all over 50% of the floor area for over half the daylight hours. From the calculation result table 5.1 we note that all of the rooms calculated daylight are well in excess of these minimum guidelines.

- Overall compliance for proposed development = 100%

In summary, the calculation results have achieved a high level of compliance under IS EN17037 / BS EN17307 and full compliance under BS EN 17037:2018 National Annex guidelines. This indicates an overall good level of daylight for the proposed development under the guidelines. We conclude, the proposed development can provide a good level of residential daylight amenity to future occupants.

Sunlight in amenity areas / Sun on ground reception analysis of the proposed development

Based on the BRE guidelines at least 50% of the amenity space should receive at least two hours of sunlight on the 21st of March. From the calculation results in table 5.3 we note that all selected amenity spaces received well in excess of the minimum 2 hours of sunlight on at least 50% of the area on March 21st, see image 5.13 for receptor/amenity space locations. Summary of results are as follows:

- The calculated average sunlight on at least 50% of the area on March 21st for Open space amenity areas is 8.8 hours.

This confirms the amenity areas proposed will be adequately sunlit throughout the year. We conclude that the new amenity spaces receive sunlight on 50% of the area is in line with the recommendations of the BRE Report - Site Layout and Planning for Daylight and Sunlight - and therefore deem these to be compliant to this element.

2.3 Impact of proposed development on the existing surrounding environment - Summary of results

Impact on daylight reception analysis on existing environment

The BRE recommends that the effects of a new development on daylight reception should not impact any existing VSC by more than 20% or have a maximum change factor in excess of 0.80. From the calculation results we note all selected neighbouring habitable receptors are affected to some degree with regards to daylight reception due to the introduction of the proposed development in their respective habitable rooms facing the proposed development. The calculated change in daylight reception in all of the neighbouring receptors/windows achieved a change factor ranging from 0.98 to 0.99. Summarized result findings are as follows (see image 6.1-6.3 for receptor locations):

- North receptors: Receptor no. 1 and 2: Existing dwelling (Ashmount, Moneteen, Mungret) with ground floor windows was examined and resulted in a change factor of 0.99. These receptors are comfortably within the guidelines and the effect is determined as negligible under BRE definitions.
- East receptors: Receptor no. 3 to 4: Existing dwelling (Mungret Community College) with ground floor windows was examined and resulted in a change factor of 0.98. These receptors are comfortably within the guidelines and the effect is determined as negligible under BRE definitions.
- Overall, the average change ratio for VSC is 0.98.

We conclude that the new proposed development's effect on daylight reception in the neighbouring rooms is all within the constraints and recommendations of the BRE Report – Site Layout and Planning for Daylight and Sunlight BR209 2022, and we therefore deem the proposed development to be compliant with this element.

Impact on sunlight in existing amenity areas / Sun on ground reception analysis on existing environment

Based on the BRE guidelines at least 50% of the amenity space should receive at least two hours of sunlight on the 21st of March and that any loss of sunlight should not be greater than 0.80 (20% reduction) times its former size. From the calculation results we note that all the existing amenity spaces received 2 hours of sunlight or more on at least 50% of the area before and after the introduction of the new development. Summary of results are as follows (see image 6.4 for receptor locations):

- East receptor: Receptor no. 1 is an outdoor sports pitch to Mungret Community College. The receptor resulted in a change factor of 0.98. The change happens in the late afternoon/evening hour of 18.00-19.00. The calculation findings are comfortably within the guidelines, and the effect is determined as 'negligible' under BRE definitions.

We conclude that the new proposed development's effect on sunlight reception in the neighbouring amenity areas is all within the constraints and minimum recommendations of the BRE Report – Site Layout and Planning for Daylight and Sunlight BR209 2022, and we therefore deem the proposed development to be compliant with this element.



3 Standards and guidelines

3.1 Standards and guidelines overview

For this report we applied the recommendations and guidelines of the following documents.

- The Building Research Establishment report, BR 209 (2011) Site Layout Planning for Daylight and Sunlight, A Guide to Good Practice. On June 8th, 2022, BR 209 (2011) was replaced with BR 209 (2022) Site Layout Planning for Daylight and Sunlight, A Guide to Good Practice. This report is commonly referenced as the main guide in Ireland/UK in determining the minimum standards of daylight and sunlight and for determining the impact of a development.
- European Standard EN 17037:2018 and British European Standard BS EN 17037:2018 Daylight in buildings, which replaces BS 8206-2:2008. The document contains guidance on interior day lighting and introduces some of the calculation procedures used in the BRE Report.
- IS EN 17037:2018 Daylight in buildings. Irish guidelines.

3.2 BR 209 (2022): Site Layout and Planning for Daylight and Sunlight, A Guide to Good Practice

This document is an updated version of BR 209 (2011) and referred to as the BRE Guidelines. The report contains guidance on how to design developments, whilst minimising the impacts on existing buildings from overshadowing and reduced levels of daylight and sunlight. The BRE guidelines recommend the use of BS EN 17037:2018 for assessing the quality of interior spaces in proposed developments. BS EN 17037 sets out assessment methods for daylight provision and access to sunlight. The advice provided within the guide is not mandatory and should not be seen as an instrument of planning policy. Its aim is to help rather than constrain the designer and should be interpreted flexibly since natural lighting is one of many factors in site layout design.

3.3 EN 17037:2018: Daylight in Buildings

EN 17037 is a daylighting standard published by the European Committee for Standardization (CEN) in 2018. It is applicable across all countries within the EU including Ireland with the Irish edition IS EN17037:2018EN 17037. It provides recommendations for daylight within spaces. Recommendations made in EN 17037 regarding daylight and sunlight exposure have been incorporated into the BRE Guidelines.

3.4 IS EN 17037:2018: Daylight in Buildings

Prior to 2018, Ireland had no standard for daylight. In 2018, the National Standards Authority of Ireland adopted EN 17037 to directly become IS EN 17037.

3.5 BS EN 17037:2018: Daylight in buildings

BS EN 17037:2018: Daylight in Buildings is the British version to the European Standard and also contains a national annex. The national annex (NA) attempts to align the guidance and expectations of the European standard with the now superseded BS 8206-2. Within the British Annex it acknowledges that a rigid application of the European Standard could prove to be a difficult task. Within BS EN 17037 NA, daylight recommendations differ depending on the function of a room and offers minimum daylight provision targets for kitchens, living rooms and bedrooms.

The assessment methodology in this report is built around the above-mentioned documents. The methods proposed are outlined in section 4.



4 Approach and methodology

4.1 General approach

This report assesses the daylight and sunlight reception to the proposed development and the impact on daylight and sunlight to surrounding areas. The results are then compared with the relevant guidelines and recommendations. The calculation assessment is split across two distinct parts:

Performance of proposed development

- Daylight reception analysis of the proposed development
- Sunlight reception analysis of the proposed development

Impact of proposed development on the existing surrounding environment:

- Impact on daylight reception analysis on existing environment
- Impact on sunlight reception analysis on existing environment

4.2 Note on the nature and effects of daylight and sunlight

When assessing the effects of proposed building projects on the potential to cause issues relating to light, it is important to recognise the distinction between daylight and sunlight. Daylight is the combination of all direct and indirect sunlight during the daytime, whereas sunlight (for the purposes of this report) comprises only the direct elements of sunlight. For example, on a cloudy or overcast day diffused daylight still comes in through windows, even when sunlight is absent. Any development within a built-up area has the potential to alter the amount of daylight received by nearby residential properties.

Care should be taken when designing new buildings in built-up areas, especially when the proposed development is relatively tall or situated to the south of existing buildings, because in the northern hemisphere the majority of the sunlight comes from the south. In Ireland (and other northern hemisphere countries) south-facing facades will in general, receive the most sunlight, while the north facing facades will receive sunlight on only a handful of occasions, specifically early mornings and late evenings during the summer months. It is therefore important to ensure that new buildings to the south of any development do not cause over shadowing to existing dwellings and therefore reduce their capacity to receive sunlight.

4.3 Assessment methodology

The analyses and assessments in this report are based on the guidelines recommended in the BRE guide (2022), the guide is intended to be used in conjunction with lighting recommendations in BS EN 17037 Daylight in buildings. It should also be noted that although the BRE guide gives numerical guidelines, these should be interpreted flexibly.

The BRE document sets out in its introduction that *"It is purely advisory and the numerical target values within it may be varied to meet the needs of the development and its location."* *"The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design"*.

Throughout this report an effort will be made to differentiate between metrics used to assess daylight (skylight) versus sunlight. The following sub-sections namely 'New buildings' and 'Existing buildings / existing amenity areas' outline the methodology and assessment criteria carried out.

4.4 New buildings

Daylight provision:

Daylight provision within IS EN 17037 guidelines

The IS EN 17037 explains that *"a space is considered to provide adequate daylight if a target illuminance level is achieved across a fraction of the reference plane within a space for at least half of the daylight hours"*. These guidelines do not provide different illuminance targets for different room types. Therefore, all rooms have the same daylight provision targets. To achieve the minimum level of daylight provision as per table 4.2, the following must be achieved, taken from IS EN 17037:2018 (table ref A.1).

- A minimum target illuminance of 300 lux must be achieved on over 50% of the floor area for over 50% of the available daylight hours.
- A minimum target illuminance of 100 lux must be achieved on over 95% of the floor area for over 50% of the available daylight hours.
- Both targets above must be satisfied for a space to be deemed compliant with the requirements.



Level of recommendation for vertical and inclined daylight opening	Target illuminance ET lx	Fraction of space for target level Fplane,%	Minimum target illuminance ETM lx	Fraction of space for Minimum target level Fplane,%	Fraction of daylight hours Ftime,%
Minimum	300	50%	100	95%	50%
Medium	500	50%	300	95%	50%
High	750	50%	500	95%	50%

Table 4.2: IS EN 17037:2018 target illuminance levels.

These recommendations can also be expressed in terms of a daylight factor. IS EN 17037:2018 (table ref A.3) provides the corresponding daylight factor relative to a recommended target illuminance and target minimum illuminance depending on the location (capital city for individual countries) for daylight. The Dublin daylight factor target recommendations are replicated in table 4.3.

Nation	Capital	Geographic al latitude ϕ [°]	Median External Diffuse Illuminance $E_{v,d,med}$	D to exceed 100 lx	D to exceed 300 lx	D to exceed 500 lx	D to exceed 750 lx
Ireland	Dublin	53,43	14 900	0.7%	2.0%	3.4%	5.0%

Table 4.3: IS EN 17037:2018 target daylight factor levels for Dublin.

Therefore, within IS EN 17037:2018, to achieve the minimum level of daylight provision for vertical openings the following must be achieved:

- A minimum target daylight factor of 2.0% must be achieved on over 50% of the floor area for over 50% of the available daylight hours.
- A minimum target daylight factor of 0.7% must be achieved on over 95% of the floor area for over 50% of the available daylight hours.
- Both targets above must be satisfied for a space to be deemed compliant with the requirements.

Daylight provision within BS EN 17037 National Annex

In the UK, EN 17037 was adopted to form BS EN 17037 and a national annex was also included. The national annex offers additional targets and guidance for daylight provision in residential developments and states “*it is the opinion of the UK committee that the recommendations for daylight provision in a space may not be achievable for some buildings.*” The national annex gives specific minimum recommendations for habitable rooms in dwellings in the UK. These are intended for ‘hard to light’ dwellings. The national annex therefore provides the UK guidance on minimum daylight provision in all UK dwellings, these are 100 lux in bedrooms, 150 lux in living rooms and 200 lux in kitchens, to be exceeded over at least 50% of the assessment points in the room for at least half of the daylight hours.

Habitable room types	BS EN17037 National Annex Minimum target Illuminance	BS EN17037 Corresponding minimum target daylight factor (Dublin)
Kitchen	200 lux	1.3%
Living rooms	150 lux	1.0%
Bedrooms	100 lux	0.7%
Living, Kitchen, Dining	200 lux	1.3%

Table 4.4: BS EN 17037 minimum target Illuminances and daylight factor for dwellings.



Daylight provision within BR 209 (2022) guidelines

The BRE guide is intended to be used in conjunction with recommendations in BS EN 17037. The guide states that *"Daylight provision in new rooms may be checked using either of the methods in BS EN 17037 Daylight in Buildings: direct prediction of illuminance levels using hourly climate data, or the use of the daylight factor"*. The two methods to assess daylight provision to the interior which are based on target values.

- Method 1-Daylight factor method: This calculation method uses the daylight factor targets on the reference plane. The Daylight factor is the illuminance at a point on a reference plane in a space, divided by the illuminance on an unobstructed horizontal surface outdoors. The assessment is carried out on a representative day and time during the year, i.e., under standard CIE overcast sky conditions. BS EN 17037 gives the Median External Diffuse Illuminance ($E_{v,d,med}$) for the capital cities throughout Europe to account for external local illuminance levels.
- Method 2-Illuminance method: This calculation method uses the illuminance targets on the reference plane. The assessment requires the use of a suitable weather file which accounts for varying sky conditions and sun positions throughout the year and takes into account the orientation of the space

Equivalent daylight factor targets to achieve a target illuminance over at least half of the daylight hours in a year are based on the formula: Target daylight factor (DT) = target illuminance/ $E_{v,d,med}$ x 100 [%].

Where, $E_{v,d,med}$ is the median diffuse horizontal illuminance from the sky (as recommended for Dublin, Ireland).

The daylight factor (D) addresses daylight provision as a ratio of unobstructed external illuminance under overcast sky conditions. The daylight factor is defined as $D = E_i/E_o \times 100[\%]$, where,
 E_i =illuminance due to daylight at a point on the indoors working plane.
 E_o = simultaneous outdoor illuminance on a horizontal plane from an unobstructed hemisphere of overcast sky.

Table 4.5 provides the target illuminances from daylight over at least half of the daylight hours and thus the corresponding calculated daylight factor targets for side lit rooms for Dublin.

Level of recommendation for vertical and inclined daylight opening	Target illuminance (lx) for half of assessment grid	Target illuminance ETM (lx) for 95% of assessment grid	Target daylight factor D for half of assessment grid (Dublin)	Target daylight factor D for 95% of assessment grid (Dublin)
Minimum	300	100	2.0%	0.7%
Medium	500	300	3.4%	2.0%
High	750	500	5.0%	3.4%

Table 4.5: Target illuminances and thus the corresponding calculated daylight factor targets for side lit rooms for Dublin.

The recommendations for rooms are met if both target daylight factors are achieved; the median daylight factor over 50% of the reference plane, and the minimum daylight factor over 95% of the reference plane.

Project calculation parameters

The following values were used in the daylighting calculations.

Element	DKP metrics	Comments
Internal and external factors:		
Ceilings	0.8	Light
Walls	0.5	Medium dark
Floor	0.2	Dark
Exterior walls and obstructions	0.2	
Exterior ground	0.2	
Maintenance factors:		
Glass light diffuse transmittance	0.68	
Glazing maintenance factor	0.92	

Table 4.6: Project calculation parameters.



Sunlight provision:

Sunlight to proposed amenity spaces / Sun on ground

Acceptable criterion within the BRE guidelines for sunlight reception recommends that at least half of the amenity area should receive at least two hours of sunlight on the 21st of March. The minimum sunlight requirement in this report measured in sunlight time 2 hours (120 minutes) multiplied by 50% area m² or the minimum requirement = 120 (min) * 0.5a (m²) = [] min·m².

Analysis	BRE recommendation, criteria on March 21 st	Acceptable sunlight reception parameters
Sunlight reception	Minimum sunlight reception in amenity spaces	At least 50% of the total area to receive at least 2 hours sunshine

Table 4.7: Sunlight to proposed amenity spaces / Sun on ground assessment

The sunlight assessment is executed using a 3D model of the project with the results illustrated in tabular format showing the hourly status of the shadow / sunlight fraction in the relevant amenity spaces. Appendix A provides the 3D images. The impacts of vegetation: It is important to note that according to the BRE Report, calculations do not normally take into account vegetation. The exception is when evergreen vegetation exists that forms a continuous barrier and would be permanent throughout the seasons.

4.5 Existing buildings

Impact on daylight provision:

Daylight provision to surrounding existing buildings

The impact of the proposed development on the existing buildings with respect to daylight can be assessed using the following methodologies advised in the BRE guide.

- The distance test: loss of light to windows need not be analysed if the distance from the existing window to the development is three or more times its height above the centre of the existing window.
- The 25° rule: loss of light to windows need not be analysed if the angle to the horizontal subtended by the new development from the centre of the existing window is less than 25° (an angle of 25° equates to a VSC of 27%).
- Vertical Sky Component (VSC) assessment: diffuse daylight of an existing building may be adversely affected by a proposed development if either: the vertical sky component measured at the centre of an existing main window is less than 27%, and less than 0.8 times its former value; or the area of the working plane which can receive direct skylight is reduced to less than 0.8 times its former value.

The impact assessment of daylight is required for windows serving rooms in adjoining dwellings where daylight is required including living rooms, kitchens and bedrooms. Windows to bathrooms, toilets, storerooms, circulation areas and garages need not be assessed. The guidelines also apply to any room that may have a reasonable expectation of daylight, including schools, hospitals, hotels and some offices. To ensure a neighbouring property is not adversely affected, VSC is calculated and assessed in this report. This report assesses the percentage of direct sky illuminance that falls on the assessment point of neighbouring windows that could be affected by the proposed development, image 4.1 represents this.

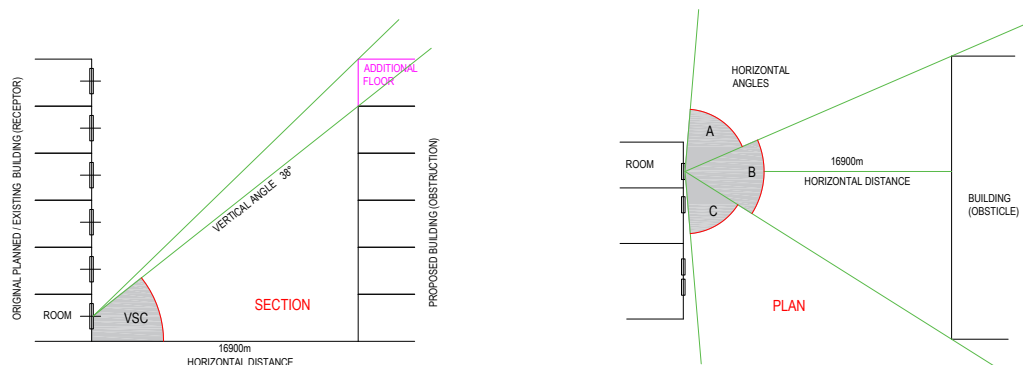


Image 4.1:

VSC gives a measure of daylight received on the outside of a window. Stated within BR 209 (2022) "if the VSC is greater than 27% then enough skylight should still be reaching the window of the existing building. Any reduction

below this level should be kept to a minimum. If the VSC, with the new development in place, is both less than 27% and less than 0.80 times its former value, occupants of the existing building will notice the reduction in the amount of skylight". Table 4.8 details the BRE assessment criteria for daylight reception for existing windows.

Analysis	Description	Acceptable parameters
Daylight reception	Existing daylight incoming angle	Existing angles should not be affected more than 0.8 time its former value or a maximum loss of 20%.

Table 4.8: VSC assessment.

In this report, the VSC of the assessment point on each of the assessed windows will be calculated, both in the baseline state and in the proposed state. The baseline state reflects the current VSC of the window, the proposed state will determine what the VSC of the window would be if the proposed development is built as planned.

Impact on sunlight provision:

Neighbouring Properties – Sunlight on the Ground (Shadow) Gardens and Open spaces

Sunlight provision in existing amenity areas: BRE (2022), recommendations are given as to the quantity of sunlight in amenity areas that is required to produce a well sunlit space throughout the year. "It is recommended that for it to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on 21st of March. If as a result of new development, an existing garden or amenity area does not meet the above, and the area which can receive two hours of sun on 21st of March is less than 0.80 times its former value, then the loss of sunlight is likely to be noticeable". Calculations were conducted in accordance with the BRE guidelines to determine the extent to which the proposed development could affect the shadow / sunlight reception in the selected existing neighbouring amenity spaces. For existing amenity spaces any loss of sunlight should not be greater than 0.8 times its former size on March 21st.

Analysis	Criteria on March 21 st	Acceptable sunlight reception parameters
Sunlight reception	Minimum sunlight reception in amenity spaces	At least 80% or 0.8 x its former sunlight reception.

Table 4.9: Sunlight in existing amenity areas.

Sunlight provision in existing amenity areas is recommended to be checked for all open spaces where it is required. BRE recommends spaces such as, gardens, such as the main back garden of a house or communal gardens including courtyards and roof terraces, parks and playing fields, children's playgrounds, outdoor swimming pools and paddling pools, and other areas of recreational water such as marinas and boating lakes, sitting out areas such as those between non-domestic buildings and in public squares, nature reserves (which may have special requirements for sunlight if rare plants are growing there).

Design Model: A 3D model of the proposed development and the surrounding neighbouring properties was provided by the Architect. SketchUp Pro 2023 design model was used to examine potential impacts. The model was geo-referenced to its correct location and an accurate solar daylight system was introduced. The 3D model of the project with the results illustrated in tabular format showing the hourly status of the shadow/sunlight fraction in the relevant amenity spaces is used to undertake the sun light assessment. Appendix A provides the illustrations in hourly sections.



4.6 Summary of analysis

The table below summarises the assessments carried out in this report.

Element	Guidelines	
Performance of proposed development		
Daylight	Daylight – IS EN 17037 / BS EN 17307	To achieve the daylight provision outlined in IS / BS EN 17037:2018 a given room is recommended to achieve: Using method 1: • A target daylight factor of 2.0% must be achieved on over 50% of the floor area for over 50% of the available daylight hours. • A target daylight factor of 0.7% must be achieved on over 95% of the floor area for over 50% of the available daylight hours. Or using method 2: • A target illuminance of 300 lux must be achieved on over 50% of the floor area for over 50% of the available daylight hours. • A target illuminance of 100 lux must be achieved on over 95% of the floor area for over 50% of the available daylight hours.
	Daylight - National annex BS EN 17037	To achieve the alternate minimum daylight provision outlined in the national annex of BS EN 17037:2018, the room is recommended to achieve: • Kitchens, 1.3% target daylight factor or 200 lux over 50% of the floor area for over half the daylight hours. • Living rooms, 1.0% target daylight factor or 150 lux over 50% of the floor area for over half the daylight hours. • Bedrooms, 0.7% target daylight factor or 100 lux over 50% of the floor area for over half the daylight hours.
Sunlight	Sunlight in amenity areas / Sun on ground	To meet the minimum recommendations given in BR 209 (2022), a new amenity space should experience two hours sunlight on March 21st for at least 50% of its area.
Impact of the proposed development on the existing surrounding environment		
Daylight	Vertical Sky Component (VSC)	To meet the recommendations in BR 209 (2022), the VSC with the new development in place, should be greater than 27% or greater than 0.80 times its former value.
Sunlight	Sunlight in existing amenity areas / Sun on ground	To meet the recommendations in BR 209 (2022), an existing amenity space, with the new development in place should experience in excess of two hours sunlight on March 21st for at least 50% of its area and should be greater than 0.80 times the previous value.

Table 4.10: Summary of assessments.



4.7 Note on receptors

The BRE guide states that when assessing the potential effects of a proposed development on existing buildings, only those windows and rooms that have a reasonable expectation of daylight and sunlight need to be considered. Windows and rooms which meet this criterion are considered to be sensitive receptors. The BRE guide clarifies what are considered sensitive receptors with respect to sunlight and daylight as follows: "The guidelines given here are intended for use for rooms in adjoining dwellings where daylight is required, including living rooms, kitchens and bedrooms. Windows to bathrooms, toilets, storerooms, circulation areas and garages need not be analysed".

The guidelines may also be applied to any existing non-domestic building where the occupants have a reasonable expectation of daylight; this would normally include schools, hospitals, hotels and hostels, small workshops and some offices. Outdoor amenity spaces which have a reasonable expectation of sunlight, whether they are private gardens, communal open spaces or outdoor public amenity areas, are also considered sensitive receptors. Receptors that may be affected by the proposed development are highlighted in the calculation section of each appropriate analysis.

4.8 Note on the definition of effects

Guidelines from Appendix H in the BRE guidelines is used to categorise the varying degrees of compliance when assessing the impact, a proposed development might have on the daylight and sunlight of an existing environment. The table of definitions given below is used in the results section of this report, for the purposes of categorising the impact on sunlight and daylight.

Effect	Definition of effect
Negligible	Where any loss of daylight / sunlight is well within the guidelines, or only a small number of windows or area of space lose daylight / sunlight but still within the guidelines, then the impact is assessed as negligible.
Minor Adverse	If the level of effect is marginally outside of the criteria as stated in the relevant guidelines, a minor adverse level of effect will be applied if the level of daylight / sunlight is within 5% of the target guideline.
Moderate Adverse	If the level of effect is outside of the criteria as stated in the relevant guidelines, a moderate adverse level of effect will be applied if the level of daylight / sunlight is within 5-10% of the target guideline.
Major Adverse	If the level of effect is outside of the criteria as stated in the relevant guidelines, a moderate adverse level of effect will be applied if the level of daylight / sunlight is in excess of 10% of the target value.
Beneficial Impact	If the ratio of change is > 1.10 (an improvement of 10%), then the impact is assessed as a beneficial impact. Should less significant improvements occur a negligible level of effect will be stated.

Table 4.11: Definition of effects used in the impact assessments.



5 Performance of proposed development – Calculation results and conclusion

The performance of the proposed development calculations is broken into two sections, daylight reception and sunlight reception.

Daylight Reception:

5.1 Receptor selection – Rooms within the proposed development

The daylight reception assessment has been targeted to habitable rooms within the proposed housing development which are perceived to be in the most challenging locations or rooms positioned with close by obstacles. Once a (lowest level) room is compliant, rooms at higher levels with similar configuration / parameters are deemed compliant on the basis that the room daylight factor would have improved due to the better vertical sky view angle of higher located rooms. Receptors / rooms within the proposed development are indicated in image 5.1 to 5.12 below.

- Houses – a large selection of habitable rooms on the ground floor which are observed to be in the most daylight challenging positions or rooms positioned with close by obstacles have been assessed.
- Triplex unit: all habitable rooms on the ground floor and first floor have been assessed.
- Apartments – all habitable rooms on the ground floor and first floor have been assessed.

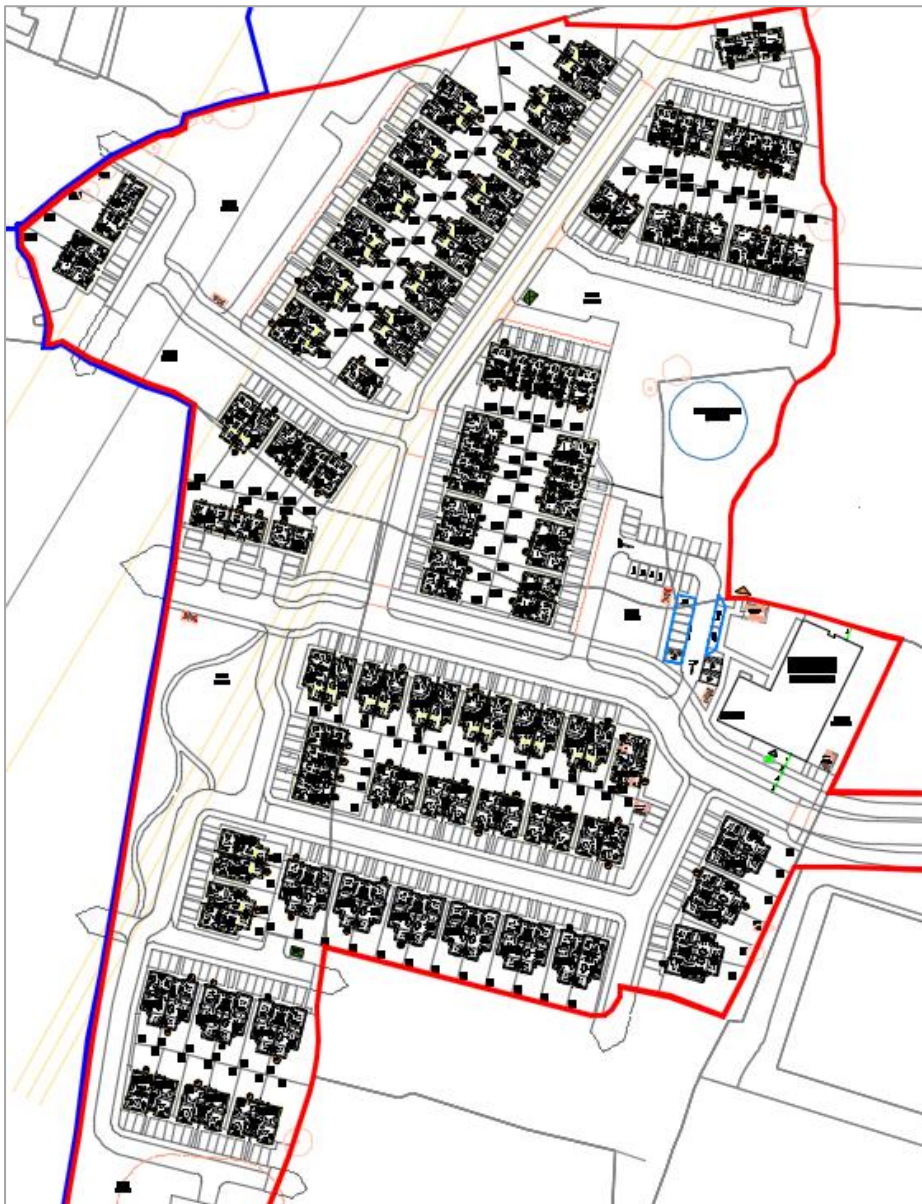


Image 5.1: Overall proposed site view.

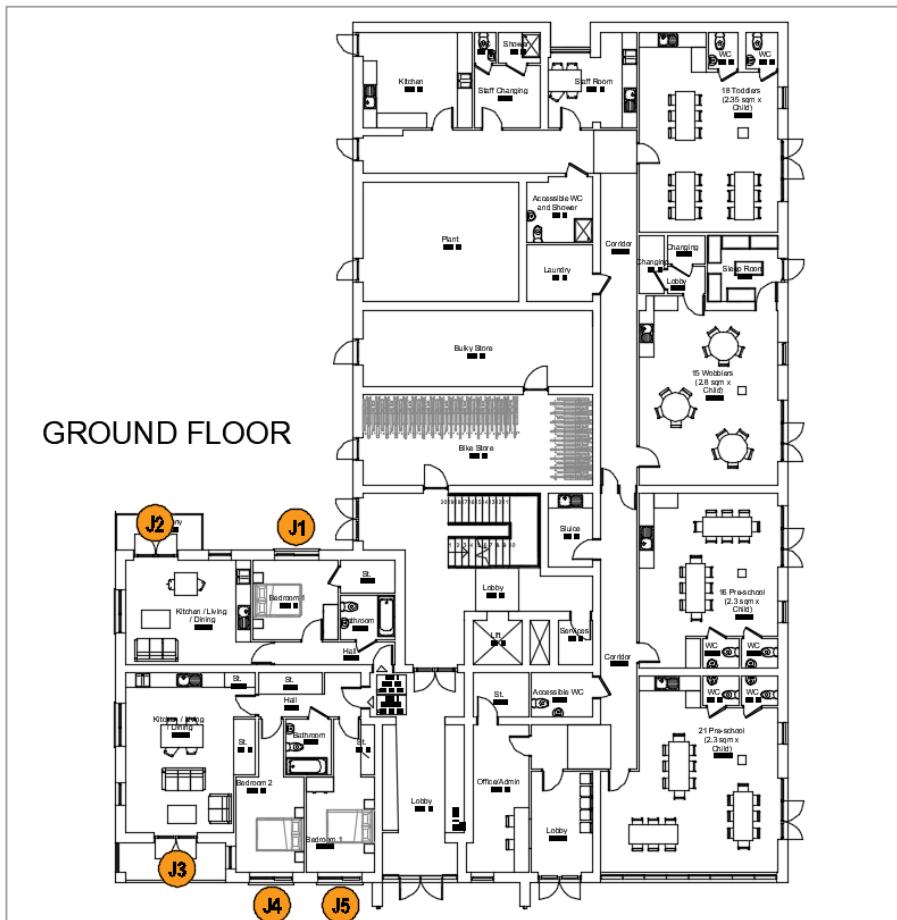


Image 5.2: Level 00 (ground floor). Apartment block J. Receptor no. J1-J5.

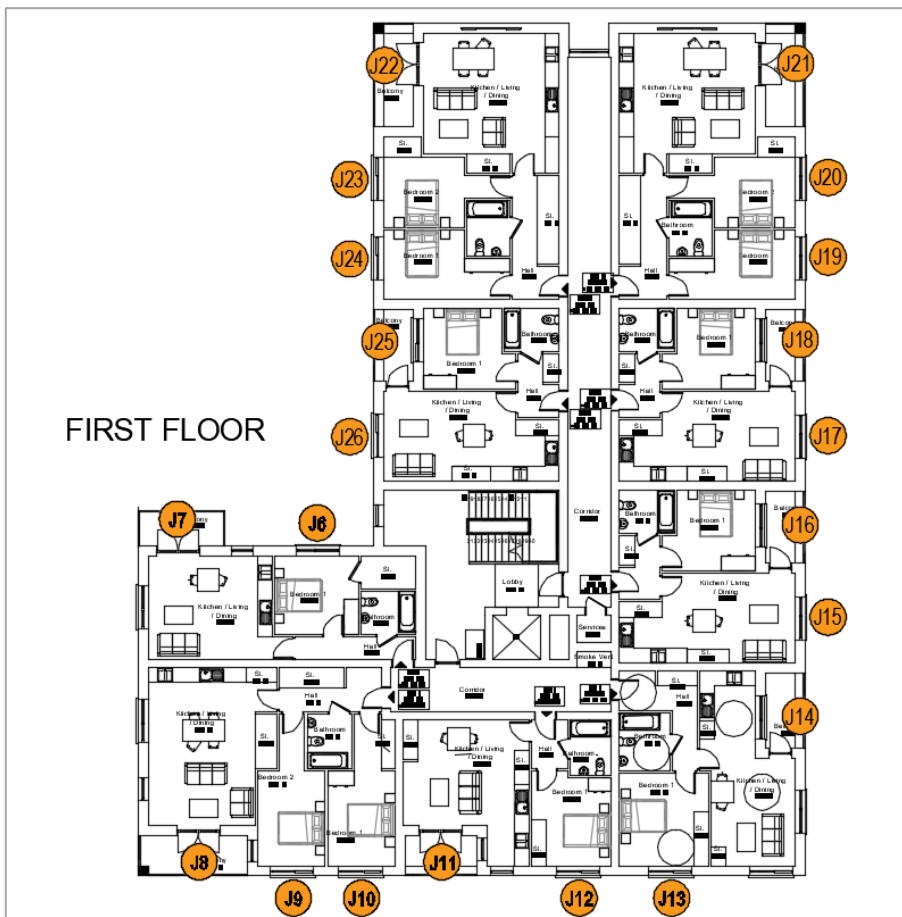


Image 5.3: Level 01 (first floor). Apartment block J. Receptor no. J6-J26.





Image 5.4: Level 00 (ground floor). Houses. Receptor no. H1-H9.

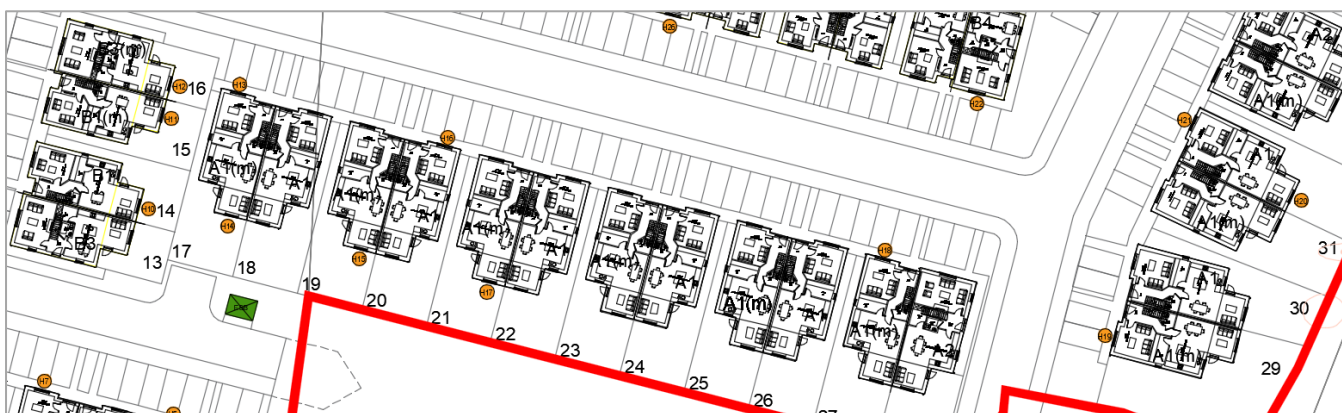


Image 5.5: Level 00 (ground floor). Houses. Receptor no. H10-H21.

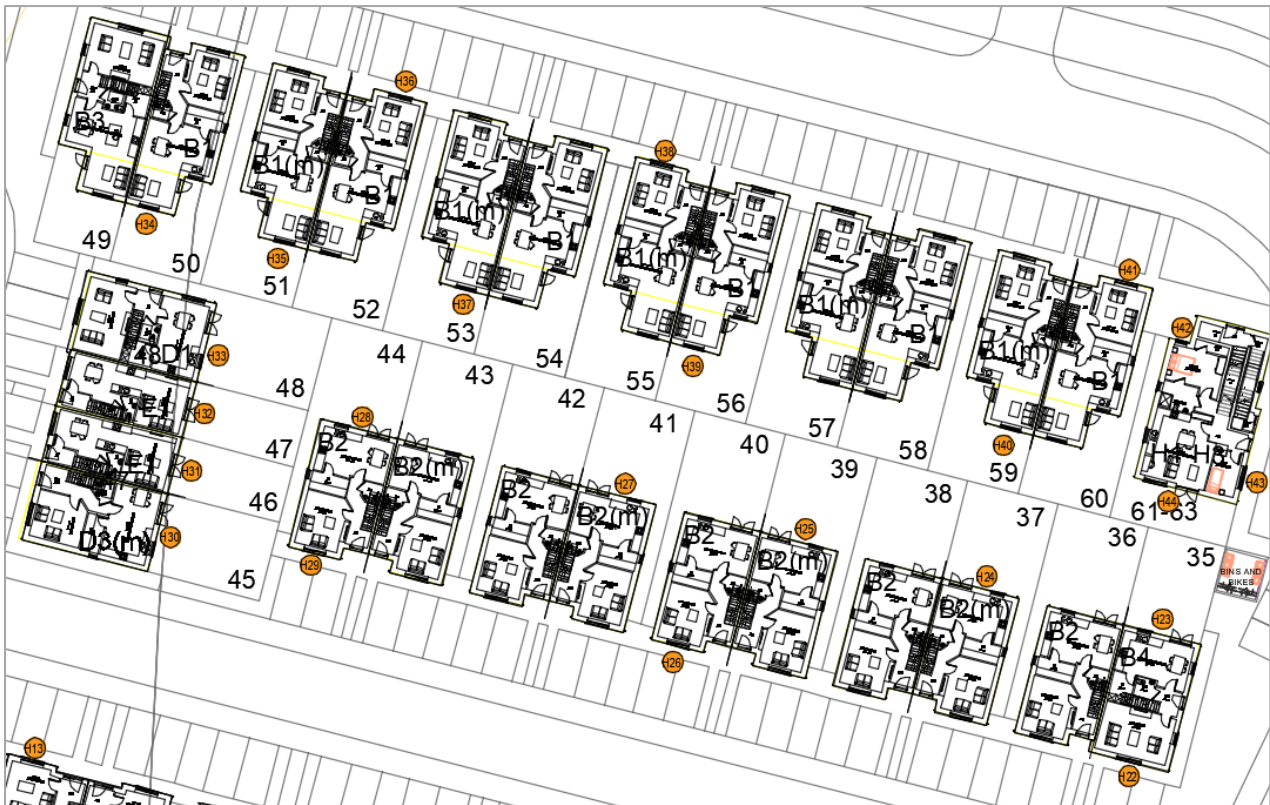


Image 5.6: Level 00 (ground floor). Houses. Receptor no. H22-H41.

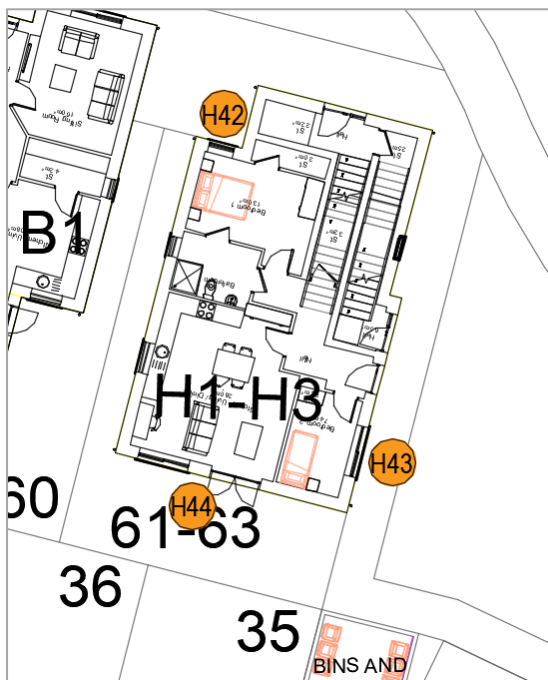


Image 5.7: Level 00 (ground floor). Triplex unit. Receptor no. H42-H44.

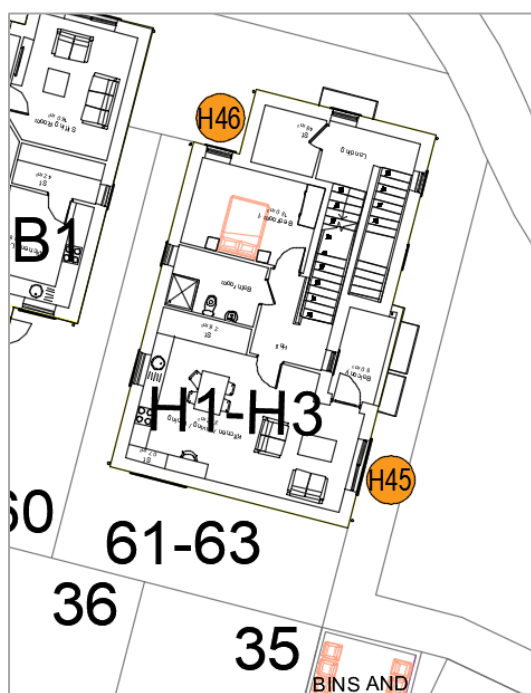


Image 5.8: Level 01 (first floor). Triplex unit. Receptor no. H5-H46.

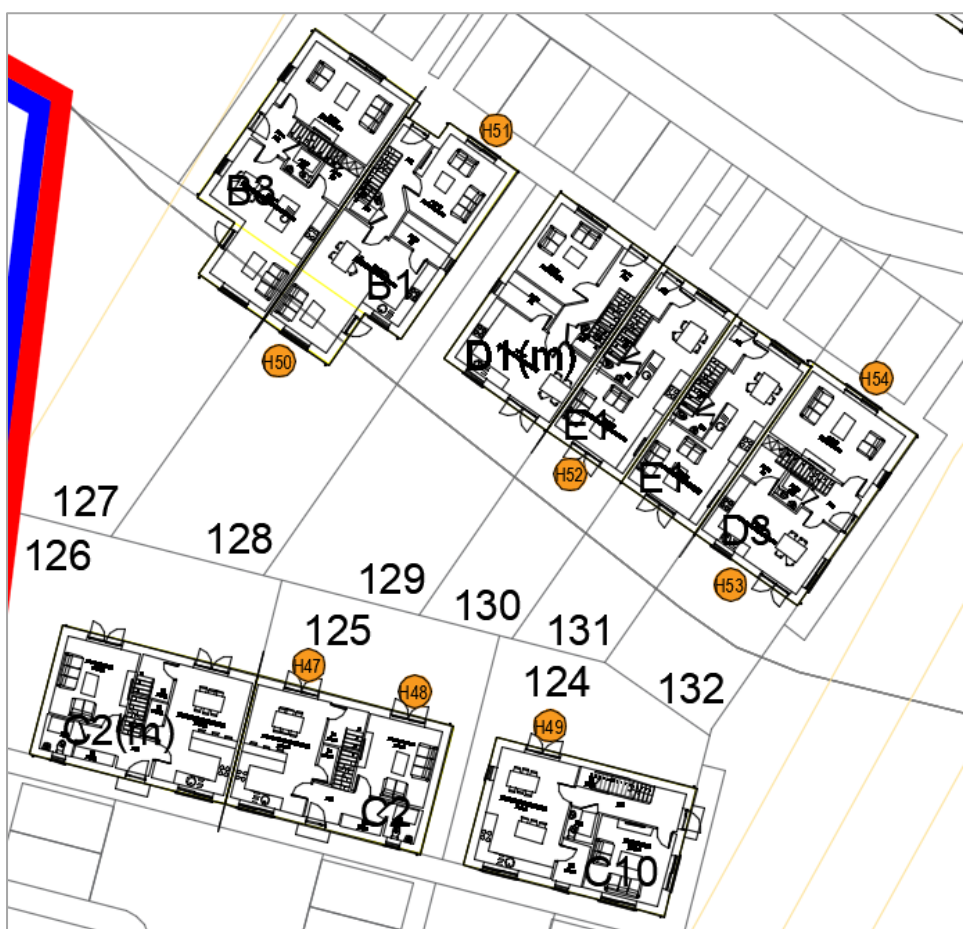


Image 5.9: Level 00 (ground floor). Houses. Receptor no. H47-H54.

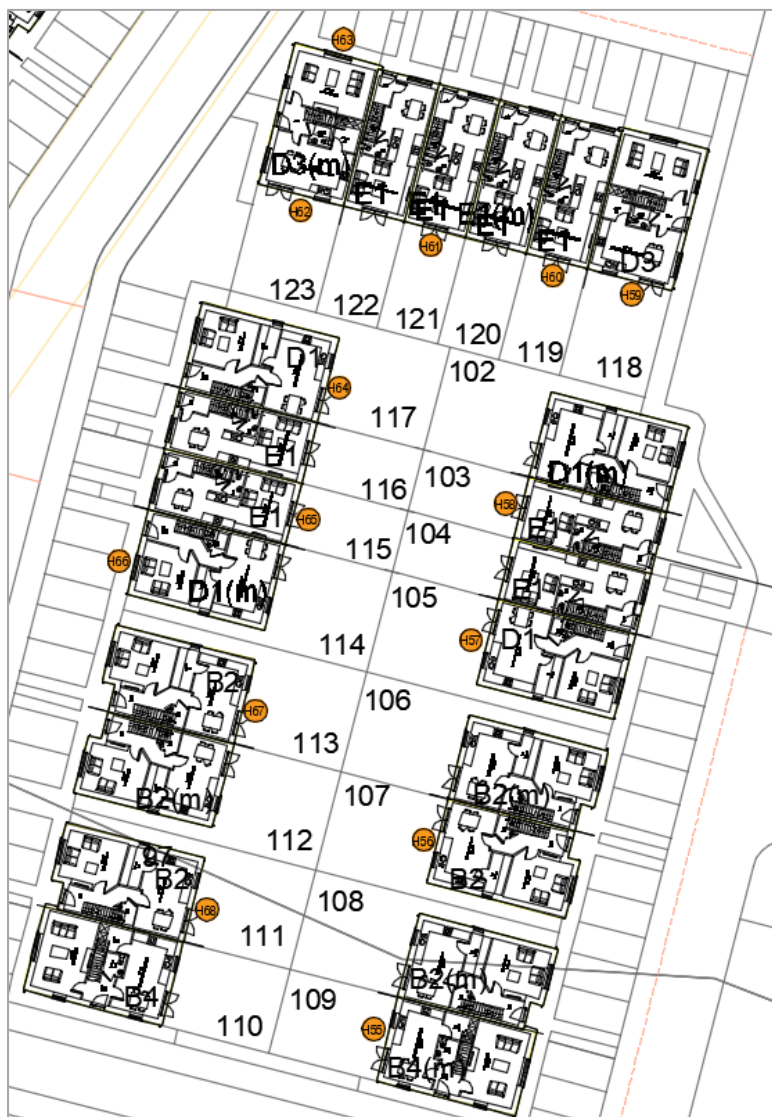


Image 5.10: Level 00 (ground floor). Houses. Receptor no. H55-H68.

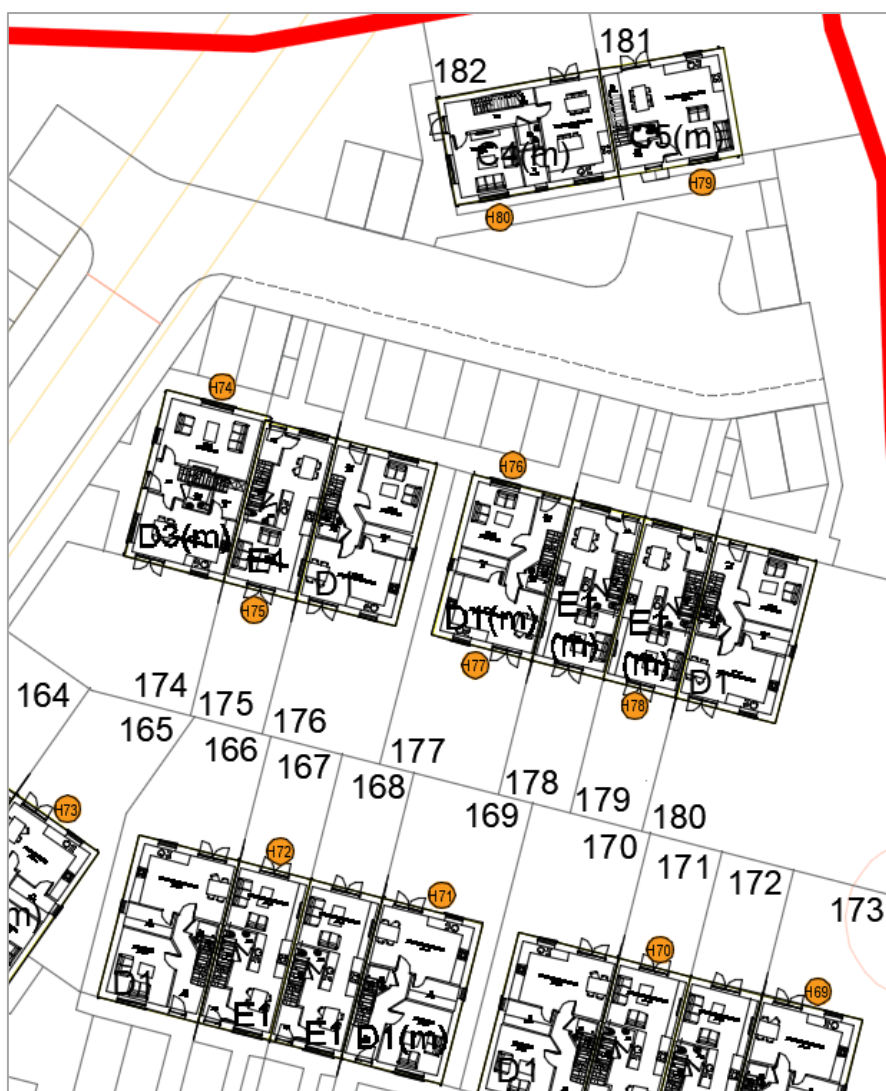


Image 5.11: Level 00 (ground floor). Houses. Receptor no. H69-H80.

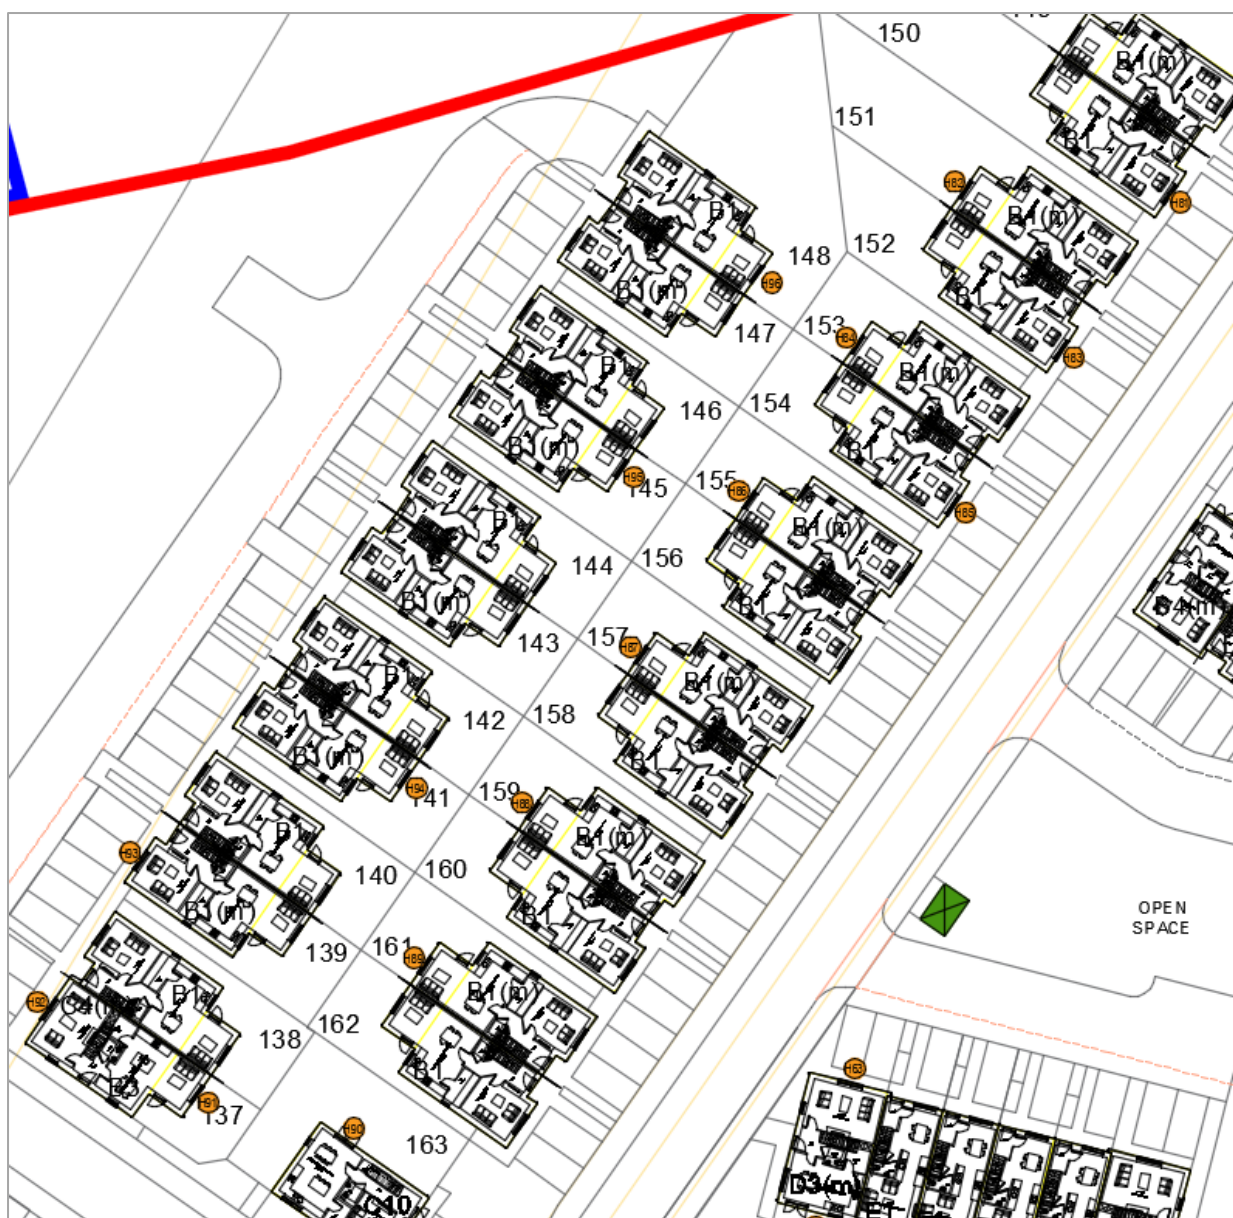


Image 5.12: Level 00 (ground floor). Houses. Receptor no. H81-H96.

5.2 Calculation result table

The results table below provide the full calculation results of the selected receptors / rooms. IS EN17037 / BS EN17037 daylight factor and illuminance levels are provided and the National Annex (NA) target values in BS EN17037. The calculation results have been given the following colour code guide depending on its level of resulting compliance within each guideline.

Compliance hierarchy

☑☑	>=100%
☑	<100% , >95%
☑	<95% , >90%
!!	<90% , >80%
x	<80%

Receptor	Level/Floor	Block / Unit ID	Room / type	glass area m2	room area m2	glass ratio %	Depth/Width	Σ VSC L (total)	ISEN17037				ISEN17037				BSEN17037	
									DAY LIGHT FACTOR				ILLUMINANCE				ANNEX	
									50% area		95% area		50% area		95% area		illuminance lx	day light factor %
									50% sun hrs		50% sun hrs		50% sun hrs		50% sun hrs			
									%	min	%	min	%	min	%	min		
J1	00	Block J. Apt 01	Bed room	2.76	11.4	24.2	2.54	23%	2.01	2.00	0.70	0.70	304	300	100	100	100	0.7
J2	00	Block J. Apt 01	Living-Kitchen	6.65	22.1	30.0	2.27	28%	3.55	2.00	1.24	0.70	537	300	177	100	200	1.3
J3	00	Block J. Apt 02	Living-Kitchen	6.65	29.2	22.7	1.42	30%	3.08	2.00	1.08	0.70	466	300	154	100	200	1.3
J4	00	Block J. Apt 02	Bed room	4.28	10.9	39.1	1.91	29%	3.82	2.00	1.34	0.70	578	300	191	100	100	0.7
J5	00	Block J. Apt 02	Bed room	2.76	10.9	25.2	1.91	33%	2.88	2.00	1.01	0.70	436	300	144	100	100	0.7
J6	01	Block J. Apt 03	Bed room	2.76	11.4	24.2	2.54	24%	2.08	2.00	0.73	0.70	314	300	104	100	100	0.7
J7	01	Block J. Apt 03	Living-Kitchen	6.65	22.1	30.0	2.27	29%	3.69	2.00	1.29	0.70	557	300	184	100	200	1.3
J8	01	Block J. Apt 04	Living-Kitchen	6.65	29.2	22.7	1.42	31%	3.28	2.00	1.15	0.70	496	300	164	100	200	1.3
J9	01	Block J. Apt 04	Bed room	4.28	10.9	39.1	1.91	30%	4.02	2.00	1.41	0.70	608	300	201	100	100	0.7
J10	01	Block J. Apt 04	Bed room	2.76	10.9	25.2	1.91	34%	3.02	2.00	1.05	0.70	456	300	150	100	100	0.7
J11	01	Block J. Apt 05	Living-Kitchen	5.42	23.9	22.6	2.13	27%	2.68	2.00	0.94	0.70	405	300	134	100	200	1.3
J12	01	Block J. Apt 05	Bed room	2.76	12.2	22.6	2.18	35%	2.88	2.00	1.01	0.70	436	300	144	100	100	0.7
J13	01	Block J. Apt 06	Bed room	2.76	12.2	22.6	2.01	35%	2.88	2.00	1.01	0.70	436	300	144	100	100	0.7
J14	01	Block J. Apt 06	Living-Kitchen	8.27	23.1	35.8	3.02	30%	4.56	2.00	1.59	0.70	689	300	227	100	200	1.3
J15	01	Block J. Apt 07	Living-Kitchen	4.28	23.0	18.6	1.32	35%	2.81	2.00	0.98	0.70	426	300	140	100	200	1.3
J16	01	Block J. Apt 07	Bed room	2.76	10.9	25.3	2.54	27%	2.41	2.00	0.84	0.70	365	300	120	100	100	0.7
J17	01	Block J. Apt 09	Living-Kitchen	4.28	23.0	18.6	1.32	35%	2.81	2.00	0.98	0.70	426	300	140	100	200	1.3
J18	01	Block J. Apt 09	Bed room	2.76	10.9	25.3	2.54	27%	2.41	2.00	0.84	0.70	365	300	120	100	100	0.7
J19	01	Block J. Apt 11	Bed room	2.76	9.6	28.8	2.28	36%	3.42	2.00	1.20	0.70	517	300	171	100	100	0.7
J20	01	Block J. Apt 11	Bed room	2.76	9.6	28.8	2.28	36%	3.42	2.00	1.20	0.70	517	300	171	100	100	0.7
J21	01	Block J. Apt 11	Living-Kitchen	4.48	29.1	15.4	1.76	29%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
J22	01	Block J. Apt 10	Living-Kitchen	4.48	29.1	15.4	1.76	29%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
J23	01	Block J. Apt 10	Bed room	2.76	9.6	28.8	2.28	31%	3.02	2.00	1.05	0.70	456	300	150	100	100	0.7
J24	01	Block J. Apt 10	Bed room	2.76	9.6	28.8	2.28	31%	2.95	2.00	1.03	0.70	446	300	147	100	100	0.7
J25	01	Block J. Apt 08	Bed room	2.76	10.9	25.3	2.54	27%	2.35	2.00	0.82	0.70	355	300	117	100	100	0.7
J26	01	Block J. Apt 08	Living-Kitchen	4.28	23.0	18.6	1.32	26%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H1	00	House no.01	Living-Kitchen	5.12	19.0	26.9	3.01	31%	3.42	2.00	1.20	0.70	517	300	171	100	200	1.3
H2	00	House no.03	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H3	00	House no.05	Living-Kitchen	4.00	19.6	20.4	2.92	31%	2.61	2.00	0.91	0.70	395	300	130	100	200	1.3
H4	00	House no.12	Living-Kitchen	5.05	36.0	14.0	1.66	31%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
H5	00	House no.11	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H6	00	House no.10	Living-Kitchen	5.05	36.0	14.0	1.66	30%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H7	00	House no.09	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H8	00	House no.08	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H9	00	House no.08	Living-Kitchen	5.05	36.0	14.0	1.66	31%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
H10	00	House no.14	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H11	00	House no.15	Living-Kitchen	5.05	30.7	16.4	1.80	27%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3



H12	00	House no.16	Living-Kitchen	5.05	30.7	16.4	1.80	27%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H13	00	House no.17	Living-Kitchen	2.55	16.0	15.9	2.20	32%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H14	00	House no.17	Living-Kitchen	5.05	36.0	14.0	1.66	32%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H15	00	House no.19	Living-Kitchen	5.05	36.0	14.0	1.66	33%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H16	00	House no.20	Living-Kitchen	2.55	16.0	15.9	2.20	32%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H17	00	House no.21	Living-Kitchen	5.05	36.0	14.0	1.66	35%	2.41	2.00	0.84	0.70	365	300	120	100	200	1.3
H18	00	House no.27	Living-Kitchen	2.55	16.0	15.9	2.20	32%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H19	00	House no.29	Living-Kitchen	2.55	16.0	15.9	2.20	34%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
H20	00	House no.32	Living-Kitchen	5.05	36.0	14.0	1.66	36%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H21	00	House no.32	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H22	00	House no.35	Living-Kitchen	3.97	21.7	18.3	2.65	32%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H23	00	House no.35	Living-Kitchen	5.12	19.0	26.9	3.01	30%	3.22	2.00	1.13	0.70	486	300	160	100	200	1.3
H24	00	House no.37	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H25	00	House no.39	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H26	00	House no.40	Living-Kitchen	2.55	16.0	15.9	2.20	32%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H27	00	House no.41	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H28	00	House no.44	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H29	00	House no.44	Living-Kitchen	2.55	16.0	15.9	2.20	32%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H30	00	House no.45	Living-Kitchen	4.00	21.2	18.9	2.77	29%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H31	00	House no.46	Living-Kitchen	5.38	32.3	16.7	1.03	31%	2.35	2.00	0.82	0.70	355	300	117	100	200	1.3
H32	00	House no.47	Living-Kitchen	5.38	32.3	16.7	1.03	31%	2.35	2.00	0.82	0.70	355	300	117	100	200	1.3
H33	00	House no.48	Living-Kitchen	4.00	21.2	18.9	2.77	29%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H34	00	House no.50	Living-Kitchen	5.05	30.7	16.4	1.80	26%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H35	00	House no.51	Living-Kitchen	5.05	30.7	16.4	1.80	27%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H36	00	House no.52	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H37	00	House no.53	Living-Kitchen	5.05	30.7	16.4	1.80	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H38	00	House no.55	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H39	00	House no.56	Living-Kitchen	5.05	30.7	16.4	1.80	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H40	00	House no.59	Living-Kitchen	5.05	30.7	16.4	1.80	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H41	00	House no.60	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H42	00	Triplex	Bed room	1.17	10.4	11.3	3.01	21%	0.80	2.00	0.28	0.70	122	300	40	100	100	0.7
H43	00	Triplex	Bed room	2.38	7.7	30.9	3.71	31%	2.88	2.00	1.01	0.70	436	300	144	100	100	0.7
H44	00	Triplex	Living-Kitchen	6.38	28.1	22.7	1.82	26%	2.75	2.00	0.96	0.70	415	300	137	100	200	1.3
H45	01	Triplex	Living-Kitchen	4.38	30.0	14.6	2.74	32%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
H46	01	Triplex	Bed room	1.17	11.1	10.5	2.80	24%	0.87	2.00	0.30	0.70	132	300	43	100	100	0.7
H47	00	House no.125	Living-Kitchen	5.00	22.4	22.3	1.47	31%	2.95	2.00	1.03	0.70	446	300	147	100	200	1.3
H48	00	House no.125	Living-Kitchen	3.00	15.2	19.7	2.15	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H49	00	House no.124	Living-Kitchen	5.00	23.6	21.2	1.51	31%	2.88	2.00	1.01	0.70	436	300	144	100	200	1.3
H50	00	House no.128	Living-Kitchen	5.05	30.7	16.4	1.80	30%	2.35	2.00	0.82	0.70	355	300	117	100	200	1.3
H51	00	House no.128	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H52	00	House no.130	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.35	2.00	0.82	0.70	355	300	117	100	200	1.3
H53	00	House no.132	Living-Kitchen	4.00	21.2	18.9	2.77	30%	2.41	2.00	0.84	0.70	365	300	120	100	200	1.3
H54	00	House no.132	Living-Kitchen	3.97	21.7	18.3	2.65	33%	2.55	2.00	0.89	0.70	385	300	127	100	200	1.3
H55	00	House no.109	Living-Kitchen	4.91	19.0	25.8	3.01	30%	3.08	2.00	1.08	0.70	466	300	154	100	200	1.3
H56	00	House no.107	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H57	00	House no.105	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H58	00	House no.103	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H59	00	House no.118	Living-Kitchen	6.55	21.2	30.9	2.78	29%	3.75	2.00	1.31	0.70	567	300	187	100	200	1.3
H60	00	House no.119	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H61	00	House no.121	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H62	00	House no.123	Living-Kitchen	6.55	21.2	30.9	2.78	29%	3.75	2.00	1.31	0.70	567	300	187	100	200	1.3
H63	00	House no.123	Living-Kitchen	3.97	21.7	18.3	2.65	33%	2.55	2.00	0.89	0.70	385	300	127	100	200	1.3
H64	00	House no.117	Living-Kitchen	4.00	19.6	20.4	2.92	29%	2.41	2.00	0.84	0.70	365	300	120	100	200	1.3
H65	00	House no.115	Living-Kitchen	5.38	32.3	16.7	1.03	31%	2.35	2.00	0.82	0.70	355	300	117	100	200	1.3
H66	00	House no.114	Living-Kitchen	2.38	15.2	15.7	2.15	33%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H67	00	House no.113	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H68	00	House no.111	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3



H69	00	House no.173	Living-Kitchen	4.00	19.6	20.4	2.92	33%	2.75	2.00	0.96	0.70	415	300	137	100	200	1.3
H70	00	House no.171	Living-Kitchen	5.38	32.3	16.7	1.03	33%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H71	00	House no.169	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H72	00	House no.167	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H73	00	House no.165	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H74	00	House no.174	Living-Kitchen	3.97	21.7	18.3	2.65	33%	2.55	2.00	0.89	0.70	385	300	127	100	200	1.3
H75	00	House no.175	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H76	00	House no.177	Living-Kitchen	2.38	15.2	15.7	2.15	33%	2.01	2.00	0.70	0.70	304	300	100	100	200	1.3
H77	00	House no.177	Living-Kitchen	4.00	19.6	20.4	2.92	30%	2.48	2.00	0.87	0.70	375	300	124	100	200	1.3
H78	00	House no.179	Living-Kitchen	5.38	32.3	16.7	1.03	30%	2.28	2.00	0.80	0.70	344	300	114	100	200	1.3
H79	00	House no.181	Living-Kitchen	6.40	31.8	20.1	1.66	32%	3.08	2.00	1.08	0.70	466	300	154	100	200	1.3
H80	00	House no.182	Living-Kitchen	4.48	15.2	29.5	2.32	31%	3.55	2.00	1.24	0.70	537	300	177	100	200	1.3
H81	00	House no.149	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H82	00	House no.151	Living-Kitchen	5.05	30.7	16.4	1.80	31%	2.41	2.00	0.84	0.70	365	300	120	100	200	1.3
H83	00	House no.152	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H84	00	House no.153	Living-Kitchen	5.05	30.7	16.4	1.80	31%	2.41	2.00	0.84	0.70	365	300	120	100	200	1.3
H85	00	House no.154	Living-Kitchen	2.55	16.0	15.9	2.20	33%	2.08	2.00	0.73	0.70	314	300	104	100	200	1.3
H86	00	House no.155	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H87	00	House no.157	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H88	00	House no.159	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H89	00	House no.161	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H90	00	House no.163	Living-Kitchen	6.36	23.6	26.9	1.51	25%	2.95	2.00	1.03	0.70	446	300	147	100	200	1.3
H91	00	House no.137	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.14	2.00	0.75	0.70	324	300	107	100	200	1.3
H92	00	House no.137	Living-Kitchen	3.97	21.7	18.3	2.65	36%	2.75	2.00	0.96	0.70	415	300	137	100	200	1.3
H93	00	House no.139	Living-Kitchen	2.55	16.0	15.9	2.20	36%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H94	00	House no.141	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H95	00	House no.145	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3
H96	00	House no.148	Living-Kitchen	5.05	30.7	16.4	1.80	28%	2.21	2.00	0.77	0.70	334	300	110	100	200	1.3

Table 5.1: Calculation results: Daylight performance of proposed development.



5.3 Daylight reception of proposed development conclusion

For the daylight assessment, results have been analysed within these standards:

- Assessed in accordance with IS EN17037 / BS EN17307, carried out in accordance with Method 1 and Method 2 described in the methodology section.
- Assessed in accordance with BS EN 17037:2018 National Annex.

The results from table 5.1 are reviewed under each standard. The daylight reception assessment has been targeted to habitable rooms within the proposed development. Receptors / rooms within the proposed development are indicated in image 5.1 to 5.12.

- Apartments: Block J, all habitable rooms within the proposed block on the ground floor and first floor have been assessed. Once a (lowest level) room is compliant, rooms at higher levels with similar configuration / parameters are deemed compliant on the basis that the room daylight factor would have improved due to the better vertical sky view angle of higher located rooms.
- Triplex unit: all habitable rooms on the ground floor and first floor have been assessed.
- All other house types: The daylight reception assessment has been targeted to habitable rooms within the proposed development on the ground floor which are observed to be in the most daylight challenging positions or rooms positioned with close by obstacles.

IS EN17037 / BS EN17307: To achieve recommendations outlined in IS EN 17037:2018 / BS EN 17307:2018, a given room must achieve: a target daylight factor of 2.0% or in terms of illuminance 300 lux on over 50% of the floor area for over 50% of the available daylight hours. And a minimum target daylight factor of 0.7% or in terms of illuminance 100 lux on over 95% of the floor area for over 50% of the available daylight hours. From the calculation result table 5.1 we note the vast majority of the proposed rooms calculated daylight results achieved the minimum guidelines or achieved well in excess of the guidelines.

- Apartments: Overall, examined residential rooms for Apartment block J, achieved on average a daylight factor (DF) of 2.9% and an illuminance of 443 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 1.0% and an illuminance of 146 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. The proposed apartment block achieves well in excess of recommendations.
- Triplex unit: Overall, examined residential rooms achieved on average a daylight factor (DF) of 1.88% and an illuminance of 286 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 0.66% and an illuminance of 94 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. 2 no. of bedrooms within the triplex fall below the target values; however, these shortfalls are limited in extent, arise from unavoidable site constraints, and do not materially affect the overall quality of accommodation. In line with planning practice, the BRE Guidelines are applied flexibly, recognising that full compliance is not always achievable in higher-density contexts. These 2 small shortfalls are justified by the overall design quality and the significant wider planning benefits delivered.
- Houses: Overall, examined residential rooms achieved on average a daylight factor (DF) of 2.3% and an illuminance of 361 lux on over 50% of the floor area for over 50% of the available daylight hours. An average DF of 0.8% and an illuminance of 119 lux on over 95% of the floor area for over 50% of the available daylight hours was achieved. The mix of proposed house types achieves recommendations.

In an urban environment it can more often be the case that complete fulfilment with the guidelines is not attainable. Within the BS EN 17037 it acknowledges that a rigid application of the European Standard could prove to be a difficult task as it offers only a single target for new buildings and IS EN17037 currently has no specific National Annex. The British Annex of BS EN 17037, daylight recommendations differ depending on the function of a room and offers minimum daylight provision targets for kitchens, living rooms and bedrooms.

Therefore, Given the similarity of weather, light and design patterns between Ireland and the UK and the lack of specific localisation Annex details in the Irish version, the alternate minimum daylight provision targets set out in the national annex of BS EN 17037 are reviewed next.

BS EN 17037:2018 National Annex: To achieve the alternate minimum daylight recommendations for Dublin, the room in question must achieve: Kitchen 1.3% target daylight factor or in terms of illuminance 200 lux. Living room 1.0% target daylight factor or in terms of illuminance 150 lux, and bedrooms 0.7% target daylight factor or in terms of illuminance 100 lux all over 50% of the floor area for over half the daylight hours. From the calculation result table 5.1 we note that all of the rooms calculated daylight are well in excess of these minimum guidelines.

- Overall compliance for proposed development = 100%

In summary, the calculation results have achieved a high level of compliance under IS EN17037 / BS EN17307 and full compliance under BS EN 17037:2018 National Annex guidelines. This indicates an overall good level of daylight for the proposed development under the guidelines. We conclude, the proposed development can provide a good level of residential daylight amenity to future occupants.



Sunlight Reception

Sunlight in the new proposed amenity areas:

5.4 Receptor selection - Amenity spaces within the proposed development

Image 5.13 below indicates the public open space amenity areas that have been selected and analysed on the basis that the shadow casted from the proposed development may affect the amenity areas given its geographical location in relation to the development. These areas are identified below and labelled for reference in the results.

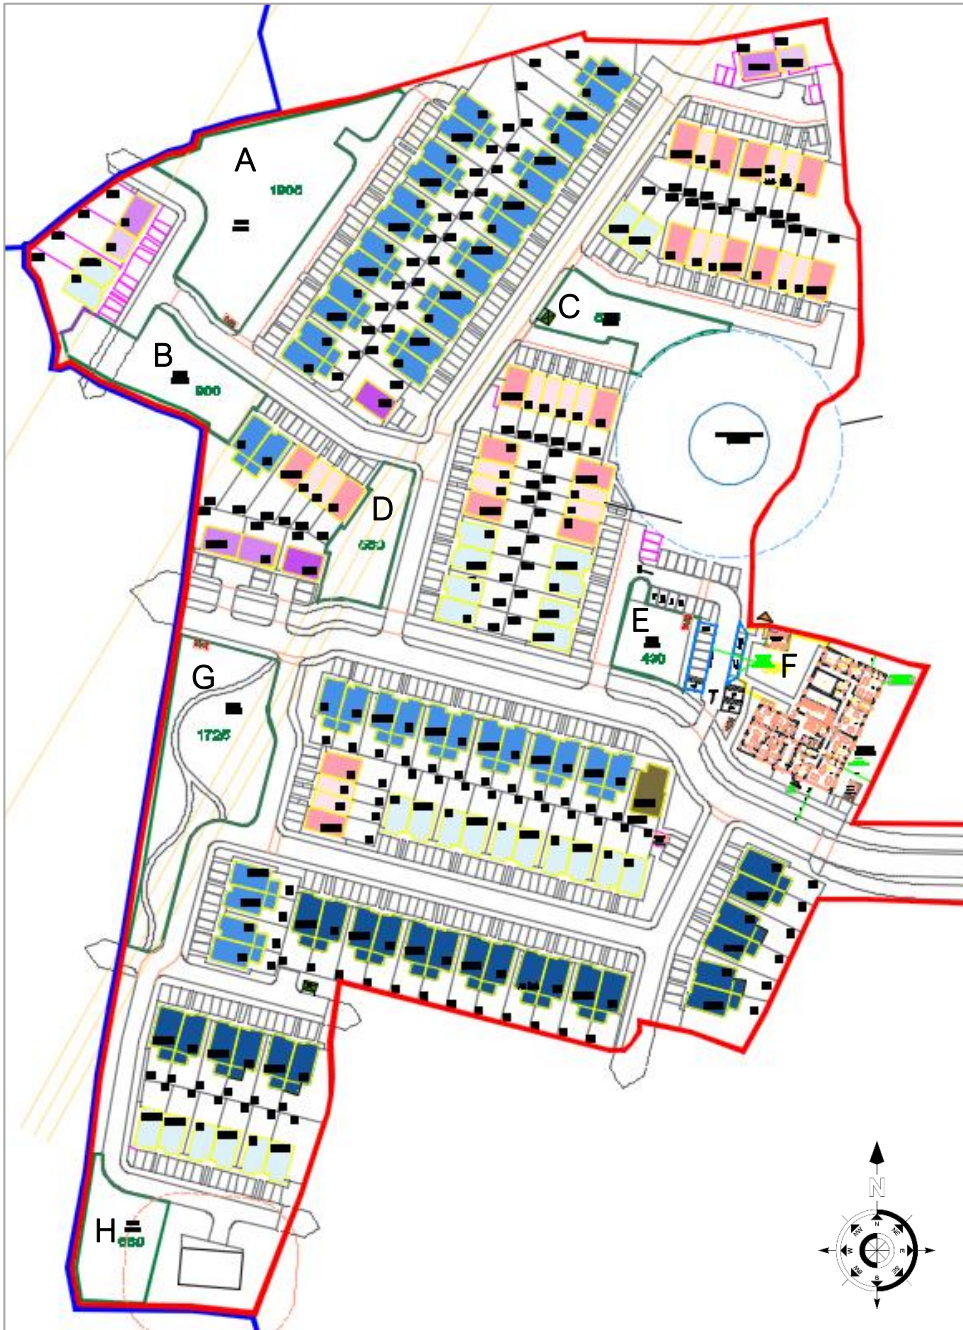


Image 5.13: New proposed amenity spaces within the development.

Receptor	Amenity Description	Amenity area (m ²)
A	Open Space	1,905
B	Open Space	900
C	Open Space	580
D	Open Space	560
E	Open Space	430
F	Open Space	350
G	Open Space	1,725
H	Open Space	660

Table 5.2: List of new proposed amenity spaces.

5.5 Calculation result table

The result table below provides a summary of the calculation results of the proposed amenity areas. It shows the overall hours of sunlight on March 21st together with the 'to-be-achieved' BRE minimum sunlight standards. Appendix B provides the full calculation results of the proposed amenity areas. The calculation results have been given the following colour code guide depending on its level of resulting compliance.

Compliance guide

☑	0% Over /equal to
☑	5% Within
!!	10% Within
x	10% In excess of

Amenity space ID ref	Amenity space area (m ²)	Achieved daily sun time * area	Achieved total sun time (hrs)	Required sun hours @ 50% area	Achieved sun hours on @ 50% area
A	1905.0	1040130.0	9.10	2.0	9.0
B	900.0	488160.0	9.04	2.0	11.0
C	580.0	358092.0	10.29	2.0	10.0
D	560.0	264768.0	7.88	2.0	8.0
E	430.0	207948.0	8.06	2.0	8.0
F	350.0	76020.0	3.62	2.0	4.0
G	1725.0	934605.0	9.03	2.0	10.0
H	660.0	417780.0	10.55	2.0	11.0

Table 5.3: Calculation results: Summary table of sunlight analysis of proposed amenity spaces.

5.6 Sunlight reception – amenity areas of the proposed development conclusion

Based on the BRE guidelines at least 50% of the amenity space should receive at least two hours of sunlight on the 21st of March. From the calculation results in table 5.3 we note that all selected amenity spaces received well in excess of the minimum 2 hours of sunlight on at least 50% of the area on March 21st, see image 5.13 for receptor/amenity space locations. Summary of results are as follows:

- The calculated average sunlight on at least 50% of the area on March 21st for Open space amenity areas is 8.8 hours.

This confirms the amenity areas proposed will be adequately sunlit throughout the year. We conclude that the new amenity spaces receive sunlight on 50% of the area is in line with the recommendations of the BRE Report - Site Layout and Planning for Daylight and Sunlight - and therefore deem these to be compliant to this element.



6 Impact of proposed development – Calculation results and conclusion

The impact of the proposed development calculations and assessments is broken into two sections, impact on daylight reception and impact on sunlight reception.

Impact on Daylight Reception:

Vertical sky component (VSC):

6.1 Receptor selection – Buildings / windows neighbouring the proposed development

The VSC assessment has been targeted to habitable neighbouring windows / rooms / dwellings that are perceived to be in challenging locations i.e., ground floor rooms and dwellings/rooms in the vicinity of the new proposed development on the basis that if these habitable rooms pass the minimum requirements all rooms at higher levels will definitely pass the minimum recommendations as a result of the improving vertical sky view angle. Image 6.1-6.3 below indicates the windows that have been selected and analysed. The windows are identified and labelled for reference in the results.

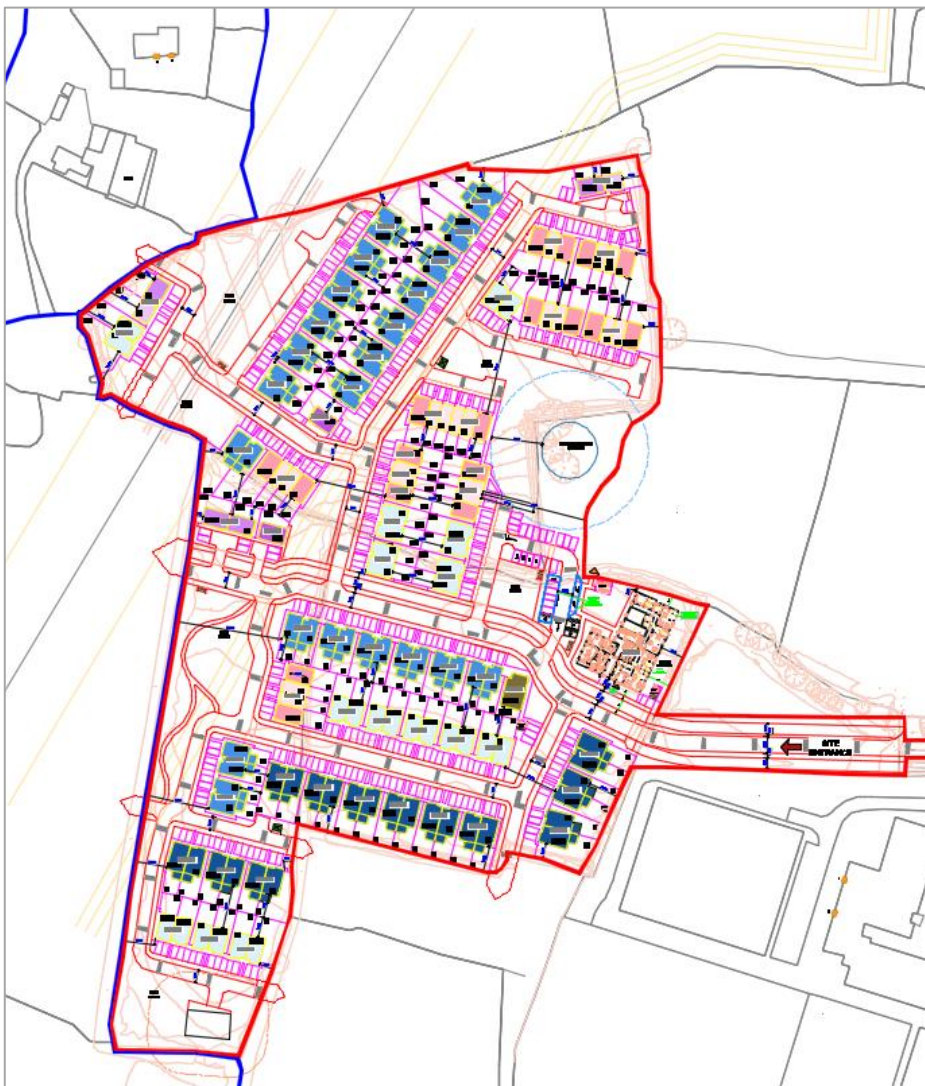


Image 6.1: Daylight impact: Neighbouring receptors – Overall view (receptor no. 1 - 4).

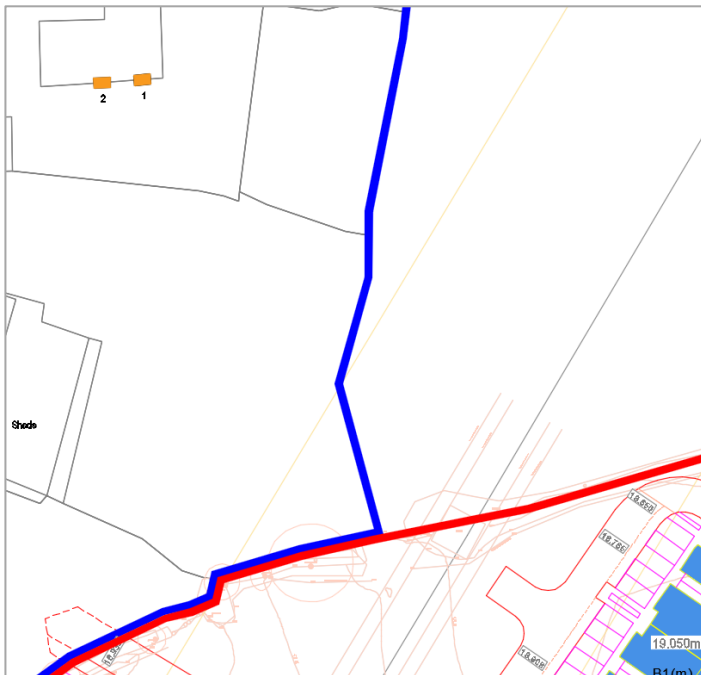


Image 6.2: Daylight impact: Neighbouring receptors (receptor no. 1 - 2).

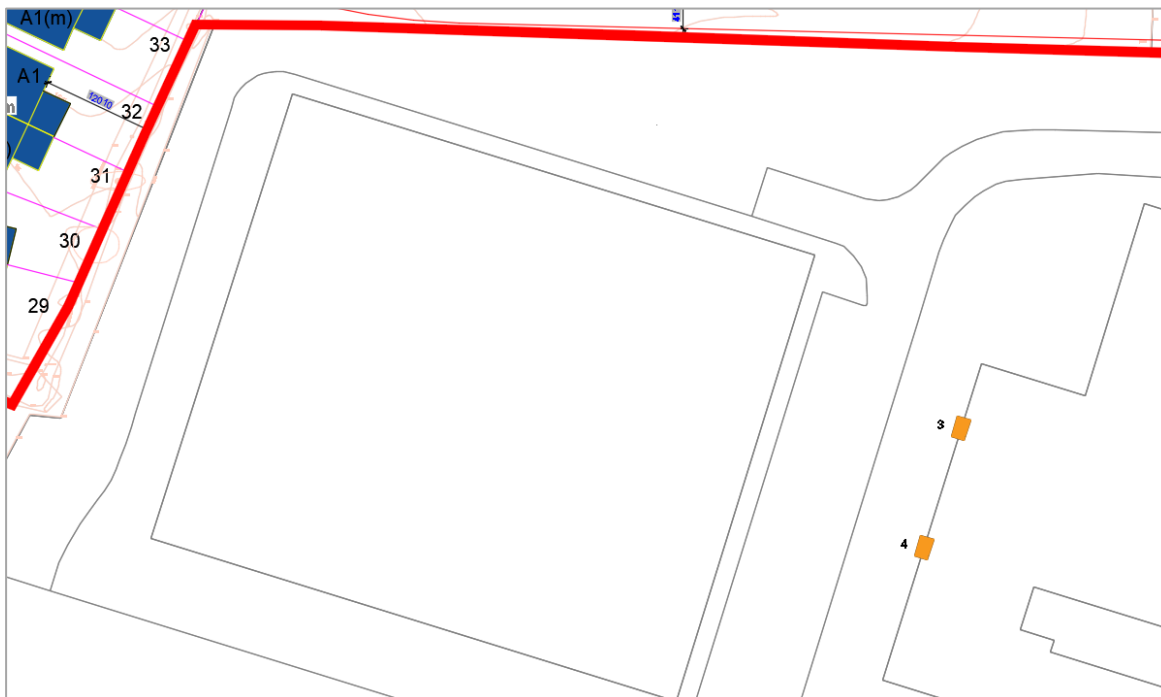


Image 6.3: Daylight impact: Neighbouring receptors (receptor no. 3 - 4).

Receptor/window *	Level	Location / Address	Dwelling description
1, 2	00	Ashmount, Moneteen, Mungret, Limerick	Residential
3, 4	00	Mungret community college, Caheranadrish, Limerick	School/educational

Table 6.1: List of receptors selected for analysis.

* The BRE report outlines VSC guidelines are intended for use for rooms where daylight is required, including living rooms, kitchens and bedrooms. Windows to bathrooms, toilets, storerooms, circulation areas and garages need not be analysed or commercial premises.

* The windows have been calculated as ground floor receptors. On the basis that if these habitable rooms pass the minimum requirements all rooms at higher levels will definitely pass the minimum recommendations as a result of the improving vertical sky view angle.

6.2 Calculation result table

The VSC has been calculated for potentially affected windows within the neighbouring/adjacent properties. Locations of receptors are based on guideline recommendations for the closest facades which have windows with potential for impact. The change factor or effect on daylight reception in an existing habitable room should not be affected by more than 20% i.e., a maximum change factor of 0.8. The column named comment/effect describes the level of change an assessed window will experience, based on its compliance with the BRE target. A list of definitions can be found in section 4.8 of this report. To identify the status of the change factor in the tables below we use the following colour code guide depending on its level of resulting compliance status. The summary result table below provides the VSC calculation results. Appendix C provides the full calculation result table.

Compliance guide

☑	0% Over /equal to
☑	5% Within
!!	10% Within
x	10% In excess of

Receptor ID	Existing baseline VSC value [%]	Proposed VSC value [%]	Change factor	Comment / Effect of proposed development
Receptor 1	36%	35%	0.99	Negligible
Receptor 2	36%	35%	0.99	Negligible
Receptor 3	37%	36%	0.98	Negligible
Receptor 4	37%	36%	0.98	Negligible

Table 6.2: Calculation results: Summary table of VSC results.

6.3 Impact on daylight reception conclusion

The BRE recommends that the effects of a new development on daylight reception should not impact any existing VSC by more than 20% or have a maximum change factor in excess of 0.80. From the calculation results we note all selected neighbouring habitable receptors are affected to some degree with regards to daylight reception due to the introduction of the proposed development in their respective habitable rooms facing the proposed development. The calculated change in daylight reception in all of the neighbouring receptors/windows achieved a change factor ranging from 0.98 to 0.99. Summarized result findings are as follows (see image 6.1-6.3 for receptor locations):

- North receptors: Receptor no. 1 and 2: Existing dwelling (Ashmount, Moneteen, Mungret) with ground floor windows was examined and resulted in a change factor of 0.99. These receptors are comfortably within the guidelines and the effect is determined as negligible under BRE definitions.
- East receptors: Receptor no. 3 to 4: Existing dwelling (Mungret Community College) with ground floor windows was examined and resulted in a change factor of 0.98. These receptors are comfortably within the guidelines and the effect is determined as negligible under BRE definitions.
- Overall, the average change ratio for VSC is 0.98.

We conclude that the new proposed development's effect on daylight reception in the neighbouring rooms is all within the constraints and recommendations of the BRE Report – Site Layout and Planning for Daylight and Sunlight BR209 2022, and we therefore deem the proposed development to be compliant with this element.



Impact on Sunlight Reception:

Sunlight in existing amenity areas:

6.4 Receptor selection – Existing amenity spaces

The sunlight reception assessment is targeted to neighbouring amenity spaces that might be affected by the introduction of the new proposed development. BR 209 (2022) outlines sunlight checks should include gardens, parks & playing fields, playgrounds, swimming pools, areas of recreational water, moorings, sitting out areas and nature reserves. Image 6.4 below indicates the neighbouring amenity areas selected and analysed on the basis that the shadow casted from the new development may impact these amenity areas given its geographical location in relation to the proposed development. These areas are identified below and labelled for reference in the results.

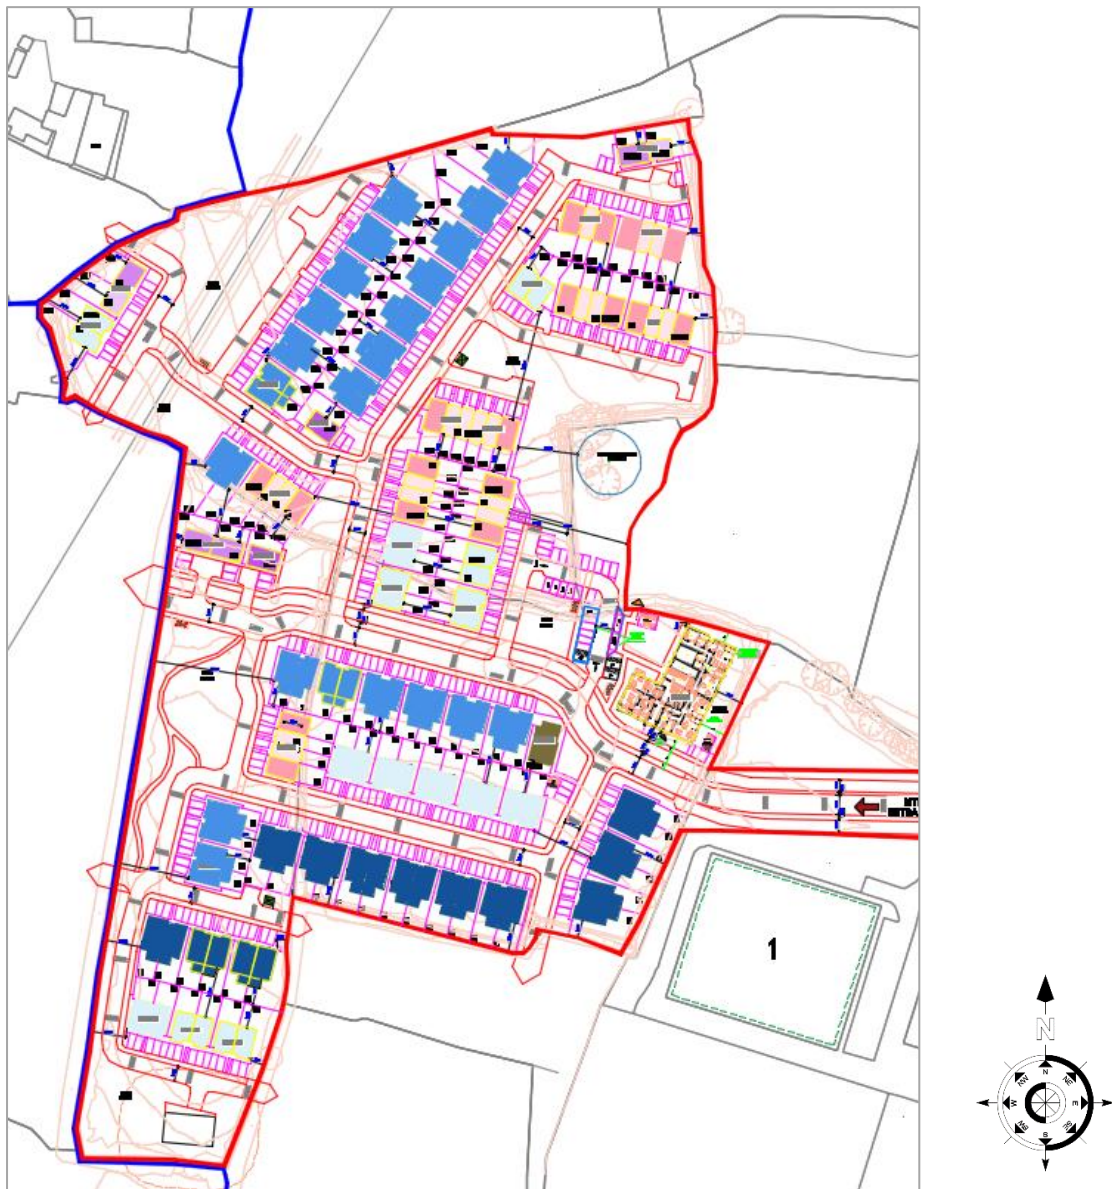


Image 6.4: Sunlight impact: Existing neighbouring amenity spaces. Receptor no.1

Receptor	Location / Address	Amenity description	Approx. area (m ²)
1	Mungret community college, Caheranadrish, Limerick	Outdoor sports pitch	2,750

Table 6.3: Sunlight impact: List of existing neighbouring amenity spaces.



6.5 Calculation result table

The table below provides a summary of the calculation results of the selected amenity space before and after the introduction of the new proposed development. Under the BRE guidelines any loss of sunlight in existing neighbouring amenity spaces as a result of the new development should not be greater than 0.8 times (maximum 20% reduction) its former size. The column named comment/effect describes the level of effect an assessed window will experience, based on its compliance with the BRE target. A list of definitions can be found in the section 4.8 of this report. Appendix D provides the full calculation results of the amenity areas. To identify the status of the change factor the following colour code guide is used depending on its level of resulting compliance status.

Compliance guide

	0% Over /equal to
	5% Within
	10% Within
	10% In excess of

Amenity space ID	Amenity space area (m ²)	EXISTING STATUS			NEW STATUS			Change factor	Comment / effect of proposed development
		sun hours * amenity space area (Sun Hr*m ²)	total sun hours (Sun Hr)	sun hours on 50% of the area	sun hours * amenity space area (Sun Hr*m ²)	total sun hours (Sun Hr)	sun hours on 50% of the area		
1	2,750	1618650	9.81	10.0	1579050	9.57	10.0	0.98	Negligible

Table 6.4: Calculation results: summary table of sunlight impact of existing neighbouring amenity spaces.

6.6 Impact on sunlight reception conclusion

Based on the BRE guidelines at least 50% of the amenity space should receive at least two hours of sunlight on the 21st of March and that any loss of sunlight should not be greater than 0.80 (20% reduction) times its former size. From the calculation results we note that all the existing amenity spaces received 2 hours of sunlight or more on at least 50% of the area before and after the introduction of the new development. Summary of results are as follows (see image 6.4 for receptor locations):

- East receptor: Receptor no. 1 is an outdoor sports pitch to Mungret Community College. The receptor resulted in a change factor of 0.98. The change happens in the late afternoon/evening hour of 18.00-19.00. The calculation findings are comfortably within the guidelines, and the effect is determined as 'negligible' under BRE definitions.

We conclude that the new proposed development's effect on sunlight reception in the neighbouring amenity areas is all within the constraints and minimum recommendations of the BRE Report – Site Layout and Planning for Daylight and Sunlight BR209 2022, and we therefore deem the proposed development to be compliant with this element.



Appendix A

Sunlight analysis illustrations: plotted in one hourly illustration time frames for March 21st (Spring equinox).

Proposed status: 06:00 to 19:00 hours.

06.00 March 21st



07.00 March 21st




08.00 March 21st09.00 March 21st

10.00 March 21st11.00 March 21st


12.00 March 21st




13.00 March 21st

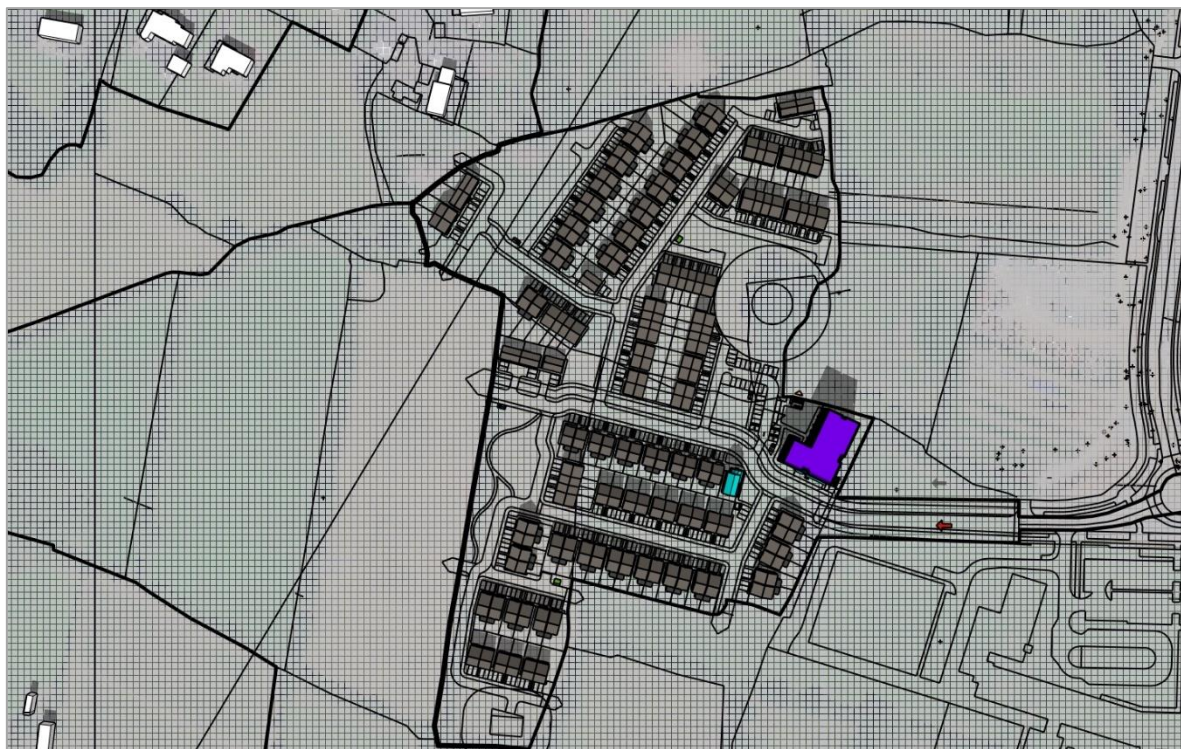

14.00 March 21st

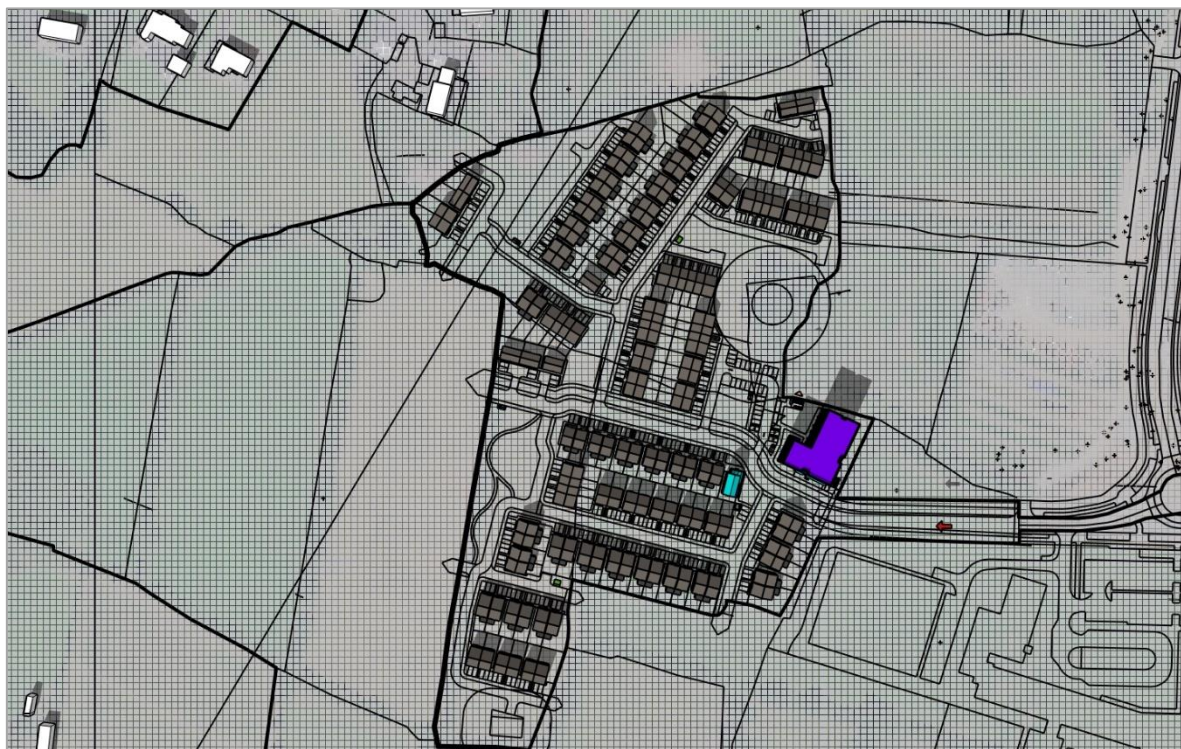

15.00 March 21st

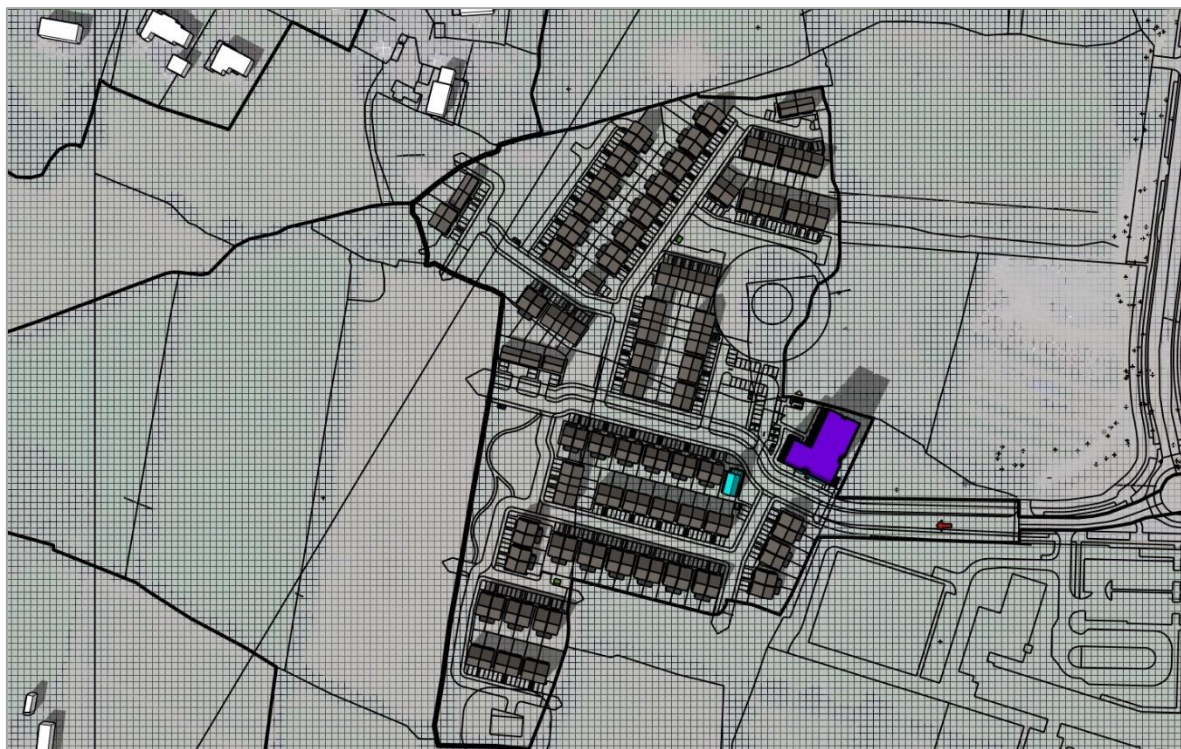

16.00 March 21st



17.00 March 21st



18.00 March 21st



19.00 March 21st



Appendix B

Sunlight calculation results of the developments proposed amenity areas providing the overall hours of sunlight on March 21st together with the recommended BRE sunlight standards.

A						1905.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	100%	0%	60	0	0	
8.00	77%	23%	60	438	26,289	
9.00	21%	79%	60	1505	90,297	
10.00	0%	100%	60	1905	114,300	
11.00	0%	100%	60	1905	114,300	
12.00	0%	100%	60	1905	114,300	
13.00	0%	100%	60	1905	114,300	
14.00	0%	100%	60	1905	114,300	
15.00	0%	100%	60	1905	114,300	
16.00	8%	92%	60	1753	105,156	
17.00	12%	88%	60	1676	100,584	
18.00	72%	28%	60	533	32,004	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						9.00
Achieved total sun time (hrs)						9.10
Achieved daily sun time * area						1040130

B						900.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	100%	0%	60	0	0	
8.00	39%	61%	60	549	32,940	
9.00	38%	62%	60	558	33,480	
10.00	30%	70%	60	630	37,800	
11.00	27%	73%	60	657	39,420	
12.00	19%	81%	60	729	43,740	
13.00	9%	91%	60	819	49,140	
14.00	0%	100%	60	900	54,000	
15.00	0%	100%	60	900	54,000	
16.00	0%	100%	60	900	54,000	
17.00	11%	89%	60	801	48,060	
18.00	23%	77%	60	693	41,580	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						11.00
Achieved total sun time (hrs)						9.04
Achieved daily sun time * area						488160

C						580.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	53%	47%	60	273	16,356	
8.00	0%	100%	60	580	34,800	
9.00	0%	100%	60	580	34,800	
10.00	0%	100%	60	580	34,800	
11.00	0%	100%	60	580	34,800	
12.00	0%	100%	60	580	34,800	
13.00	0%	100%	60	580	34,800	
14.00	0%	100%	60	580	34,800	
15.00	0%	100%	60	580	34,800	
16.00	0%	100%	60	580	34,800	
17.00	18%	82%	60	476	28,536	
18.00	100%	0%	60	0	0	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						10.00
Achieved total sun time (hrs)						10.29
Achieved daily sun time * area						358092

D						560.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	100%	0%	60	0	0	
8.00	92%	8%	60	45	2,688	
9.00	26%	74%	60	414	24,864	
10.00	0%	100%	60	560	33,600	
11.00	0%	100%	60	560	33,600	
12.00	0%	100%	60	560	33,600	
13.00	0%	100%	60	560	33,600	
14.00	0%	100%	60	560	33,600	
15.00	15%	85%	60	476	28,560	
16.00	39%	61%	60	342	20,496	
17.00	53%	47%	60	263	15,792	
18.00	87%	13%	60	73	4,368	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						8.00
Achieved total sun time (hrs)						7.88
Achieved daily sun time * area						264768

G						1725.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	100%	0%	60	0	0	
8.00	84%	16%	60	276	16,560	
9.00	40%	60%	60	1035	62,100	
10.00	16%	84%	60	1449	86,940	
11.00	0%	100%	60	1725	103,500	
12.00	0%	100%	60	1725	103,500	
13.00	0%	100%	60	1725	103,500	
14.00	0%	100%	60	1725	103,500	
15.00	0%	100%	60	1725	103,500	
16.00	0%	100%	60	1725	103,500	
17.00	21%	79%	60	1363	81,765	
18.00	36%	64%	60	1104	66,240	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						10.00
Achieved total sun time (hrs)						9.03
Achieved daily sun time * area						934605

E						430.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	94%	6%	60	26	1,548	
8.00	100%	0%	60	0	0	
9.00	94%	6%	60	26	1,548	
10.00	56%	45%	60	194	11,610	
11.00	11%	89%	60	383	22,962	
12.00	0%	100%	60	430	25,800	
13.00	0%	100%	60	430	25,800	
14.00	0%	100%	60	430	25,800	
15.00	0%	100%	60	430	25,800	
16.00	0%	100%	60	430	25,800	
17.00	9%	91%	60	391	23,478	
18.00	31%	69%	60	297	17,802	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						8.00
Achieved total sun time (hrs)						8.06
Achieved daily sun time * area						207948

F						350.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	100%	0%	60	0	0	
8.00	100%	0%	60	0	0	
9.00	100%	0%	60	0	0	
10.00	100%	0%	60	0	0	
11.00	100%	0%	60	0	0	
12.00	100%	0%	60	0	0	
13.00	100%	0%	60	0	0	
14.00	59%	41%	60	144	8,610	
15.00	36%	64%	60	224	13,440	
16.00	17%	83%	60	291	17,430	
17.00	0%	100%	60	350	21,000	
18.00	26%	74%	60	259	15,540	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						4.00
Achieved total sun time (hrs)						3.62
Achieved daily sun time * area						76020

H						660.00 m ²
NEW STATUS						March 21st
Time	Shadow	Sunlight	Sun time	Sun area	Sun time.area	
24 Hr	% / %		min	m ²	min*m ²	
6.00	100%	0%	60	0	0	
7.00	57%	43%	60	284	17,028	
8.00	0%	100%	60	660	39,600	
9.00	0%	100%	60	660	39,600	
10.00	0%	100%	60	660	39,600	
11.00	0%	100%	60	660	39,600	
12.00	0%	100%	60	660	39,600	
13.00	0%	100%	60	660	39,600	
14.00	0%	100%	60	660	39,600	
15.00	0%	100%	60	660	39,600	
16.00	16%	84%	60	554	33,264	
17.00	26%	74%	60	488	29,304	
18.00	46%	54%	60	356	21,384	
19.00	100%	0%	60	0	0	
Required sun hours @ 50% area						2
Achieved sun hours on @ 50% area						11.00
Achieved total sun time (hrs)						10.55
Achieved daily sun time * area						417780



Appendix C

Daylight calculation results of existing VSC and the VSC after the introduction of the new proposed development.

Receptor 1		EXISTING								NEW								change				
VSC test distance	24 m	Section 1		Section 2		Section 3		Section 4		Σ Hor	Σ VSC	Section 1		Section 2		Section 3			Section 4		Σ Hor	Σ VSC
Target distance	89m	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°			Hor°	Ver°	Hor°	Ver°	Hor°	Ver°		Hor°	Ver°		
		72	8	108	2					180	36%	72	8	90	5	18	2				180	35%
																					0.99	
Receptor 2		EXISTING								NEW								change				
VSC test distance	24 m	Section 1		Section 2		Section 3		Section 4		Σ Hor	Σ VSC	Section 1		Section 2		Section 3			Section 4		Σ Hor	Σ VSC
Target distance	89m	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°			Hor°	Ver°	Hor°	Ver°	Hor°	Ver°		Hor°	Ver°		
		73	8	107	2					180	36%	73	8	90	5	17	2				180	35%
																					0.99	
Receptor 3		EXISTING								NEW								change				
VSC test distance	24 m	Section 1		Section 2		Section 3		Section 4		Σ Hor	Σ VSC	Section 1		Section 2		Section 3			Section 4		Σ Hor	Σ VSC
Target distance	106m	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°			Hor°	Ver°	Hor°	Ver°	Hor°	Ver°		Hor°	Ver°		
		180	1							180	37%	20	9	61	5	99	1				180	36%
																					0.98	
Receptor 4		EXISTING								NEW								change				
VSC test distance	24 m	Section 1		Section 2		Section 3		Section 4		Σ Hor	Σ VSC	Section 1		Section 2		Section 3			Section 4		Σ Hor	Σ VSC
Target distance	106m	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°	Hor°	Ver°			Hor°	Ver°	Hor°	Ver°	Hor°	Ver°		Hor°	Ver°		
		180	1							180	37%	20	9	62	5	98	1				180	36%
																					0.98	



Appendix D

Sunlight calculation results of existing amenity spaces before and after the introduction of the new proposed development.

1				2,750 m ²								
EXISTING STATUS				March 21st		NEW STATUS				March 21st		change
Time	Shadow	Sunlight	Sun time	Sun area	time * area	Time	Shadow	Sunlight	Sun time	Sun area	time * area	time * area
24 Hr	% / %		min	m ²	min*m ²	24 Hr	% / %		min	m ²	min*m ²	min*m ²
6.00	100%	0%	60	0	0	6.00	100%	0%	60	0	0	0
7.00	93%	7%	60	193	11,550	7.00	93%	7%	60	193	11,550	0
8.00	73%	27%	60	743	44,550	8.00	73%	27%	60	743	44,550	0
9.00	22%	78%	60	2145	128,700	9.00	22%	78%	60	2145	128,700	0
10.00	9%	91%	60	2503	150,150	10.00	9%	91%	60	2503	150,150	0
11.00	0%	100%	60	2750	165,000	11.00	0%	100%	60	2750	165,000	0
12.00	0%	100%	60	2750	165,000	12.00	0%	100%	60	2750	165,000	0
13.00	0%	100%	60	2750	165,000	13.00	0%	100%	60	2750	165,000	0
14.00	0%	100%	60	2750	165,000	14.00	0%	100%	60	2750	165,000	0
15.00	0%	100%	60	2750	165,000	15.00	0%	100%	60	2750	165,000	0
16.00	0%	100%	60	2750	165,000	16.00	0%	100%	60	2750	165,000	0
17.00	10%	90%	60	2475	148,500	17.00	10%	90%	60	2475	148,500	0
18.00	12%	88%	60	2420	145,200	18.00	36%	64%	60	1760	105,600	-39,600
19.00	100%	0%	60	0	0	19.00	100%	0%	60	0	0	0
Required sun hours @ 50% area (hr)					2	Required sun hours @ 50% area (hr)					2	
Achieved sun hours on (hrs) @ 50% area					10.00	Achieved sun hours on (hrs) @ 50% area					10.00	
Achieved total sun time (hrs)					9.81	Achieved total sun time (hrs)					9.57	0.98
Achieved daily sun time * area					1618650	Achieved daily sun time * area					1579050	0.98



End of Report

