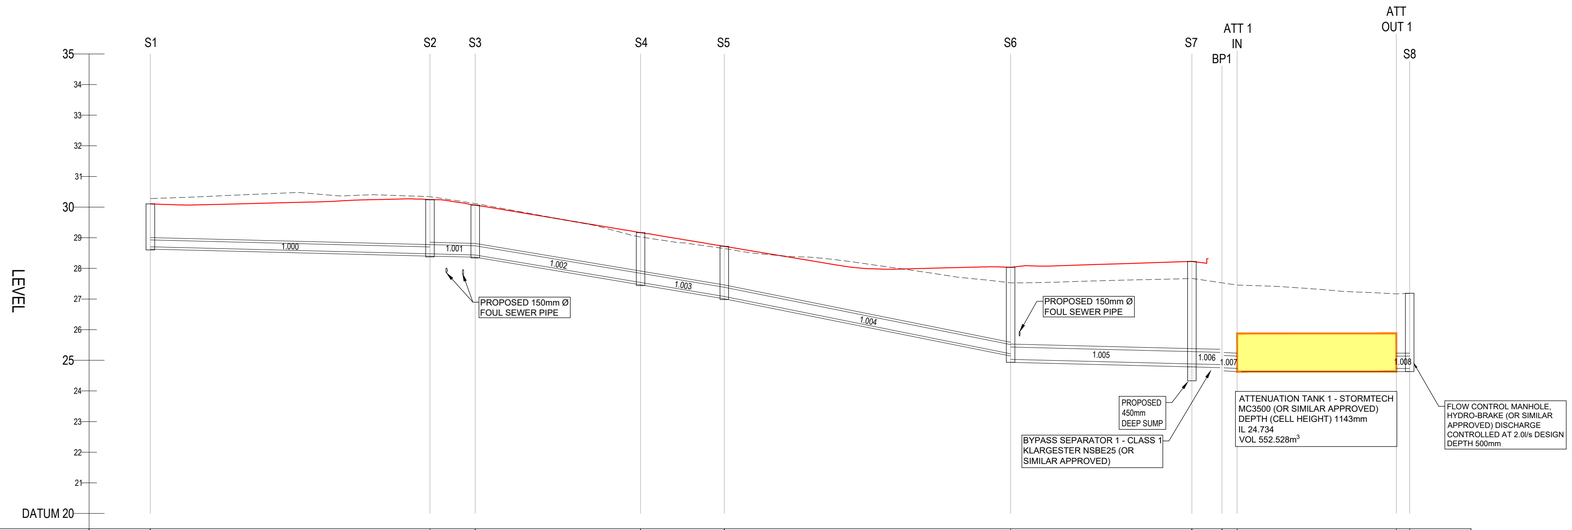

S1
S2
S3
S4
S5
S6
S7
ATT 1 IN
BP1
ATT OUT 1
S8
LEVEL
35
34
33
32
31
30
29
28
27
26
25
24
23
22
21
DATUM 20
1.000
1.001
1.002
1.003
1.004
1.005
1.006
1.007
1.008
PROPOSED 150mm Ø FOUL SEWER PIPE
PROPOSED 150mm Ø FOUL SEWER PIPE
PROPOSED 450mm DEEP SUMP
BYPASS SEPARATOR 1 - CLASS 1 KLARGESTER NSBE25 (OR SIMILAR APPROVED)
ATTENUATION TANK 1 - STORMTECH MC3500 (OR SIMILAR APPROVED) DEPTH (CELL HEIGHT) 1143mm IL 24.734 VOL 552.528m³
FLOW CONTROL MANHOLE, HYDRO-BRAKE (OR SIMILAR APPROVED) DISCHARGE CONTROLLED AT 2.0l/s DESIGN DEPTH 500mm

| | | |